

SITE NOTICES






12/01/2017 12:05 PM

23,487,96° S 30,381,64° E

Auto Stamp

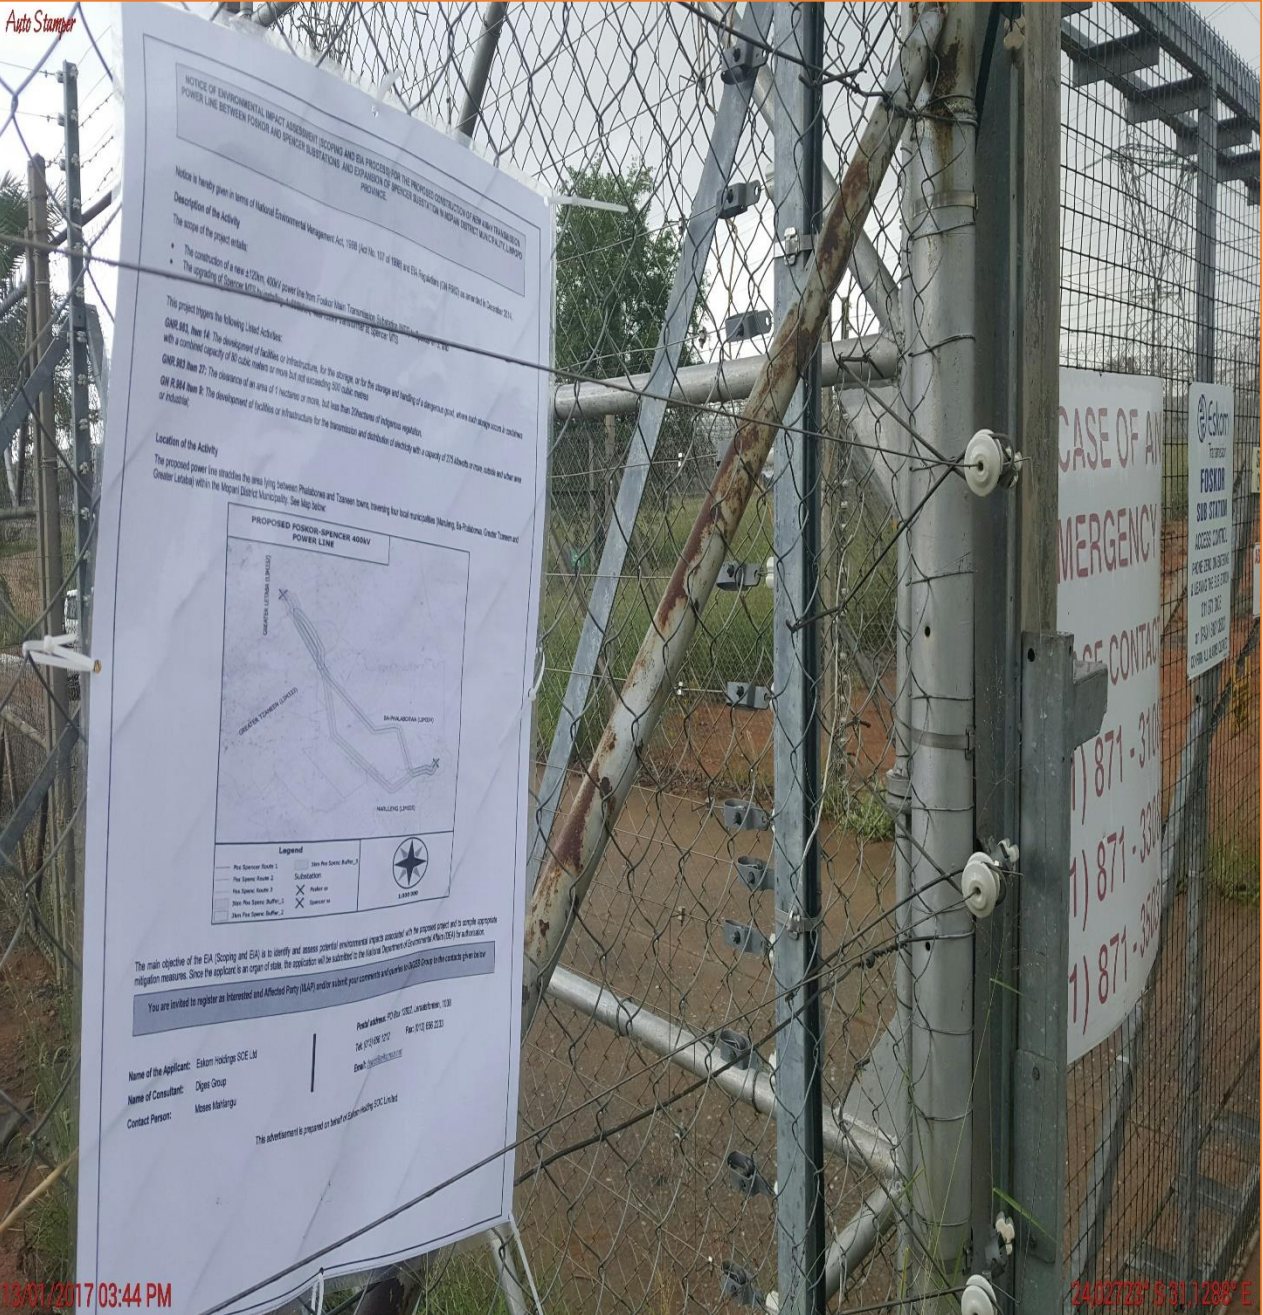

NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT (SCOPE) AND EIA PROCESS FOR THE PROPOSED CONSTRUCTION OF NEW HIGH TRANSMISSION POWER LINE BETWEEN FOSKOR AND SPENCER SUBSTATIONS AND EXPANSION OF SPENCER SUBSTATION IN MOJARD DISTRICT, MALAYSIAN PENINSULA

Notice is hereby given in terms of National Environmental Management Act, 1969 (Act No. 107 of 1969) and EIA Regulations (PR 592) as amended (October 2014), PROVINCE.

Description of the Activity
 The scope of the project entails:

- The construction of a new 40KV, 40MW power line from Foskor Main Transmission Substation to Spencer substation.
- The upgrading of Spencer 40KV substation.

Location of the Activity
 The proposed power line involves the area lying between Phalokan and Taseen town, traversing four local municipalities (Majard, Sa-Palokan, Ulu-Taseen and Greater Lanting) within the Mojard District Municipality. See Map below.



The main objective of the EIA (Scope) and EIA) is to identify and assess potential environmental impacts associated with the proposed project and to propose appropriate mitigation measures. Since the applicant is an organ of state, the application will be submitted to the National Department of Environment (NDE) for a determination.

You are invited to register as Interested and Affected Party (I/AAP) and/or submit your comments and queries to NDE through the contact person below.

Name of the Applicant: Eikom Holdings Sdn Bhd
 Name of Consultant: Diges Group
 Contact Person: Moses Marituge


Postal Address: 47000 Seremban, Negeri Sembilan, 70300
 Tel: 6760 281 222 Fax: 6760 281 223
 Email: info@eikom.com

This advertisement is prepared on behalf of Eikom Holdings Sdn Bhd.

CASE OF AN EMERGENCY
 PLEASE CONTACT
 1) 871-3100
 1) 871-3100
 1) 871-3100

13/01/2017 03:44 PM

24.02723° S 31.1288° E

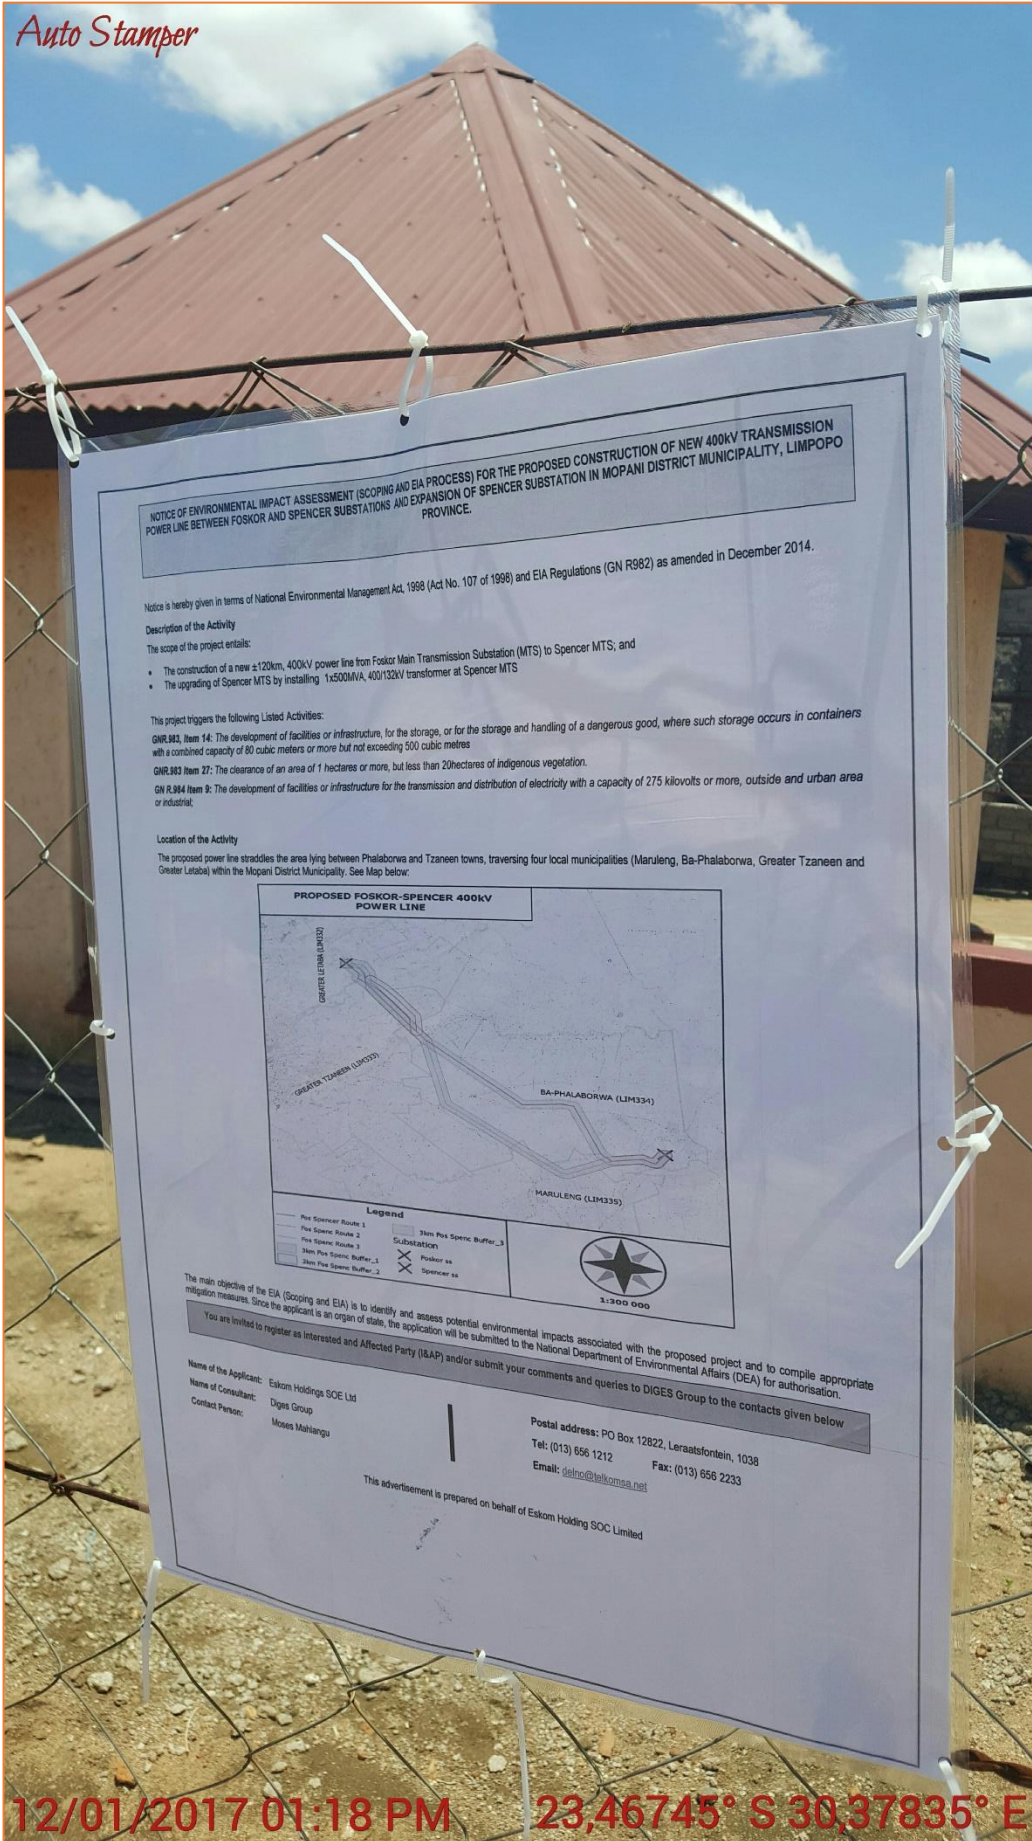

NOTICE OF ENVIRONMENTAL IMPACT ASSESSMENT (SCOPING AND EIA PROCESS) FOR THE PROPOSED CONSTRUCTION OF NEW 400kV TRANSMISSION POWER LINE BETWEEN FOSKOR AND SPENCER SUBSTATIONS AND EXPANSION OF SPENCER SUBSTATION IN MOPANI DISTRICT MUNICIPALITY, LIMPOPO PROVINCE.

Notice is hereby given in terms of National Environmental Management Act, 1998 (Act No. 107 of 1998) and EIA Regulations (GN R982) as amended in December 2014.

Description of the Activity

- The scope of the project entails:
- The construction of a new ±120km, 400kV power line from Foskor Main Transmission Substation (MTS) to Spencer MTS; and
 - The upgrading of Spencer MTS by installing 1x500MVA, 400/132kV transformer at Spencer MTS

This project triggers the following Listed Activities:


GNR 983, Item 14: The development of facilities or infrastructure, for the storage, or for the storage and handling of a dangerous good, where such storage occurs in containers with a combined capacity of 90 cubic meters or more but not exceeding 500 cubic metres

GNR 983 Item 27: The clearance of an area of 1 hectares or more, but less than 20hectares of indigenous vegetation.

GN R.984 Item 9: The development of facilities or infrastructure for the transmission and distribution of electricity with a capacity of 275 kilovolts or more, outside and urban area or industrial.

Location of the Activity

The proposed power line straddles the area lying between Phalaborwa and Tzaneen towns, traversing four local municipalities (Maruleng, Ba-Phalaborwa, Greater Tzaneen and Greater Lerabab) within the Mopani District Municipality. See Map below:

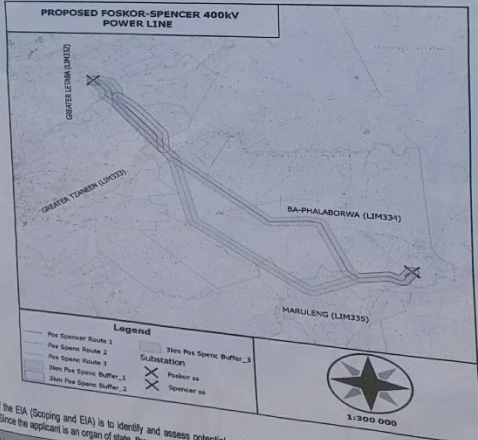

The main objective of the EIA (Scoping and EIA) is to identify and assess potential environmental impacts associated with the proposed project and to compile appropriate mitigation measures. Since the applicant is an organ of state, the application will be submitted to the National Department of Environmental Affairs (DEA) for authorisation.

You are invited to register as Interested and Affected Party (I&AP) and/or submit your comments and queries to DIGES Group to the contacts given below

Name of the Applicant: Eskom Holdings SOE Ltd
 Name of Consultant: Diges Group
 Contact Person: Moses Mahlangu

Postal address: PO Box 12822, Leraatsfontein, 1038
 Tel: (013) 656 1212 Fax: (013) 656 2233
 Email: dahno@telkomsa.net

This advertisement is prepared on behalf of Eskom Holding SOC Limited