EMAIL NOTIFICATION OF THE DRAFT EIA REPORT AVAILABILITY

🖂 🛃 🤊	🕖 🐟 🧇 🖙 DRAFT EIA REPORT AVAILABLE FOR THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE - Message (HTML)	
File	Message ESET	♡ (?
You rep	up. Start by Tuesday, May 16, 2017. Due by Tuesday, May 16, 2017. lied to this message on 07-Jun-17 10:04 AM. ssage was sent with High importance.	
From: To: Cc:	Sheila Bolingo <sheila@envirolution.co.za></sheila@envirolution.co.za>	Sent: Fri 12-May-17 5:09 PM
Bcc: Subject:	'ahugo@graze.co.za'; 'carey@acmotorhomes.co'; 'atmoolman@gmail.com'; 'sonikavton@absamail.co.za'; 'makleyn36@gmail.com'; 'albo@telkomsa.net'; 'alten@4sure.co.za'; 'langspruit@lantic.net'; 'Enquiries@dmr.gov.za'; 'andre@sta 'landusegeorge@capenature.co.za'; 'anel.abrahams@transnet.net'; 'Vincent.matabane@transnet.net'; 'albe@durand.bz'; 'brendajonck@gmail.com'; 'jonck@brlowsa.co.za'; 'brianrobertson@hilbert.co.za'; 'brian@bsmmdesign.com'; 'di 'carey@acmotorhomes.co'; 'gertenbach@vodamail.zo.za'; 'barnarc@eskom.co.za'; 'chris.mostert@vodamail.co.za'; 'christine@stadlers.co.za'; 'Christelle.VanDerMerwe@transnet.net'; 'chrisleo@bmberries.co.za'; 'christe@eskoof.co. 'danie.dutoit44@gmail.com'; 'dpbailey@vodamail.co.za'; 'derick@leisureislandholidays.com'; 'mwdiondenise@mwdio.co.za'; 'ddekock209@gmail.com'; 'admin@hartenbosgamelodge.co.za'; 'erictex@netactive.co.za'; 'blconstructions@vo DRAFT EIA REPORT AVAILABLE FOR THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE	ffgreen@yandex.com'; za'; 'info@apieskloof.co.za';
X · · ·		X
	U ← ♥	~ ~ ?
File	Message ESET	~ ♥
You rep	up. Start by Tuesday, May 16, 2017. Due by Tuesday, May 16, 2017. lied to this message on 07-Jun-17 10:04 AM. ssage was sent with High importance.	
From: To:	Sheila Bolingo <sheila@envirolution.co.za></sheila@envirolution.co.za>	Sent: Fri 12-May-17 5:09 PM
Cc Bcc	'George.classen@gmail.com'; 'gwonline86@gmail.com'; 'heinie.gericke@vodamail.co.za'; 'smithja@iafrica.com'; 'matjiesdrif@gmail.com'; 'helgardmeyer@hotmail.com'; 'Ferreira3bears@gmail.com'; 'vvuuren@law.co.za'; 'Howard@steync 'robertson.ian42@gmail.com'; 'msp@mobicast.co.za'; 'ystus.gertenbach@gmail.com'; 'jroux@mosselbay.gov.za'; 'mwjacovr@mweb.co.za'; 'dasseja@eskom.co.za'; 'mwjacovr@mweb.co.za'; 'vermaakdelana@gmail.com'; 'robfarm@mw 'vermaakdelana@gmail.com'; 'robfarm@mweb.co.za'; 'cgricius@raubenheimers.co.za'; 'robetsj@dwa.gov.za'; 'jwmeyer@mweb.co.za'; 'kwinbach@gmail.com'; 'Info@mosselbayhelicopters.co.za'; 'mosselbayhelicopters@msc.com'; 'leon 'liz@montechristo.co.za'; 'lize@vanrensburgsauctions.co.za'; 'mapaseka.lukhele@transnet.net'; 'zwaipm@gmail.com'; 'Buskes.marius@gmail.com'; 'marike@vreken.co.za'; 'mark@gondwanagr.co.za'; 'dopters2@gmail.com'; 'montagur	/eb.co.za'; .dorfling@icloud.com';
A 1 A 1	(→ 🗇 = DRAFT EIA REPORT AVAILABLE FOR THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE - Message (HTML)	- 0 ×
File	Message ESET	♡ ?
You rep	up. Start by Tuesday, May 16, 2017. Due by Tuesday, May 16, 2017. ied to this message on 07-Jun-17 10:04 AM. ssage was sent with High importance.	
From: To:	Sheila Bolingo <sheila@envirolution.co.za></sheila@envirolution.co.za>	Sent: Fri 12-May-17 5:09 PM
Cc: Bcc:	'morneclaassen2@gmail.com'; 'zwaipm@gmail.com'; 'zwaipm48@mweb.co.za'; 'zwaipm@gmail.com'; 'justus.gertenbach@gmail.com'; 'ntuthu@mto.co.za'; 'kwepertuin@gmail.com'; 'nelius@vangreunenbdy.co.za'; 'jwmeyer@mweb.co.za'; 'pierre@nyarugame.co.za'; 'pietie'; 'gobeukes@gmail.com'; 'poenaviljoen@mweb.co.za'; 'johlenemuller03@gmail.com'; 'adminboplaas@wispernet.co.za'; 'jabarnard@mweb.co.za'; 'zacmalan@gmail.com'; 's121181f@yahoo.co.uk'; 'roberts 'springer@intellect.co.za'; 'ttdt@gmail.com'; 'jonckdairy@gmail.com'; 'Brenda Jonck'; 'thuens@dabico.co.za'; 'Motlatso.Shabangu@transnet.net'; 'thysvanstaden@vox.co.za'; 'wmanuel@moselbay.gov.za'; 'walterrobertson@vodamail.co 'willemo@ecosource.co.za'; 'willieta@wispernet.co.za'; 'elenslin@gmail.com'; 'agrisa@agriinfo.co.za'; 'Enquiries@dmr.gov.za'; 'thokob@daff.gov.za'; 'WelanieKo@daff.gov.za'; 'NgobeniT@dwa.gov.za'; 'Clareen.Collins@drdlr.gov.za'; 'me	son.ian42@gmail.com'; .za'; 'stander@ion.co.za';
1 🛃 🖂	🟱 🐟 🧇 🖙 DRAFT EIA REPORT AVAILABLE FOR THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE - Message (HTML)	
File	Message ESET	♡ ♡
You rep	up. Start by Tuesday, May 16, 2017. Due by Tuesday, May 16, 2017. ied to this message on 07-Jun-17 10:04 AM. ssage was sent with High importance.	
From: To: Cc:	Sheila Bolingo <sheila@envirolution.co.za></sheila@envirolution.co.za>	Sent: Fri 12-May-17 5:09 PM
CC BCC	'Dekodr@nra.co.za'; 'peter.novellie@sanparks.org'; 'strohl@caa.co.za'; 'petrovr@elsenburg.com'; 'Pieter.vanZyl@pgwc.gov.za'; 'reservation.alert@capenature.co.za'; 'Transport.Publicworks@westerncape.gov.za'; 'Rudolf.VanJaarsve 'ceoheritage@westerncape.gov.za'; 'andew.september@westerncape.gov.za'; 'cabrahams@bgcma.co.za'; 'Shireen.pullen@westerncape.gov.za'; 'Malcolm.fredericks@westerncape.gov.za'; 'daniel.lambrechts@westerncape.gov.za'; 'cabrahams@bgcma.co.za'; 'Shireen.pullen@westerncape.gov.za'; 'Malcolm.fredericks@westerncape.gov.za'; 'daniel.lambrechts@westerncape.gov.za'; 'da 'trix@edendm.co.za'; 'ellanore@edendm.co.za'; 'trevor@george.org.za'; 'corlize@george.org.za'; 'delia@george.org.za'; 'gpretorius@george.gov.za'; 'admin@mosselbay.gov.za'; 'ddiliers@mosselbay.gov.za'; 'ekruger@mosselbay.gov. 'annatjiejvren@gmail.com'; 'adellemijn@mosselbay.gov.za'; 'groenewaldbarnie@gmail.com'; 'cbayman@mosselbay.gov.za'; 'botesm@wpk.co.za'; 'les.underhill@uct.ac.za'; 'tourism@beaufortwest.net'; 'info@birdlife.org.za'; 'chogbotani	m@edendm.co.za'; za';

EMAIL NOTIFICATION OF THE DRAFT EIA REPORT AVAILABILITY

🖂 🛛 🖓 🔍 🗢 🗇 🖙 DRAFT EIA REPORT AVAILABLE FOR THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE - Message (HTML)
File Message ESET 🕫 🖓
 Follow up. Start by Tuesday, May 16, 2017. Due by Tuesday, May 16, 2017. You replied to this message on 07-Jun-17 10:04 AM. This message was sent with High importance.
From: Sheila Bolingo <sheila@envirolution.co.za> Sent: Fri 12-May-17 5:09 PM To:</sheila@envirolution.co.za>
Cc Bcc: 'fretief@telkomsa.net'; 'gawie@konsortium-merino.com'; 'Kmaree@capenature.co.za'; 'landusegeorge@capenature.co.za'; 'cfordham@capenature.co.za'; 'info@oudtshoorn.com'; 'derust@oudtshoorn.com'; 'ewt@ewt.org.za'; 'trees@global.co.za'; ' 'mike@forestrysouthafrica.co.za'; 'karoonewsgroup@gmail.com'; 'info@nafuagribusiness.co.za'; 'petrosa@petrosa.co.za'; 'durrfam@mweb.co.za'; 'info@route62.co.za'; 'jonathan.deal@treasurethekaroo.co.za'; 'philippa@wessa.co.za'; 'lorraine@wessa.co.za'; 'botesm@wpk.co.za'; 'WklConsResOrg@gmail.com'; 'info@wwf.org.za'; MulaloSU@daff.gov.za
Subject: DRAFT EIA REPORT AVAILABLE FOR THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE
Dear Interested and/or Affected Party,
bear interested and/or Arrested Party,
Envirolution Consulting (Pty) Ltd was appointed by Eskom Holdings SOC Limited to conduct the Environmental Impact Assessment (EIA) Process for the PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE (DEA Reference: 14/12/16/3/3/2/994) The EIA process for the project commenced in early 2015, this application has however lapsed in accordance with Regulation 23 (1) of the EIA Regulations, 2014 and a new EIA process is currently being initiated. A draft EIA Report has been prepared by Envirolution Consulting and is available for public review. The review period is from 12 May 2017 – 12 June 2017. You are invited to review the report at one of the following locations: • The Envirolution website at https://www.envirolution.co.za/index.php/public-participation
 Dropbox link: https://www.dropbox.com/sh/0efjizq3kps9j8z/AACjFD8Cvyz9boG9ERZ9x-YCa?dl=0
George Public Library and Mossel Bay Public Library
Please submit written comment on or before 12 June 2017. Please advise if your comments have remained the same or if you have additional or new comments. All comments received will be submitted in the final EIA Report which will be submitted to the DEA for decision. Comments can be made as written submission via fax, post or e-mail.
Should you require a CD copy, please email us and this can be couriered to you on request.
We look forward to your participation and involvement throughout this process
Click on a photo to see social network updates and email messages from this person.



11 May 2017

Dear Organs of State

- (1) BLANCO TO DROERIVIER 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE AND THE EASTERN CAPE PROVINCES. DEA Reference: 14/12/16/3/3/2/995
- (2) GOURIKWA TO BLANCO 400KV TRANSMISSION LINE, AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE DEA Reference: 14/12/16/3/3/2/994

NOTICE OF AVAILABILITY OF DRAFT ENVIRONMENTAL IMPACT ASSESSMENT REPORT FOR PUBLIC REVIEW

Envirolution Consulting (Pty) Ltd was appointed by **Eskom Holdings SOC Limited** to conduct the Environmental Impact Assessment (EIA) Process for (1) The proposed construction of the Blanco-Droërivier 400kV Power line and Substations upgrade in the Western Cape Province AND Eastern Cape Province and (2) the construction of the Gourikwa to Blanco 400kV Power line and Substations upgrade in the Western Cape Province.

The EIA process for these projects commenced in early 2015 under the reference number: 14/12/16/3/3/2/922. This application has lapsed in accordance with Regulation 23 (1) of the EIA Regulations, 2014 and a new EIA process is currently being undertaken. This new process entails (1) the resubmission of a new application to DEA and the project will be assigned a new reference number, (2) the release of a Draft Scoping Report (DSR) and a Draft Environmental Impact Assessment Report (DEIAr) for public review and thereafter (3) resubmission the final reports to DEA for decision-making.

It must be noted that the contents of this Draft EIA report has not changed significantly from the previous application as the scope of the project and the environment still remains the same. All additional information in this report (mostly relating to the public participation process) has been underlined throughout the Draft EIA report for ease of reference.

The draft Environmental Impact Assessment Reports (DEIAR) has been prepared by Envirolution Consulting for public and authority review. The review period is from 12 MAY 2017 – 12 JUNE 2017: at the following locations:


- The Envirolution website at <u>www.envirolution.co.za</u>
- Dropbox link sent to registered I&APs
- Beaufort West, George and Mossel Bay Public Library


Please find herewith copies of the Draft EIA Report for your record. Kindly advise if your previous comments have remained the same or if you have additional or new comments.


We welcome your participation and look forward to your involvement throughout this new process.


Best Regards Sheila Bolingo Environmental Consultant


> Envirolution Consulting (Pty) Ltd Reg No 2001/029956/07 K Govender B Sc (Hons) (Wits) Pr. Sci. Nat

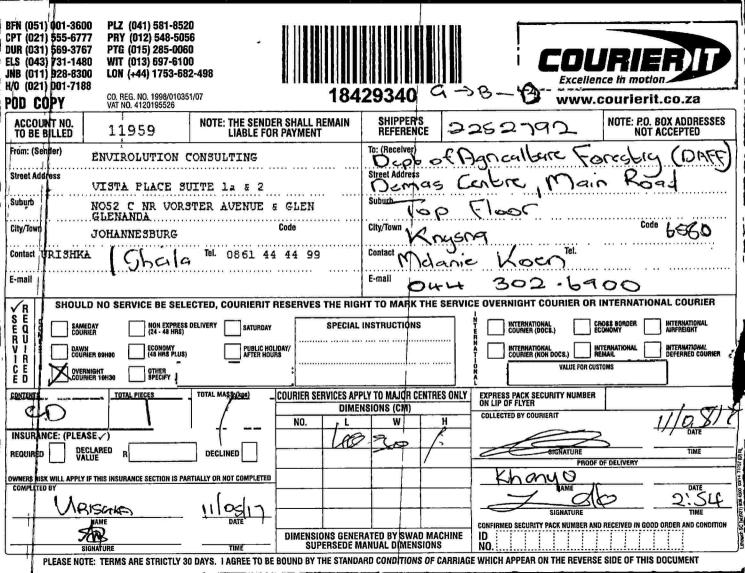


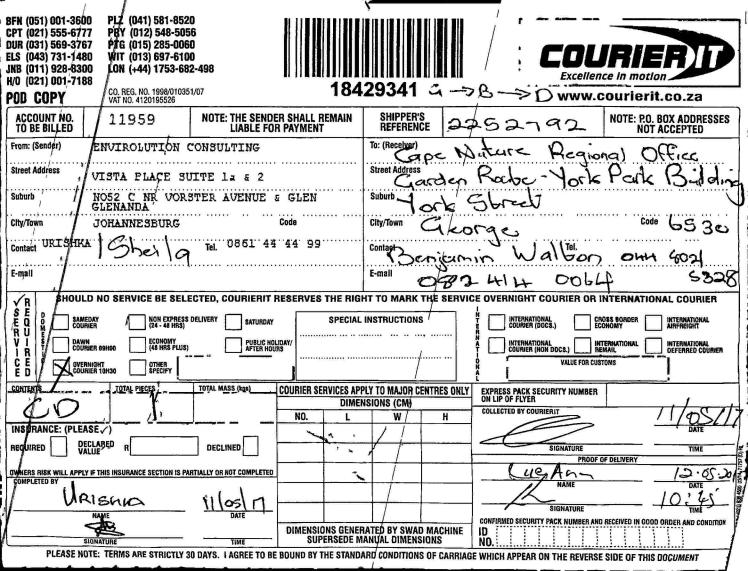


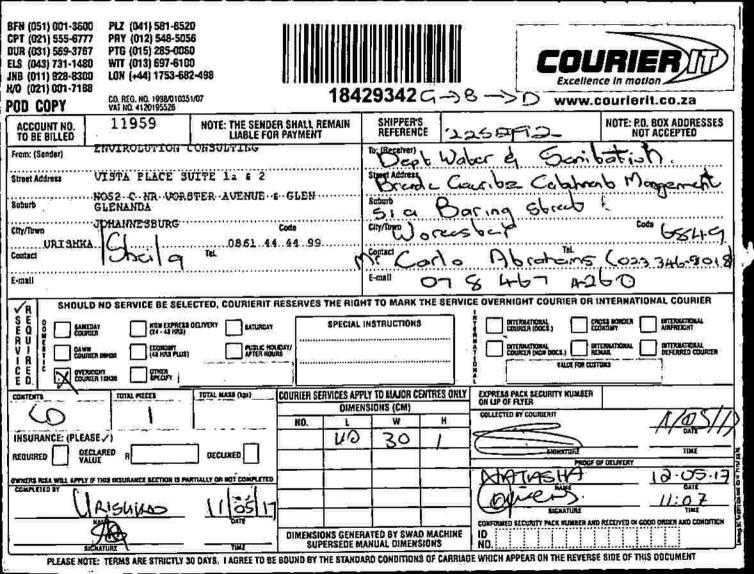

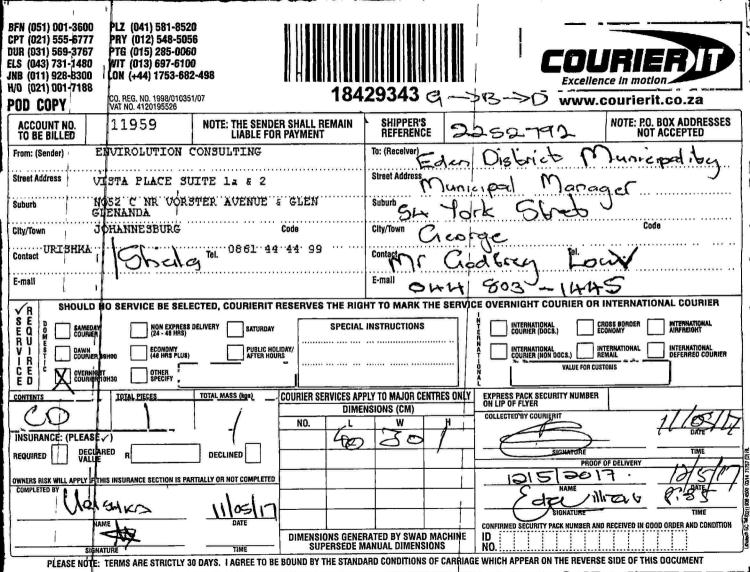

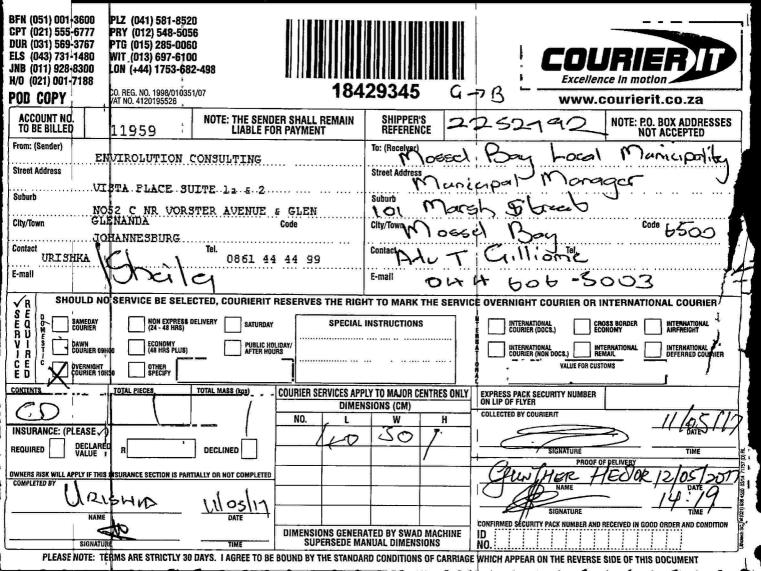

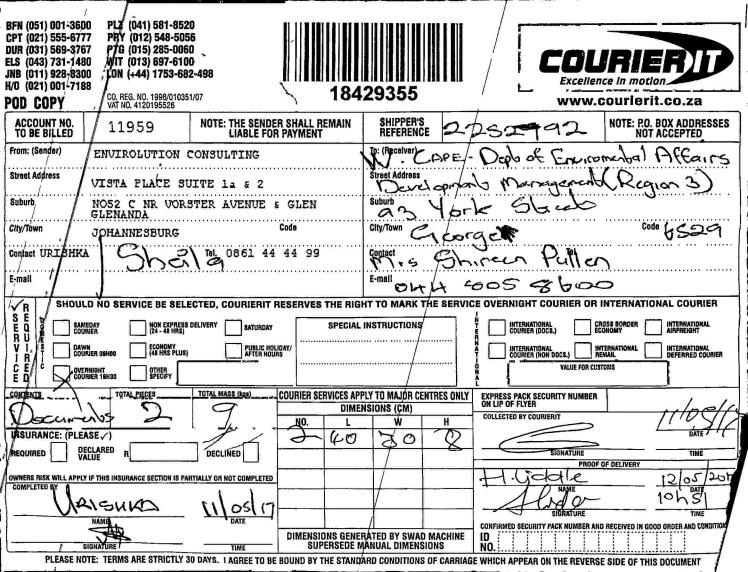

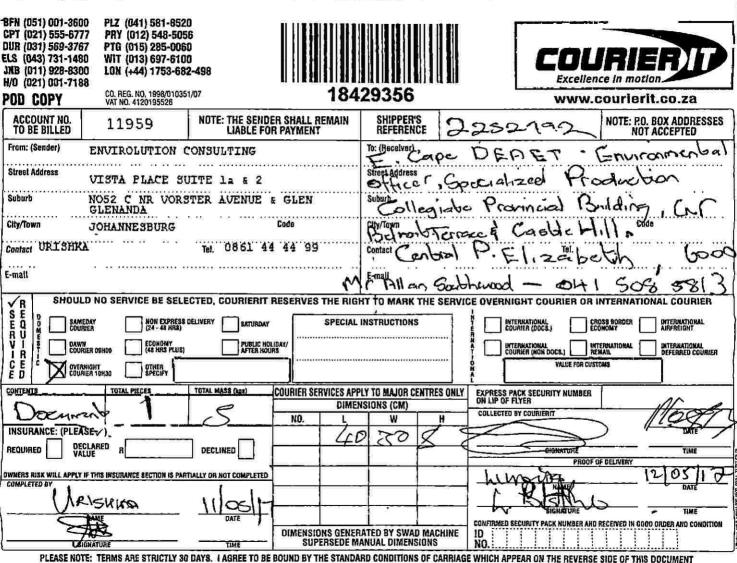



PO Box 1898 Sunninghill 2157 Vista Place Suite 1a & 2 No 52, Cnr Vorster Avenue & Glen Avenue Glenanda Tel: 0861 44 44 99 Fax: 0861 626 222 Email: info@envirolution.co.za

DELIVERY NOTE: Acknowledgement of Receipt

PROJECT NAME: 1) THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE

2) PROPOSED BLANCO TO DROERIVIER 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE AND THE EASTERN CAPE PROVINCES.

DEA Reference: 14/12/16/3/3/2/994 and 14/12/16/3/3/2/995

CONTENTS: DRAFT EIA REPORT

NUMBER OF COPIES: 1 CD copy

DELIVER TO: Department of Agriculture, Forestry and Fisheries: Directorate: Forestry Regulation and Oversight

Attention: Ms Mulalo Sundani

20 Steve Biko former (Beatrix) Street, Agriculture Place, Arcadia, Pretoria **Contact:** 0760216115/012 309 5865

RECEIVED BY: 6 CIEL (Print Name)

_____ Date: <u>12____</u> Time: <u>t2:01</u>

FOR OFFICE USE:

(Signature)

DELIVERED BY	STAMP
COURIER COMPANY:	
NAME:	
DATE:	
TIME:	



PO Box 1898 Sunninghill 2157 Vista Place Suite 1a & 2 No 52, Cnr Vorster Avenue & Glen Avenue Glenanda Tel: 0861 44 44 99 Fax: 0861 626 222 Email: info@envirolution.co.za www.envirolution.co.za

DELIVERY NOTE: Acknowledgement of Receipt

PROJECT NAME: 1) THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE

2) PROPOSED BLANCO TO DROERIVIER 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE AND THE EASTERN CAPE PROVINCES.

DEA Reference: 14/12/16/3/3/2/994 and 14/12/16/3/3/2/995

CONTENTS: DRAFT EIA REPORT

NUMBER OF COPIES: 1 CD copy

DELIVER TO: Department of Environmental Affairs: Biodiversity Directorate:

Attention: Mr Stanley Tshitwamulomi Environment House 473 Steve Biko Arcadia, 0083 Tel 012 3921374

0,0120/210/4	<i>a</i>	$\mathcal{D}I$			
RECEIVED BY: _	Sello	THUYOR	Date:	Time:	
_	(Print Name)				
	d'				
	Picker				

(Signature)

FOR OFFICE USE:

DELIVERED BY
COURIER COMPANY:
NAME: _____
DATE: _____
TIME: _____

STAMP	
ENVIRONMENTAL AFFAIRS	
INT ENV AUTH	
2017 -05- 1 2	
SIGN:	



PO Box 1898 Sunninghill 2157 Vista Place Suite 1a & 2 No 52, Cnr Vorster Avenue & Glen Avenue Glenanda Tel: 0861 44 44 99 Fax: 0861 626 222 Email: info@envirolution.co.za www.envirolution.co.za

DELIVERY NOTE: Acknowledgement of Receipt

PROJECT NAME: THE PROPOSED BLANCO TO DROERIVIER 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE

DEA Reference: <u>14/12/16/3/3/2/995</u>

CONTENTS: DRAFT EIA REPORT

NUMBER OF COPIES: 2 hard copies and 2 CDs **DELIVER TO:** Department of Environmental Affairs

Attention: Ms Portia Makitla Environment House 473 Steve Biko Arcadia, 0083 Tel 012 399 941 1

1012 399 9411	1 (13	Pl .
RECEIVED BY: _	Sello	Hursoe
_	(Print Name)	
	aD	

Date: _____ Time: _____

(Signature)

Ered

FOR OFFICE USE:

DELIVERED BY	STAMP
COURIER COMPANY:	
NAME:	ENVIRONMENTAL AFFAIRS INT ENV AUTH
DATE:	2017 -05- 1 2 SIGN-
TIME:	



PO Box 1898 Sunninghill 2157 Vista Place Suite 1a & 2 No 52, Cnr Vorster Avenue & Glen Avenue Glenanda Tel: 0861 44 44 99 Fax: 0861 626 222 Email: info@envirolution.co.za www.envirolution.co.za

DELIVERY NOTE: Acknowledgement of Receipt

PROJECT NAME: THE PROPOSED GOURIKWA TO BLANCO 400KV TRANSMISSION LINE AND SUBSTATION UPGRADE IN THE WESTERN CAPE PROVINCE

DEA Reference: 14/12/16/3/3/2/994

CONTENTS: DRAFT EIA REPORT

NUMBER OF COPIES: 2 hard copies and 2 CDs **DELIVER TO:** Department of Environmental Affairs

Attention: Ms Portia Makitla **Environment House** 473 Steve Biko Arcadia, 0083 Tel 012 399 9411

RECEIVED BY:

The bac Date: _____ Time: _____ (Print Name)

(Signature)

FOR OFFICE USE

DELIVERED BY	STAMP
COURIER COMPANY:	
NAME:	ENVIRONMENTAL AFFAIRS INT ENV AUTH 2017 -05- 1 2
DATE:	SIGN
TIME:	