


APPENDIX G. Proposed structure – cross rope suspension structure for 400kV line

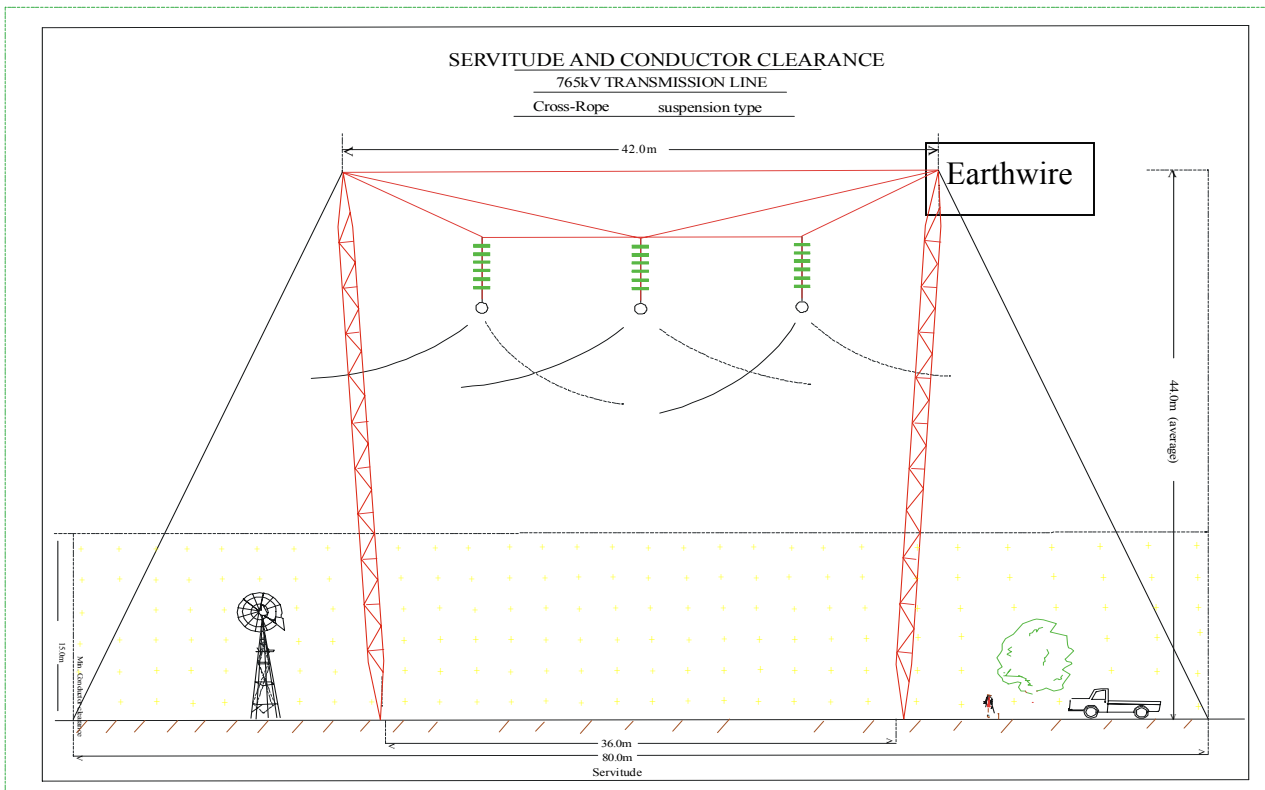

Bundled  
Conductors