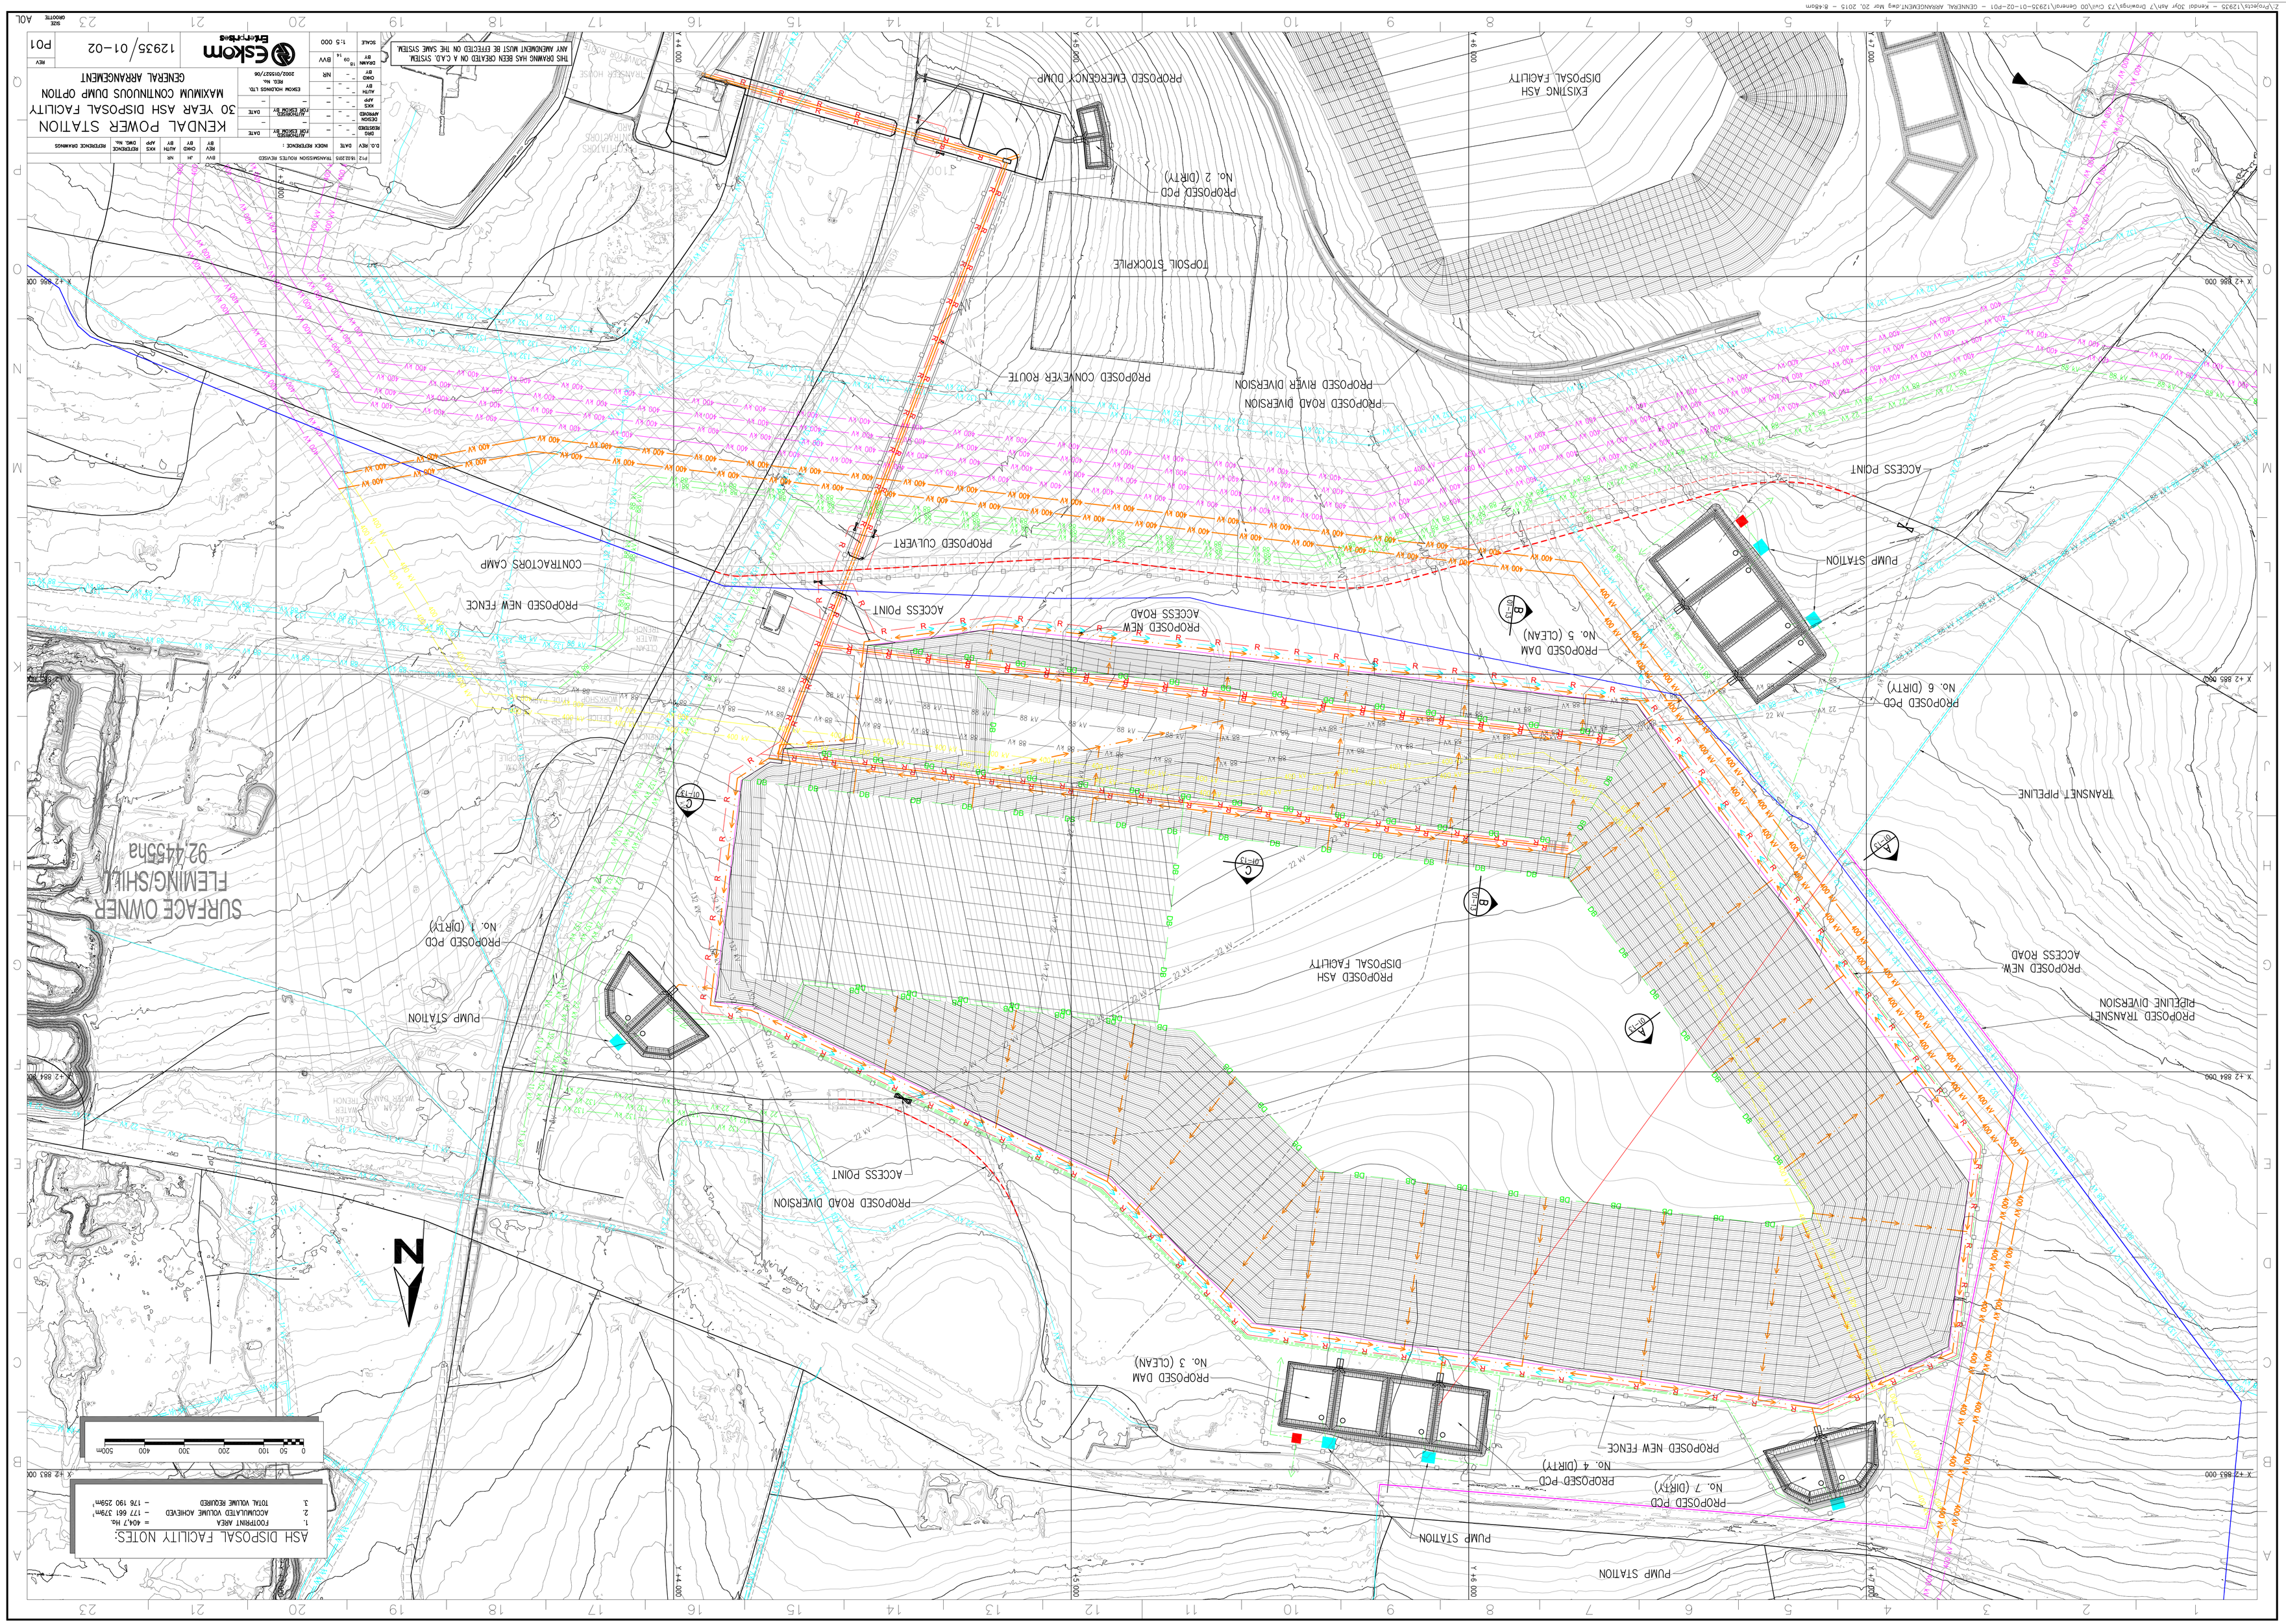
KENDAL POWER STATION
30 YEAR ASH DISPOSAL FACILITY
MAXIMUM CONTINUOUS DUMP OPTION
GENERAL ARRANGEMENT
12935/01-02
P01
Eskom
Bateman
ASH DISPOSAL FACILITY NOTES:
1. FOOTPRINT AREA = 464,7 ha.
2. ACCUMULATED VOLUME ACHIEVED – 177 661 379m³
3. TOTAL VOLUME REQUIRED – 176 190 259m³
SURFACE OWNER
FLEMING/SHILL
92/445Sna
PROPOSED EMERGENCY DUMP
EXISTING ASH DISPOSAL FACILITY
TOPSOIL STOCKPILE
PROPOSED POD No. 2 (DIRTY)
PROPOSED CONVEYER ROUTE
PROPOSED RIVER DIVERSION
PROPOSED ROAD DIVERSION
PROPOSED CULVERT
CONTRACTORS CAMP
PROPOSED NEW FENCE
ACCESS POINT
PROPOSED NEW ACCESS ROAD
PROPOSED DAM No. 5 (CLEAN)
PUMP STATION
PROPOSED POD No. 6 (DIRTY)
TRANSNET PIPELINE
PROPOSED ASH DISPOSAL FAGILITY
PROPOSED TRANSNET PIPELINE DIVERSION
PROPOSED NEW ACCESS ROAD
PROPOSED POD No. 1 (DIRTY)
PROPOSED DAM No. 3 (CLEAN)
PROPOSED POD No. 7 (DIRTY)
PROPOSED POD No. 4 (DIRTY)
PROPOSED NEW FENCE
PUMP STATION
N