

Mr Vusi Mahlangu
 Nkangala District Municipality
 PO BOX 437
 MIDDLEBURG
 1050

Date:
 10 May 2018

Enquiries:

Ref: 17/4/AEL/MP312/11/09

Dear Mr Mahlangu

KRIEL POWER STATION'S MONTHLY STACK EMISSIONS REPORT FOR THE MONTH OF February 2018

This serves as the monthly report required in terms of Section 7.2.1 in Kriel Power Station's Atmospheric Emission License 17/4/AEL/MP312/11/09. The emissions are for the month of February 2018. Verified emissions of particulates matter, SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table 1: Quantity of Raw Materials and Products used/produced for the month of February 2018

Raw Materials and Products used	Raw Material Type	Units	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of February 2018
	Coal	Tons/month	1 227 600	509 027.00
	Fuel Oil	Tons/month	5 000	2 464.82
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of February 2018
	Ash	Tons/month	not specified	551.79
	RE PM	kg/MWh	not specified	0.45

1/...

Abatement Technology

Table 2: Abatement Equipment Control Technology for February 2018

Associated Unit/Stack	Technology Type	Actual Utilisation (%)
		February 2018
Unit 1	ESP	Outage
Unit 2	ESP	Outage
Unit 3	ESP	83.3%
Unit 4	ESP	97.5%
Unit 5	ESP	79.4%
Unit 6	ESP	87.5%

Energy Source Characteristics




Table 3: Energy Source Material Characteristics for the month of February 2018

Characteristic	Stipulated Range (Unit)	Monthly Average Content
CV Content	18-24 (MJ/kg)	
Sulphur Content	0.6-1.2 (%)	0.93
Ash Content	27-32 (%)	27.94

Monthly Monitor Reliability

Associated Unit/Stack	PM (%)	SO _x (%)	NO _x (%)
North	98.8%	82.9%	82.9%
South	100%	100%	100%

Emissions Reporting

GRAPH LEGEND	
	Final daily emissions average in mg/Nm ³ released within a particular day
	Final monthly emissions average in mg/Nm ³ released within the whole month
	Emissions limit as per the AEL

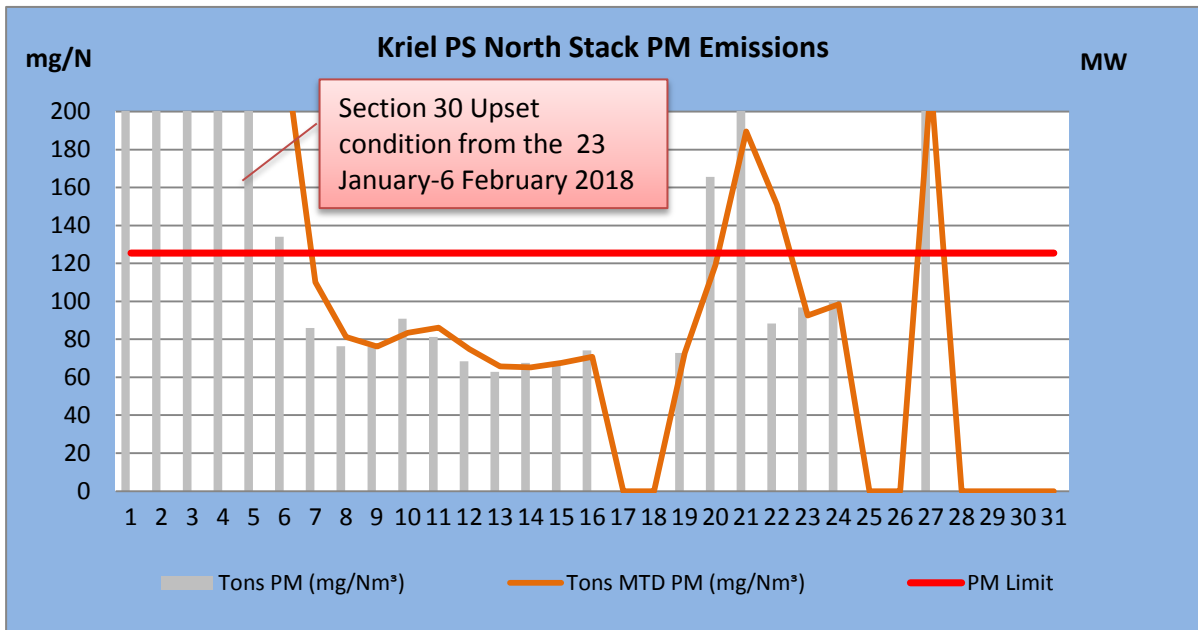


Figure 1: PM emissions (daily averages) for the month of February 2018 against emission limit for the North Stack

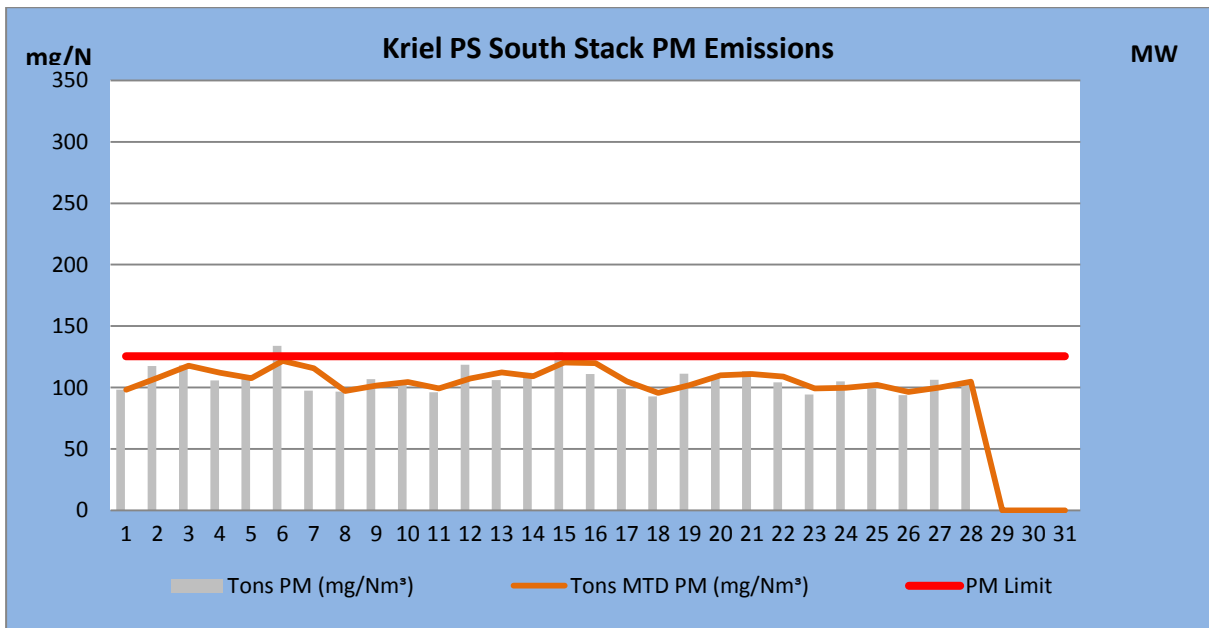


Figure 2: PM emissions (daily averages) for the month of February 2018 against emission limit for the South Stack


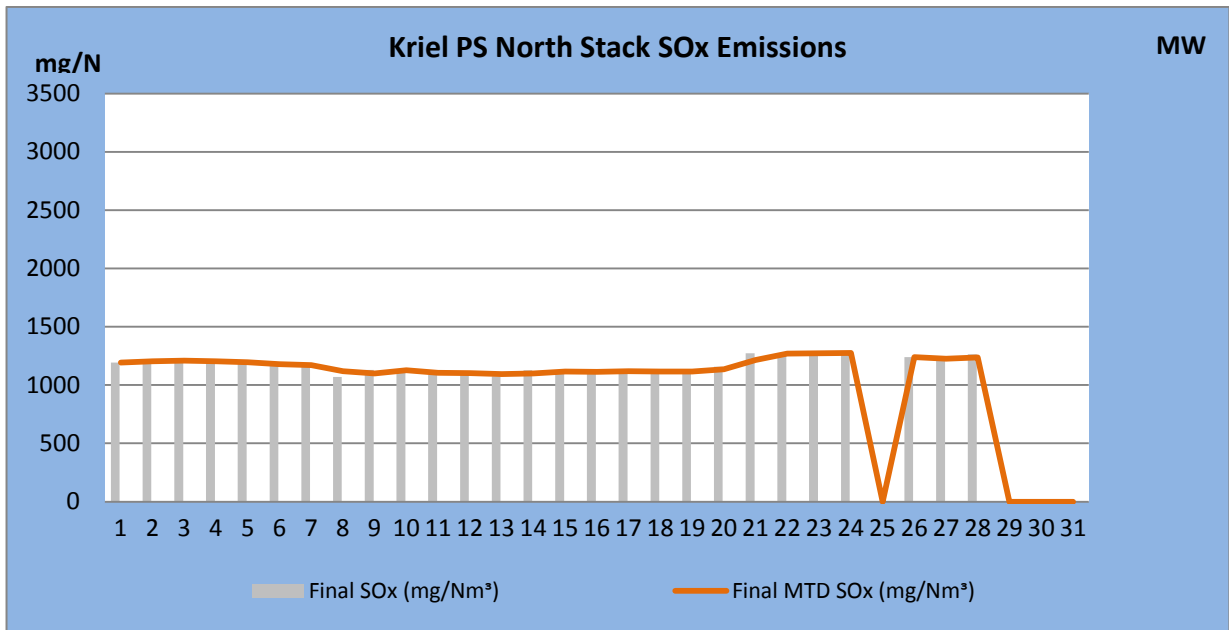


Figure 3. SO₂ emissions (daily averages) for the month of February 2018 against emission limit for the North Stack. SO_x permitted maximum release rate is 3 500mg/Nm³.

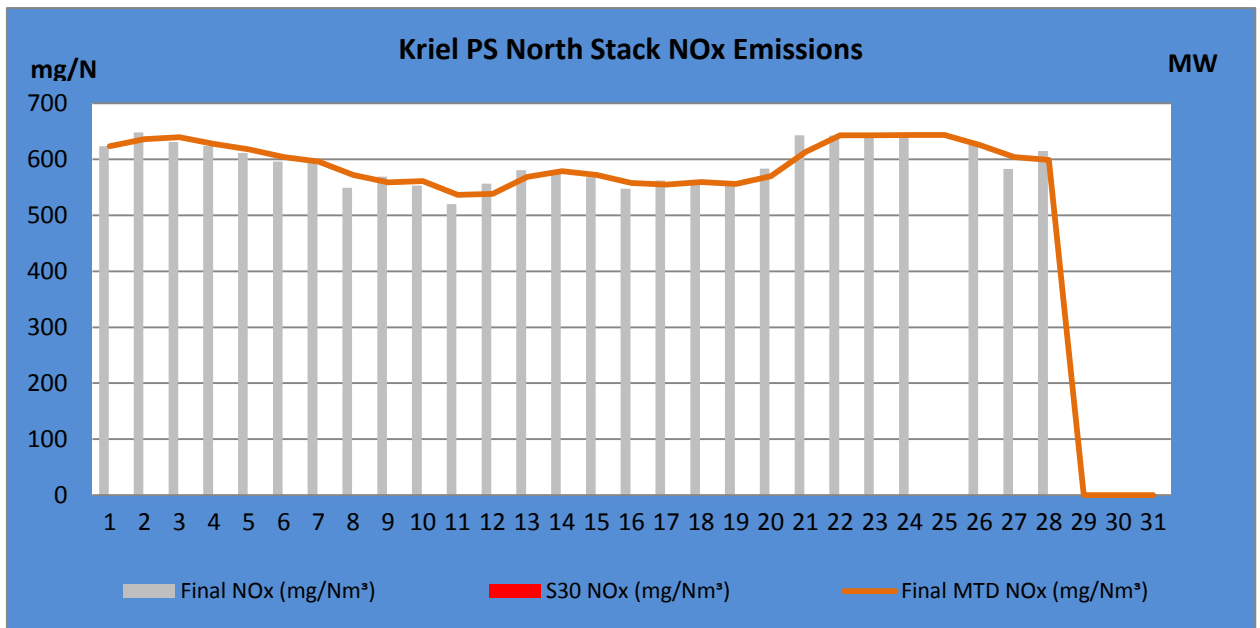

4. NO₂ emissions (daily averages) for the month of February 2018 against emission limit for the North Stack. NO_x permitted maximum release rate is 1 600mg/Nm³

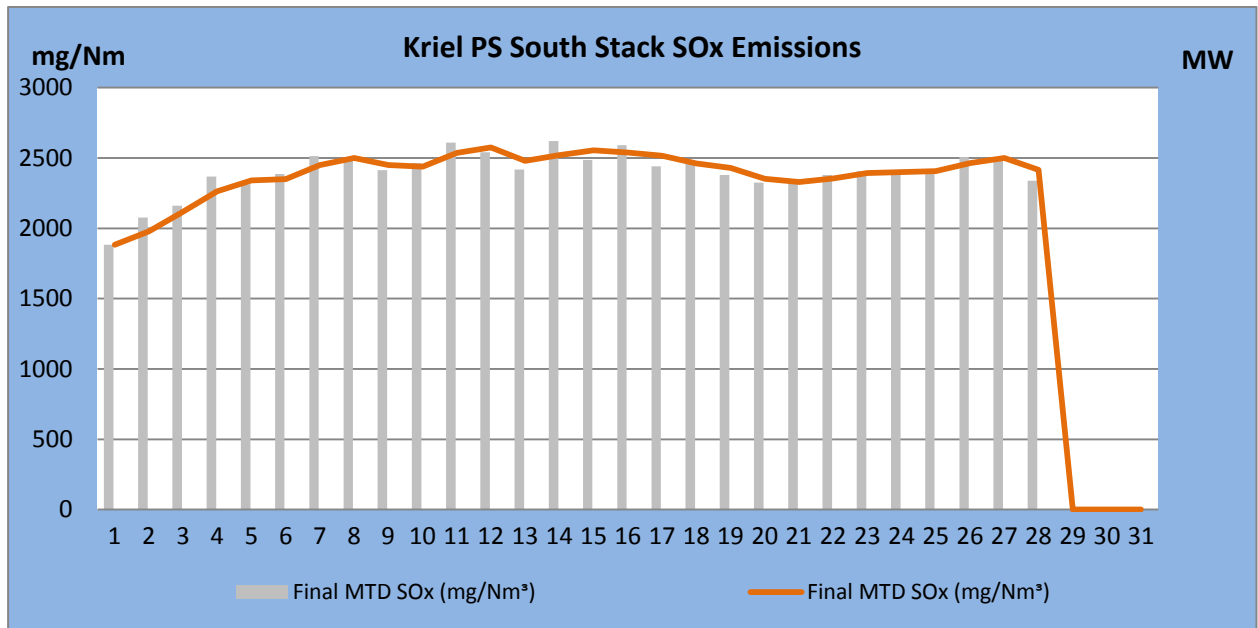


Figure 5. SO₂ emissions (daily averages) for the month of February 2018 against emission limit for the South Stack. SO_x permitted maximum release rate is 3 500mg/Nm³.

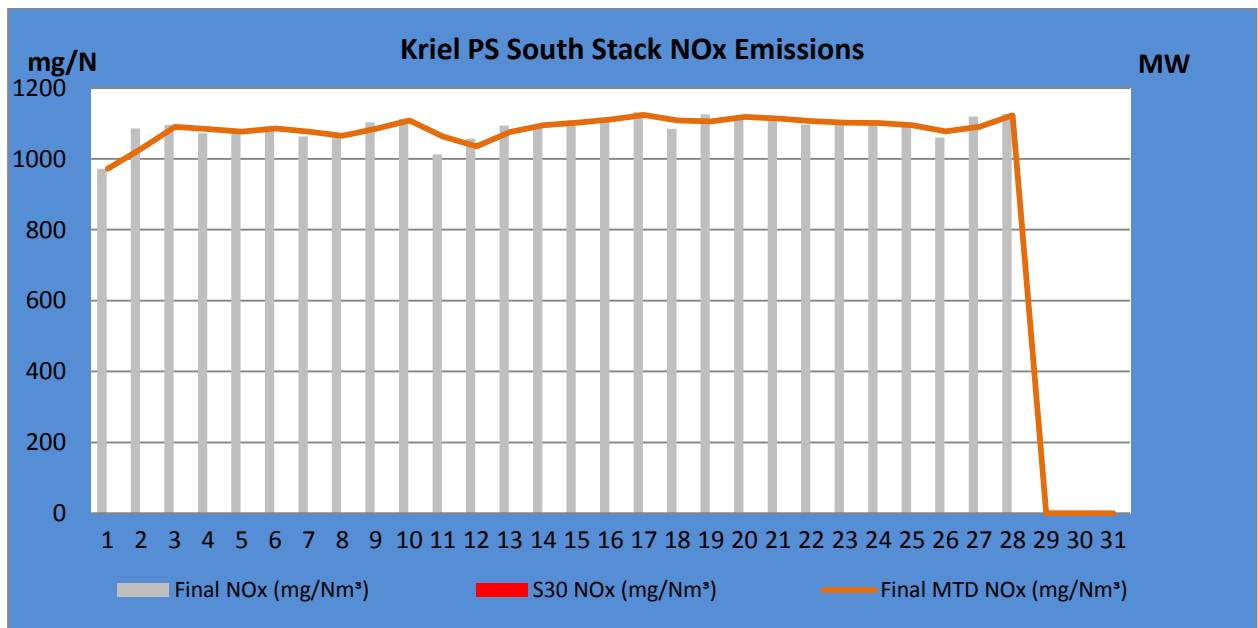


Figure 6. NO₂ emissions (daily averages) for the month of February 2018 against emission limit for the South Stack. NO_x permitted maximum release rate is 1 600mg/Nm³

Table 4: Monthly tonnages for the month February 2018

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)	CO ₂ (tons)
1	2.7	88.2	43.1	
2	0.0	0.0	0.0	
3	147.6	1 119.6	569.2	
4	137.2	3 332.4	1 509.3	
5	110.8	2 795.5	1 257.6	
6	153.6	3 452.0	1 567.2	
SUM	551.8	10 787.7	4 946.5	

Operating Days (DD:HH:MM)				
Unit	Normal operation	In grace period	Under S 30	Unit off load
1	02:02:00	00:00:00	00:00:00	25:22:00
2	00:00:00	00:00:00	00:00:00	28:00:00
3	21:22:55	00:00:00	00:00:00	06:01:05
4	27:07:40	00:00:00	00:00:00	00:16:20
5	23:23:45	00:00:00	00:00:00	04:00:15
6	28:00:00	00:00:00	00:00:00	00:00:00

Light up information

Table 6: PM Start-up information for the month of February 2018

North Stack	Event 2		Event 3		Event 4		Event 7		Event 8	
Unit No.	Unit 3		Unit 1		Unit 1		Unit 3		Unit 3	
Fires in	12:45 PM	06/02 /2018	7:30 PM	25/02 /2018	12:05 AM	28/02 /2018	11:40 PM	16/02 /2018	12:05 PM	28/02/2018
Synchronisation with Grid	5:10 PM	06/02 /2018	12:05 PM	26/02 /2018	6:20 AM	28/02 /2018	12:45 PM	18/02 /2018	5:05 PM	28/02/2018
Emissions below limit from Sync (Date and Time)										
Fires in to synchronisation	00:04:25		00:16:35		00:06:15		01:13:05		00:05:00	
Synchronisation to < limit (Duration)	did not go above limit		did not go above limit		did not go above limit		did not go above limit		did not go above limit	

South Stack	Event 1		Event 2		Event 3		Event 4		Event 5	
Unit No.	Unit 4		Unit 4		Unit 5		Unit 5		Unit 5	
Fires in	3:25 AM	01/02/2018	5:30 AM	04/02/2018	3:25 AM	05/02/2018	9:40 PM	20/02/2018	4:00 PM	28/02/2018
Synchronisation with Grid	10:55 AM	01/02/2018	10:45 AM	04/02/2018	12:30 PM	05/02/2018	2:45 AM	21/02/2018	7:35 PM	28/02/2018
Emissions below limit from Sync										
Fires in to synchronisation	00:07:30		00:05:15		00:09:05		00:05:05		00:03:35	
Synchronisation to < limit	did not go above limit		did not go above limit		did not go above limit		did not go above limit		did not go above limit	

Table 7. Point Source emissions released during start-up (fires-in) for the month of February 2018 in mg/Nm³

North Stack Emission Average from Fires-in to Synchronisation (Date and Time)							
Unit	Fires-In		Synchronisation		PM	SO ₂	NO _x
Unit 3	06/02/2018	12:45 PM	06/02/2018	5:10 PM	84.0	371.5	117.2
Unit 1	25/02/2018	7:30 PM	26/02/2018	12:05 PM	406.2	139.2	2.3
Unit 1	28/02/2018	12:05 AM	28/02/2018	6:20 AM	64.0	166.8	6.8
Unit 3	16/02/2018	11:40 PM	18/02/2018	12:45 PM	78.0	93.2	-9.6
Unit 3	28/02/2018	12:05 PM	28/02/2018	5:05 PM	499.8	819.5	298.2

South Stack Emission Average from Fires-in to Synchronisation (Date and Time)							
Unit	Fires-In		Synchronisation		PM	SO ₂	NO _x
Unit 4	01/02/2018	3:25 AM	01/02/2018	10:55 AM	240.2	1502.7	793.6
Unit 4	04/02/2018	5:30 AM	04/02/2018	10:45 AM	99.5	2309.4	765.9
Unit 5	05/02/2018	3:25 AM	05/02/2018	12:30 PM	218.2	2244.7	775.9
Unit 5	20/02/2018	9:40 PM	21/02/2018	2:45 AM	201.7	1838.2	852.9
Unit 5	28/02/2018	4:00 PM	28/02/2018	7:35 PM	162.5	1892.7	932.6

Table 8. Point Source emissions released during Shut-down (SD) for the month of February 2018 in mg/Nm³

North Stack Emission Average Breaker Open (BO) to Draft Group Shut Down (SD) (Date & Time)						
Unit	Breaker Open		DG SD		PM	NO _x
Unit 1	27/02/2018	8:35 PM	27/02/2018	9:05 PM	67.0	
Unit 1	23/02/2018	7:30 PM	24/02/2018	4:10 PM	199.2	
Unit 2	18/02/2018	2:10 AM	20/02/2018	4:35 PM	281.0	
Unit 3	24/02/2018	8:20 AM	24/02/2018	9:25 PM	170.6	

South Stack Emission Average Breaker Open (BO) to Draft Group Shut Down (SD) (Date & Time)						
Unit	Breaker Open		DG SD		PM	NO _x
Unit 5	02/02/2018	10:40 PM	03/02/2018	7:10 PM	148.3	737.0
Unit 5	19/02/2018	10:35 PM	20/02/2018	1:15 AM	234.6	860.2
Unit 5	28/02/2018	12:10 PM	28/02/2018	12:35 PM	262.9	1066.6

Complaints Register

Table 9: Complaints for the month of February 2018

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
There was no complaint related to air quality received during the month of February 2018					

General

The particulate matter emissions for South Stack were within the limit, The North Stack was above the limit due to the Incident that occurred in January 2018. The incident report was submitted with the January Emission Report. The monthly gaseous emissions (NOx & SOx) were also within the limit for both stacks;

NB: The rest of the information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.