

2350

Mr Dan Hlanyane Senior Manager Municipal Health & Environmental Services Gert Sibande District Municipality PO BOX 3016 ERMELO

Enquiries: Mrs B Malope Tel +27 17 799 8815

Date: 11 February 2021

Dear Mr. Hlanyane

MAJUBA POWER STATION'S REVISED MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2020

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of October 2020. Verified emissions of particulates are included. SO₂ and NO_x (as NO₂) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting. This report was revised due to the Unit 5 gaseous emissions monitor that was reading incorrect values which was identified during the parallel test that was conducted in October 2020. An average from the parallel test report was used for Unit 5 gaseous emissions.

Raw Materials and Products

Table 1. Quantity of Raw Materials and Products used/produced for the month of January 2020

| 2020 | | | | | |
|---------------------------------|------------------------------|------------|---|--|--|
| Raw Materials and Products used | Raw Material Type | Unit | Maximum Permitted Consumption/ Rate (Quantity) | Consumption/ Rate in Month of January 2020 | |
| Products used | Coal | Tons/month | 1 800 000 | 1 027 069 | |
| | Fuel Oil | Tons/month | 6 000 | 4 283 | |
| | | | | | |
| Due direction Detec | Product/ By- Product Name | Unit | Maximum Production Capacity Permitted (Quantity - MW) | Production Rate in Month of January 2020 | |
| Production Rates | Energy | GWh | 4 110 | 1 889 | |
| | Ash | Tons/month | Not stated in the license | 300 931 | |
| | | | | | |

Abatement Technology

Table 2. Abatement Equipment Control Technology for the month of January 2020

| Associated Unit | Technology Type | Actual Utilisation (%) for the month of January 2020 | *Minimum Control Efficiency (%) |
|-----------------|---------------------|--|------------------------------------|
| Unit 1 | Fabric Filter Plant | Unit on outa | ge |
| Unit 2 | Fabric Filter Plant | 100 | 99.87% |

| Unit 3 | Fabric Filter Plant | 100 | 99.81% |
|--------|---------------------|-----|--------|
| Unit 4 | Fabric Filter Plant | 100 | 99.97% |
| Unit 5 | Fabric Filter Plant | 100 | 99.82% |
| Unit 6 | Fabric Filter Plant | 100 | 99.98% |

^{*}Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal **Energy Source Characteristics**

Table 3. Energy Source Material Characteristics for the month of January 2020

| Characteristic | Stipulated Range (Unit) | Monthly Average Content | | | |
|-----------------|-------------------------|-------------------------|--|--|--|
| Sulphur Content | 0.6 to >0.94% | Not Available | | | |
| Ash Content | 28 to >30% | 29.3 % | | | |

Emissions Reporting

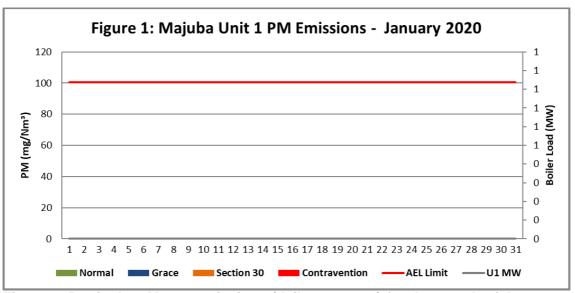


Figure 1. Particulate Matter emissions (daily averages) for the month of January 2020 against emission limit for Unit 1 — Unit 1 was on outage.

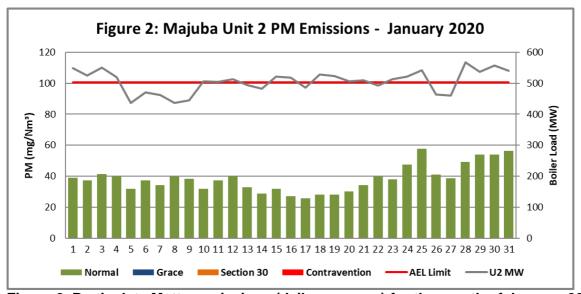


Figure 2. Particulate Matter emissions (daily averages) for the month of January 2020 against emission limit for Unit 2

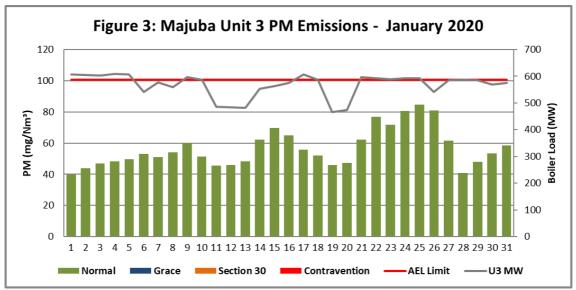


Figure 3. Particulate Matter emissions (daily averages) for the month of January 2020 against emission limit for Unit 3.

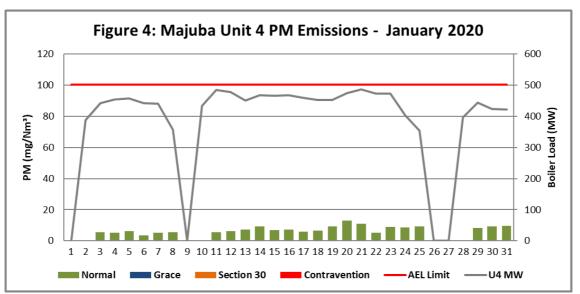


Figure 4. Particulate Matter emissions (daily averages) for the month of January 2020 against emission limit for Unit 4

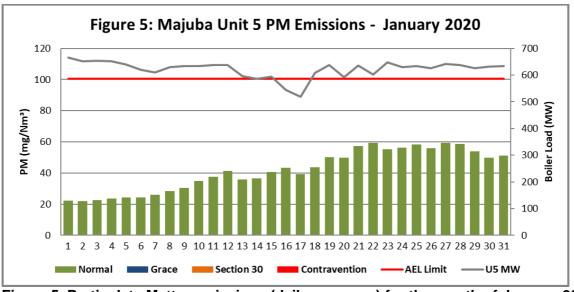


Figure 5. Particulate Matter emissions (daily averages) for the month of January 2020 against emission limit for Unit 5

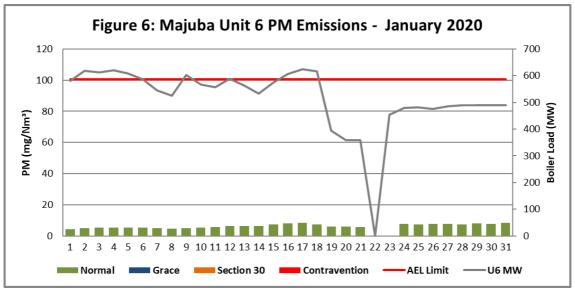


Figure 6. Particulate Matter emissions (daily averages) for the month of January 2020 against emission limit for Unit 6

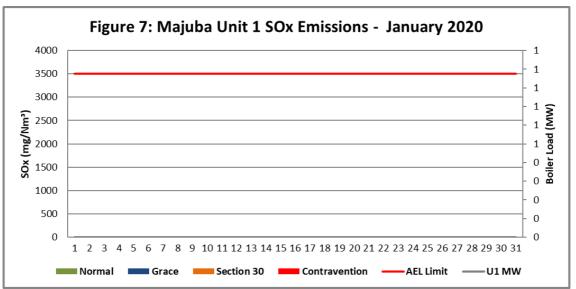


Figure 7. SOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 1 – Unit 1 was on outage.

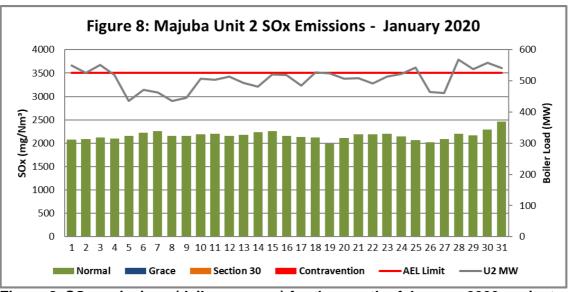


Figure 8. SOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 2

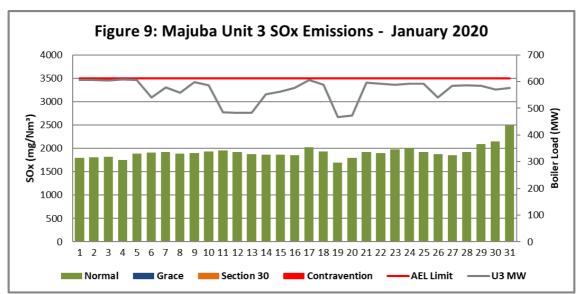


Figure 9. SOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 3.

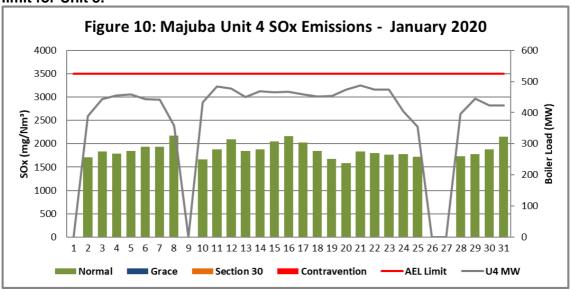


Figure 10. SOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 4

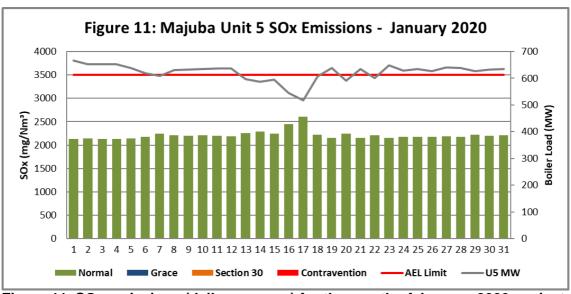


Figure 11. SOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 5

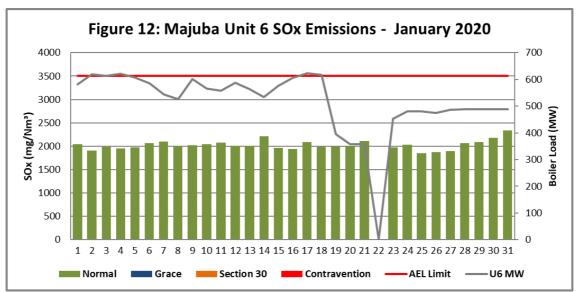


Figure 12. SOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 6

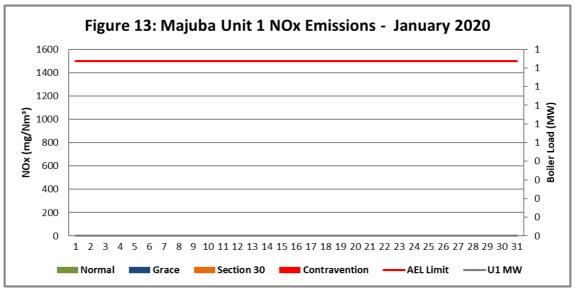


Figure 13. NOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 1 – Unit 1 was on outage.

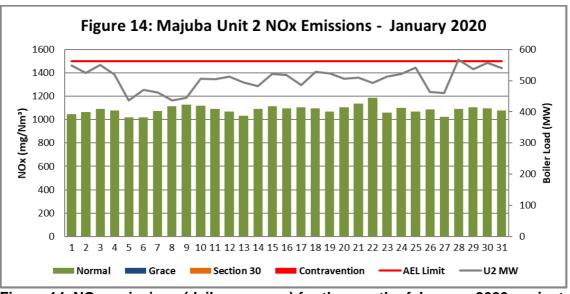


Figure 14. NOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 2

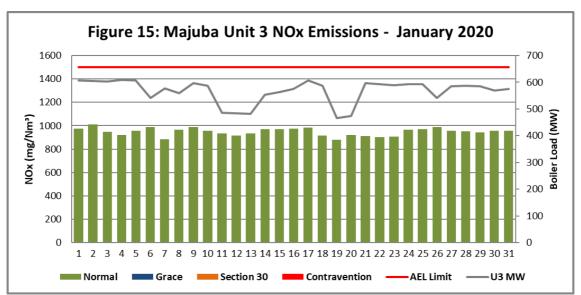


Figure 15. NOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 3.

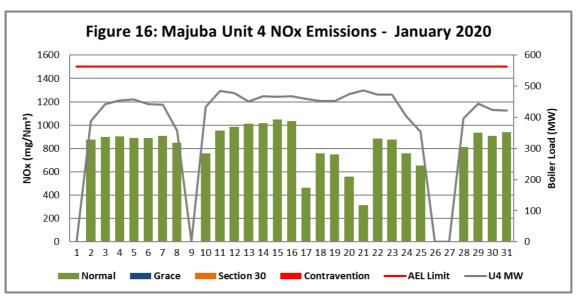


Figure 16. NOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 4

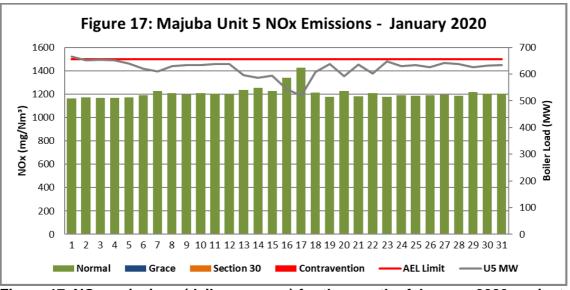


Figure 17. NOx emissions (daily averages) for the month of January 2020 against emission limit for Unit 5

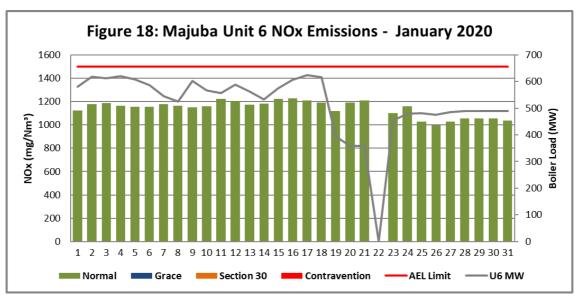


Figure 18. NOx emissions (daily averages) for the month January 2020 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of January 2020

| Unit | PM (tons) | SO ₂ (tons) | NO _x (tons) | | | | | | |
|------|-----------|------------------------|------------------------|--|--|--|--|--|--|
| 1 | | Unit on outage | | | | | | | |
| 2 | 67.7 | 3 991 | 2 001 | | | | | | |
| 3 | 119.0 | 4 044 | 2 000 | | | | | | |
| 4 | 11.0 | 3 104 | 1 405 | | | | | | |
| 5 | 115.4 | 6 130 | 3 349 | | | | | | |
| 6 | 11.9 | 4 131 | 2 340 | | | | | | |
| Sum | 324.9 | 21 399 | 11 095 | | | | | | |

Table 5: Average monthly concentrations (mg/Nm³) for the month of January 2020

| | | · · · · · · · · · · · · · · · · · · · | | | | | | | |
|------|-------------|---------------------------------------|---------|--|--|--|--|--|--|
| Unit | PM (Mg/Nm³) | PM (Mg/Nm³) SO ₂ (Mg/Nm³) | | | | | | | |
| 1 | | Unit on outage | | | | | | | |
| 2 | 38.4 | 2 164.3 | 1 085.4 | | | | | | |
| 3 | 56.6 | 1 918.6 | 948.1 | | | | | | |
| 4 | 7.4 | 1 864.3 | 838.4 | | | | | | |
| 5 | 41.7 | 2 213.7 | 1 209.6 | | | | | | |
| 6 | 6.4 | 2 026.3 | 1 142.6 | | | | | | |

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits $(SO_x, NO_x \text{ and } PM)$

| Associated Unit/Stack | Normal | Grace | Section 30 | Contravention | Total Exceedance |
|-----------------------|--------|-------|---------------|---------------|---------------------|
| Unit 1 | 0 | 0 | 0 | 0 | 0 |
| Unit 2 | 31 | 0 | 0 | 0 | 0 |
| Unit 3 | 31 | 0 | 0 | 0 | 0 |
| Unit 4 | 24 | 0 | 0 | 0 | 0 |
| Unit 5 | 31 | 0 | 0 | 0 | 0 |
| Unit 6 | 29 | 0 | 0 | 0 | 0 |

CO₂ and O₂ Relationship

Calculation: $CO_2\% + O_2\% = 19.5-21.5\%$

| | Final Average CO₂ (%) | | | | Final Average O ₂ (%) | | | | | Final Average CO ₂ + O ₂ (%) | | | | | | | | | |
|--------|-----------------------|------|------|------|----------------------------------|------|--|----|------|--|------|-----|------|----|------|------|------|------|------|
| Date | U1 | U2 | U3 | U4 | U5 | U6 | | U1 | U2 | U3 | U4 | U5 | U6 | U1 | U2 | U3 | U4 | U5 | U6 |
| 01-Jan | | 11.2 | 11.3 | | 14.1 | 12.4 | | | 9.0 | 8.6 | | 6.9 | 7.7 | | 20.2 | 20.0 | | 21.1 | 20.1 |
| 02-Jan | | 10.9 | 11.4 | | 14.1 | 12.7 | | | 9.3 | 8.9 | 9.8 | 7.0 | 7.4 | | 20.2 | 20.3 | | 21.1 | 20.1 |
| 03-Jan | | 11.2 | 11.6 | 9.5 | 14.1 | 12.6 | | | 8.9 | 8.3 | 10.0 | 7.0 | 7.5 | | 20.2 | 19.9 | 19.5 | 21.1 | 20.2 |
| 04-Jan | | 10.5 | 11.6 | 9.4 | 14.2 | 12.7 | | | 9.8 | 7.9 | 10.0 | 7.0 | 7.4 | | 20.3 | 19.5 | 19.4 | 21.1 | 20.2 |
| 05-Jan | | 8.9 | 11.5 | 9.4 | 14.1 | 12.7 | | | 11.8 | 8.4 | 10.1 | 7.1 | 7.5 | | 20.7 | 19.9 | 19.5 | 21.1 | 20.2 |
| 06-Jan | | 9.9 | 10.6 | 8.9 | 13.9 | 12.5 | | | 10.5 | 9.3 | 10.6 | 7.2 | 7.6 | | 20.3 | 19.9 | 19.5 | 21.2 | 20.2 |
| 07-Jan | | 9.7 | 11.4 | 8.8 | 13.6 | 12.1 | | | 10.7 | 8.0 | 10.8 | 7.7 | 8.0 | | 20.4 | 19.3 | 19.5 | 21.2 | 20.1 |
| 08-Jan | | 9.1 | 11.1 | 8.2 | 13.8 | 11.6 | | | 11.5 | 8.8 | 11.1 | 7.5 | 8.5 | | 20.6 | 19.9 | 19.3 | 21.3 | 20.1 |
| 09-Jan | | 9.0 | 11.2 | | 14.0 | 12.7 | | | 11.7 | 8.8 | | 7.3 | 7.4 | | 20.7 | 20.0 | | 21.3 | 20.1 |
| 10-Jan | | 10.1 | 11.4 | | 13.9 | 12.1 | | | 10.3 | 8.6 | 9.7 | 7.4 | 8.2 | | 20.4 | 20.1 | | 21.3 | 20.3 |
| 11-Jan | | 10.6 | 9.9 | 9.8 | 13.9 | 12.0 | | | 9.6 | 10.4 | 9.7 | 7.4 | 8.3 | | 20.2 | 20.3 | 19.5 | 21.3 | 20.3 |
| 12-Jan | | 10.8 | 9.8 | 9.7 | 14.0 | 12.6 | | | 9.4 | 10.5 | 9.8 | 7.3 | 7.5 | | 20.2 | 20.3 | 19.5 | 21.3 | 20.2 |
| 13-Jan | | 10.1 | 10.0 | 9.4 | 13.5 | 12.3 | | | 10.3 | 10.1 | 10.1 | 7.8 | 7.9 | | 20.4 | 20.1 | 19.5 | 21.3 | 20.2 |
| 14-Jan | | 10.1 | 11.1 | 9.5 | 13.3 | 12.0 | | | 10.3 | 8.6 | 10.0 | 8.0 | 8.2 | | 20.4 | 19.7 | 19.5 | 21.3 | 20.2 |
| 15-Jan | | 11.1 | 11.1 | 9.5 | 13.6 | 12.3 | | | 9.1 | 8.5 | 10.1 | 7.7 | 7.9 | | 20.2 | 19.6 | 19.5 | 21.3 | 20.2 |
| 16-Jan | | 11.0 | 11.1 | 9.4 | 12.7 | 12.6 | | | 9.1 | 8.5 | 10.1 | 8.7 | 7.5 | | 20.1 | 19.6 | 19.5 | 21.4 | 20.1 |
| 17-Jan | | 10.2 | 11.6 | 9.3 | 12.2 | 12.7 | | | 10.1 | 8.8 | 10.2 | 9.4 | 7.4 | | 20.3 | 20.3 | 19.5 | 21.6 | 20.2 |
| 18-Jan | | 11.0 | 11.3 | 9.2 | 13.7 | 12.7 | | | 9.2 | 8.7 | 10.3 | 7.5 | 7.4 | | 20.2 | 20.1 | 19.5 | 21.2 | 20.1 |
| 19-Jan | | 10.9 | 9.7 | 9.3 | 14.1 | 10.7 | | | 9.3 | 10.7 | 10.3 | 7.1 | 9.4 | | 20.2 | 20.4 | 19.5 | 21.2 | 20.1 |
| 20-Jan | | 10.8 | 9.8 | 9.3 | 13.5 | 10.1 | | | 9.4 | 10.7 | 10.1 | 7.7 | 9.8 | | 20.2 | 20.5 | 19.4 | 21.2 | 19.9 |
| 21-Jan | | 10.9 | 11.6 | 9.5 | 14.1 | 8.7 | | | 9.3 | 8.5 | 9.7 | 7.1 | 11.4 | | 20.2 | 20.1 | 19.2 | 21.2 | 20.1 |
| 22-Jan | | 10.6 | 11.4 | 9.7 | 13.9 | | | | 9.6 | 8.5 | 9.7 | 7.5 | | | 20.2 | 19.9 | 19.5 | 21.3 | |
| 23-Jan | | 10.9 | 11.7 | 9.9 | 14.3 | | | | 9.3 | 8.7 | 9.6 | 7.1 | 9.6 | | 20.1 | 20.4 | 19.5 | 21.3 | |
| 24-Jan | | 10.8 | 11.5 | 9.8 | 14.1 | 10.2 | | | 9.4 | 8.8 | 10.3 | 7.2 | 10.2 | | 20.2 | 20.3 | 20.1 | 21.3 | 20.3 |
| 25-Jan | | 11.0 | 11.4 | 9.5 | 14.2 | 10.7 | | | 9.2 | 8.9 | 10.5 | 7.2 | 9.6 | | 20.2 | 20.3 | 20.0 | 21.4 | 20.3 |
| 26-Jan | | 9.7 | 10.7 | | 14.1 | 10.5 | | | 10.8 | 10.0 | | 7.3 | 9.6 | | 20.5 | 20.7 | | 21.4 | 20.2 |
| 27-Jan | | 9.7 | 11.4 | | 14.2 | 10.7 | | | 10.8 | 8.9 | | 7.3 | 9.6 | | 20.5 | 20.3 | | 21.5 | 20.3 |
| 28-Jan | | 11.3 | 11.4 | | 14.2 | 10.7 | | | 8.7 | 9.1 | 10.1 | 7.3 | 9.6 | | 20.0 | 20.5 | | 21.4 | 20.3 |
| 29-Jan | | 11.1 | 11.4 | 10.1 | 13.9 | 10.6 | | | 9.0 | 9.0 | 10.4 | 7.6 | 9.7 | | 20.0 | 20.4 | 20.5 | 21.5 | 20.3 |
| 30-Jan | | 11.2 | 11.0 | 10.0 | 14.1 | 10.6 | | | 8.8 | 9.5 | 10.8 | 7.4 | 9.7 | | 20.0 | 20.5 | 20.8 | 21.5 | 20.3 |
| 31-Jan | | 11.2 | 11.1 | 10.0 | 14.1 | 10.6 | | | 8.8 | 9.4 | 10.9 | 7.4 | 9.9 | | 20.1 | 20.5 | 21.0 | 21.5 | 20.5 |
| Totals | | 10.5 | 11.1 | 9.5 | 13.8 | 11.6 | | | 9.8 | 9.0 | 10.2 | 7.5 | 8.6 | | 20.3 | 20.1 | 19.7 | 21.3 | 20.2 |

Table 7: CO_2 and O_2 deviations of the Month of January 2020 *Blank spaces indicate that the unit was offline during that period

Comments on the performance and availability of each unit

Emergency Generation

Table 8: Emergency Generation for the month of January 2020

| | Unit 1 | Unit 2 | Unit 3 | Unit 4 | Unit 5 | Unit 6 |
|---|--------|--------|--------|--------|--------|--------|
| Emergency Generation hours declared by national Control | 0 | 0 | 0 | 0 | 0 | 0 |
| Emergency Hours declared including hours after stand down | 0 | 0 | 0 | 0 | 0 | 0 |
| Hours over the Limit during Emergency Generation | 0 | 0 | 0 | 0 | 0 | 0 |

Comments on the performance and availability of each unit

UNIT 1

The unit was on outage for the entire month.

UNIT 2

The unit base loaded the entire month. Fifty seven fabric filter bags were replaced during the month.

UNIT 3

The unit base loaded the entire month. Sixty four fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for most of the days during the month and off for four days. No fabric filter bags were replaced during the month.

UNIT 5

The unit base loaded the entire month. Twenty five fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for most of the days during the month and off for one day. Forty four fabric filter bags were replaced during the month.

Complaints Register

Table 9: Complaints for the month of January 2020

| Source Code/ Name | Root Cause Analysis | Calculation of Impacts/ emissions associated with the incident | Dispersion modeling of pollutants where applicable | Measures implemented to prevent reoccurrence | Date by which measure will be implemented |
|-------------------------|--|--|--|---|---|
| | No complaints were received in the month of January 2020 | | | | |

General

Additional information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Report compiled by:

Faith Kagoda Date 11/02/2021

ENVIRONMENTAL MANAGER: (MAJUBA)

Report verified by:

Lindani Madonsela Date 16/02/2021

BOILER ENGINEERING MANAGER: (MAJUBA)

Hoping the above will meet your satisfaction

Yours sincerely

Bawinile Malope 2021/02/22
Date

ENGINEERING MANAGER: (MAJUBA)