

2350

Mr Dan Hlanyane Senior Manager Municipal Health & Environmental Services Gert Sibande District Municipality PO BOX 3016 ERMELO

Enquiries: Mrs B Malope Tel +27 17 799 8815

Date: 11 February 2021

Dear Mr. Hlanyane

# MAJUBA POWER STATION'S REVISED MONTHLY EMISSIONS REPORT FOR THE MONTH OF FEBRUARY 2020

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of October 2020. Verified emissions of particulates are included.  $SO_2$  and  $NO_x$  (as  $NO_2$ ) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting. This report was revised due to the Unit 5 gaseous emissions monitor that was reading incorrect values which was identified during the parallel test that was conducted in October 2020. An average from the parallel test report was used for Unit 5 gaseous emissions.

#### **Raw Materials and Products**

Table 1. Quantity of Raw Materials and Products used/produced for the month of February 2020

Raw Materials and	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate	Consumption/ Rate in Month of	
Products used	Coal Fuel Oil	Tons/month Tons/month	(Quantity) 1 800 000 6 000	906 909	
	ruei Oii	TOHS/MONUT	6 000	6 244	
	Product/ By- Product Name	Unit	Maximum Production Capacity Permitted (Quantity - MW)	Production Rate in Month of February 2020	
Production Rates	Energy	GWh	4 110	1 691	
	Ash	Tons/month	Not stated in the license	254 842	

#### **Abatement Technology**

Table 2. Abatement Equipment Control Technology for the month of February 2020

Associated Unit	Technology Type	Actual Utilisation (%) for the month of February 2020	*Minimum Control Efficiency (%)			
Unit 1	Fabric Filter Plant	Unit on outage				
Unit 2	Fabric Filter Plant	100	99.88%			

Unit 3	Fabric Filter Plant	100	99.73%
Unit 4	Fabric Filter Plant	100	99.95%
Unit 5	Fabric Filter Plant	100	99.78%
Unit 6	Fabric Filter Plant	100	99.96%

<sup>\*</sup>Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal **Energy Source Characteristics** 

Table 3. Energy Source Material Characteristics for the month of February 2020

Characteristic	Stipulated Range (Unit)	Monthly Average Content			
Sulphur Content	0.6 to >0.94%	0.97%			
Ash Content	28 to >30%	28.1 %			

#### **Emissions Reporting**

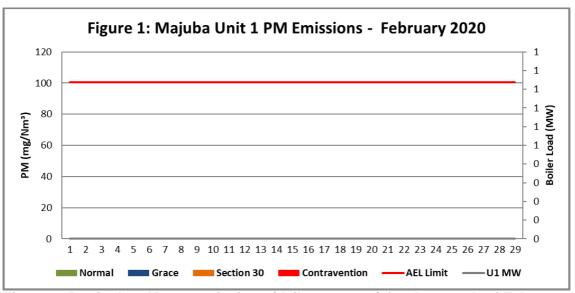


Figure 1. Particulate Matter emissions (daily averages) for the month of February 2020 against emission limit for Unit 1 – Unit 1 was on outage.

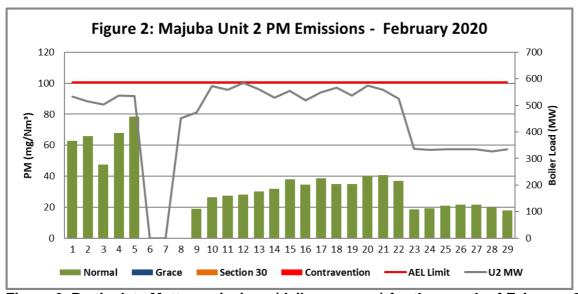


Figure 2. Particulate Matter emissions (daily averages) for the month of February 2020 against emission limit for Unit 2

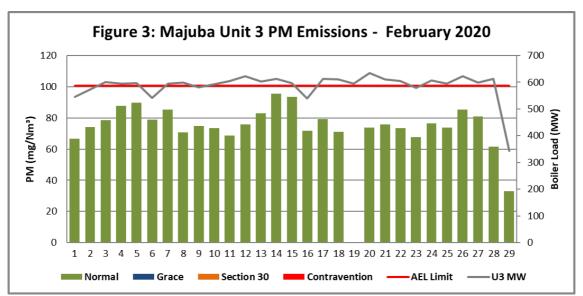


Figure 3. Particulate Matter emissions (daily averages) for the month of February 2020 against emission limit for Unit 3.

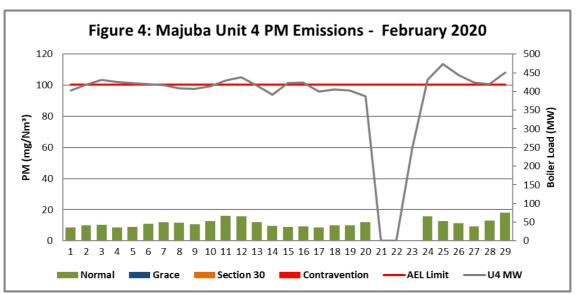


Figure 4. Particulate Matter emissions (daily averages) for the month of February 2020 against emission limit for Unit 4

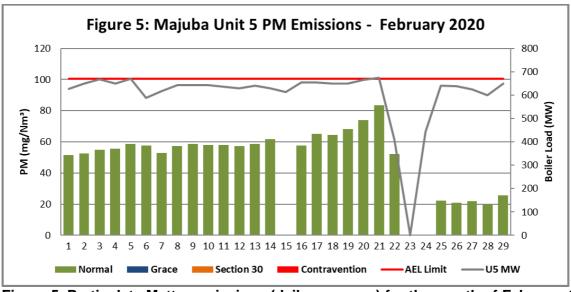


Figure 5. Particulate Matter emissions (daily averages) for the month of February 2020 against emission limit for Unit 5

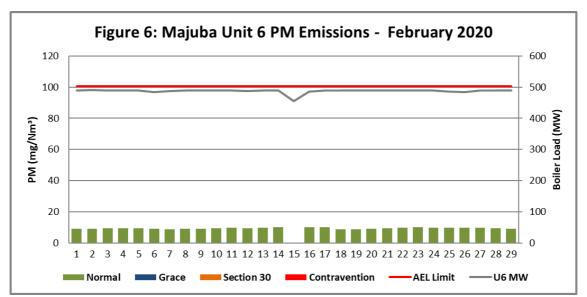


Figure 6. Particulate Matter emissions (daily averages) for the month of February 2020 against emission limit for Unit 6

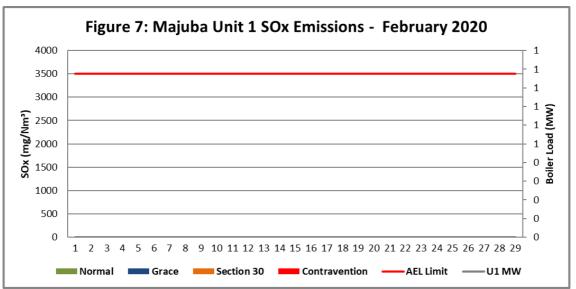


Figure 7. SOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 1 – Unit 1 was on outage.

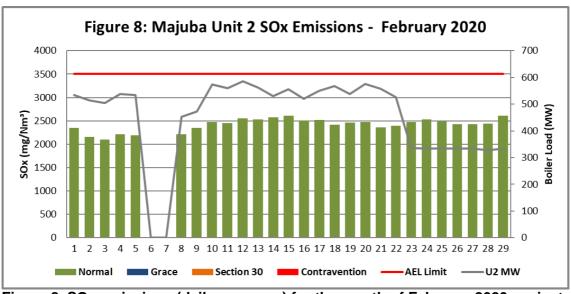


Figure 8. SOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 2

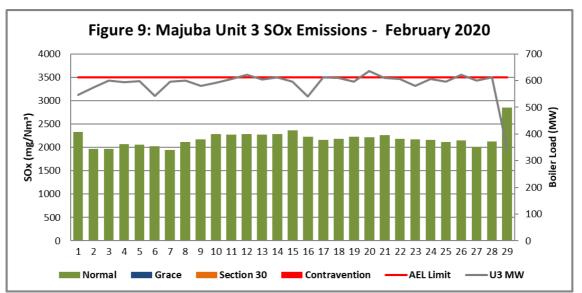


Figure 9. SOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 3.

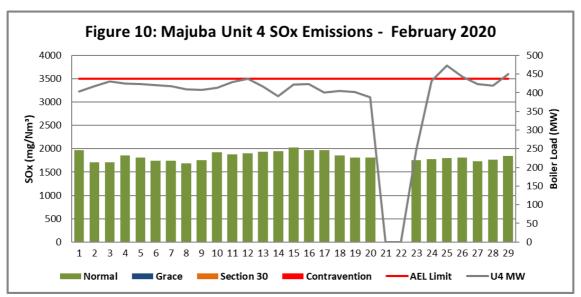


Figure 10. SOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 4

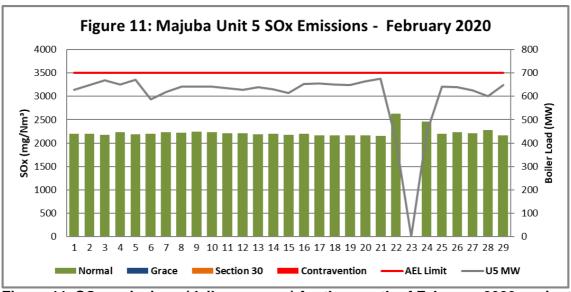


Figure 11. SOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 5

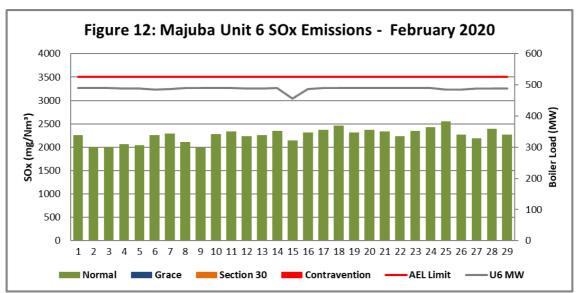


Figure 12. SOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 6

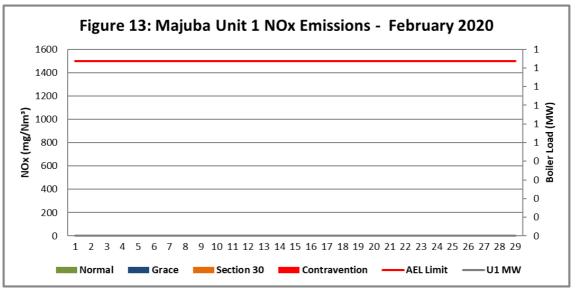


Figure 13. NOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 1 – Unit 1 was on outage.

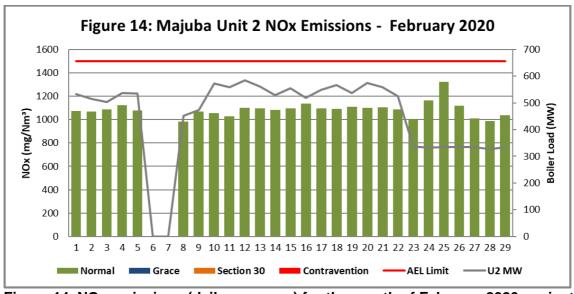


Figure 14. NOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 2

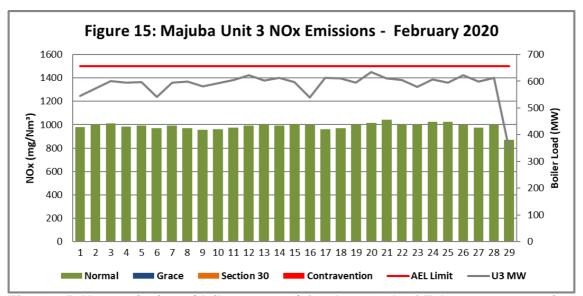


Figure 15. NOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 3.

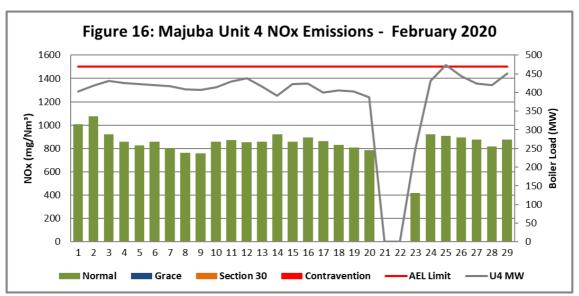


Figure 16. NOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 4

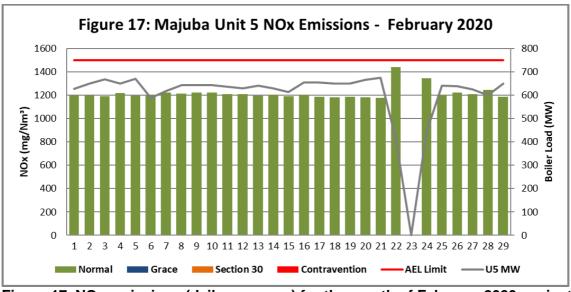


Figure 17. NOx emissions (daily averages) for the month of February 2020 against emission limit for Unit 5

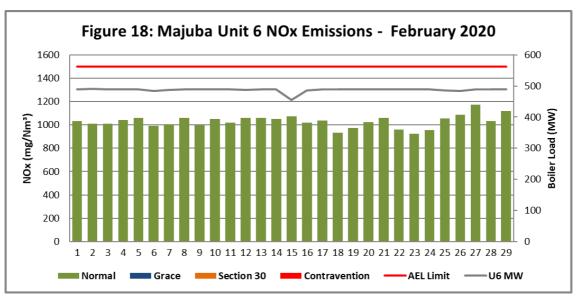


Figure 18. NOx emissions (daily averages) for the month February 2020 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of February 2020

Unit	PM (tons)	SO <sub>2</sub> (tons)	NO <sub>x</sub> (tons)						
1		Unit on outage							
2	49.3	3 618	1 623						
3	148.5	4 308	1 976						
4	17.7	3 001	1 420						
5	111.5	5 198	2 840						
6	16.5	4 088	1 863						
Sum	343.5	20 212	9 722						

Table 5: Average monthly concentrations (mg/Nm³) for the month of February 2020

<u> </u>									
Unit	PM (Mg/Nm³)	NO <sub>2</sub> (Mg/Nm <sup>3</sup> )							
1		Unit on outage							
2	35.6	2 418.3	1 085.7						
3	75.7	2 187.6	988.4						
4	11.4	1 831.7	851.2						
5	52.6	2 224.8	1 215.6						
6	9.5	2 259.7	1 030.1						

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits ( $SO_x$ ,  $NO_x$  and PM)

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	0	0	0	0	0
Unit 2	27	0	0	0	0
Unit 3	28	0	0	0	0
Unit 4	27	0	0	0	0
Unit 5	27	0	0	0	0
Unit 6	29	0	0	0	0

# CO<sub>2</sub> and O<sub>2</sub> Relationship

Calculation:  $CO_2\% + O_2\% = 19.5-21.5\%$ 

	Final Average CO₂ (%)				Final Average O₂ (%)					Final Average CO <sub>2</sub> + O <sub>2</sub> (%)									
Date	U1	U2	U3	U4	U5	U6		U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
30-Jan		11.2	11.0	10.0	14.1	10.6			8.8	9.5	10.8	7.4	9.7		20.0	20.5	20.8	21.5	20.3
31-Jan		11.2	11.1	10.0	14.1	10.6			8.8	9.4	10.9	7.4	9.9		20.1	20.5	21.0	21.5	20.5
01-Feb		11.2	10.8	10.0	14.1	10.7			8.9	9.7	11.0	7.4	9.8		20.1	20.6	21.1	21.6	20.5
02-Feb		11.1	11.3	10.1	14.2	10.8			9.1	9.1	11.0	7.4	9.5		20.1	20.4	21.0	21.6	20.3
03-Feb		10.7	11.6	9.7	14.3	10.7			9.4	8.7	10.4	7.3	9.6		20.2	20.3	20.1	21.6	20.3
04-Feb		10.9	11.2	9.3	14.1	10.8			9.1	9.3	10.7	7.6	9.6		20.1	20.5	20.0	21.6	20.4
05-Feb		11.3	11.3	9.8	14.0	10.7			8.8	9.1	10.5	7.3	9.6		20.1	20.4	20.3	21.3	20.4
06-Feb			11.0	9.1	13.2	10.7				9.7	10.3	7.3	9.9			20.6	19.4	20.5	20.6
07-Feb			11.6	8.5	13.5	10.8				8.8	10.7	7.5	10.0			20.4	19.3	21.0	20.8
08-Feb			11.5	8.3	13.8	10.7			9.6	8.8	10.8	7.5	10.0			20.3	19.1	21.2	20.8
09-Feb		10.2	11.2	8.2	13.8	10.7			10.2	9.3	10.8	7.6	10.0		20.4	20.6	19.0	21.3	20.7
10-Feb		11.2	11.3	8.4	13.8	10.6			8.8	9.1	10.4	7.6	10.0		20.1	20.4	18.8	21.3	20.6
11-Feb		11.1	11.5	8.6	13.7	10.7			9.0	8.5	10.3	7.4	9.8		20.1	20.0	18.9	21.1	20.5
12-Feb		11.2	11.9	8.8	13.6	10.6			8.8	8.3	10.1	7.4	9.9		20.0	20.2	18.9	21.1	20.5
13-Feb		11.1	11.6	8.3	13.8	10.8			9.0	8.6	10.7	7.3	9.8		20.1	20.2	19.0	21.1	20.6
14-Feb		10.8	11.7	8.2	13.8	10.7			9.4	8.4	10.7	7.4	9.9		20.2	20.1	18.9	21.2	20.6
15-Feb		11.2	11.5	8.4					8.9	8.7	10.6	7.3	9.3		20.1	20.1	19.0		
16-Feb		10.5	10.8	8.2	13.8	10.8			9.8	9.3	10.9	7.4	9.9		20.3	20.2	19.1	21.2	20.7
17-Feb		11.1	11.7	8.0	13.9	10.8			8.9	8.1	11.1	7.2	10.1		20.0	19.9	19.1	21.1	20.8
18-Feb		11.2	11.7	7.9	13.9	10.8			8.9	8.3	11.3	7.1	10.0		20.0	20.0	19.2	21.0	20.8
19-Feb		10.9		7.9	13.9	10.9			9.2	8.9	11.3	7.1	9.8		20.1		19.2	21.0	20.7
20-Feb		11.2	11.8	8.1	13.9	10.9			8.9	8.6	11.0	7.1	9.8		20.1	20.4	19.1	21.0	20.7
21-Feb		11.1	11.8		14.0	10.9			9.1	8.7		7.0	9.5		20.2	20.4		21.0	20.4
22-Feb		10.8	11.7		11.4	11.0			9.4	8.7		9.5	9.7		20.2	20.4		20.9	20.7
23-Feb		8.7	11.5			11.0			11.8	8.8	11.2		9.8		20.5	20.3			20.8
24-Feb		8.5	11.8	8.4		10.9			11.8	8.5	10.8	8.6	9.6		20.3	20.3	19.2		20.5
25-Feb		8.4	11.4	8.8	13.3	10.8			12.0	9.0	10.4	7.4	9.5		20.3	20.4	19.1	20.7	20.3
26-Feb		8.6	11.7	8.3	13.4	10.7			11.8	8.3	10.9	7.5	10.4		20.4	20.1	19.2	20.9	21.1
27-Feb		8.7	11.7	8.0	13.4	10.7			11.8	8.4	11.3	7.5	10.4		20.5	20.2	19.2	20.9	21.1
28-Feb		8.6	11.9	8.4	13.2	10.7			12.0	8.4	11.0	7.8	10.5		20.6	20.3	19.4	21.0	21.2
29-Feb		8.6	9.4	8.4	13.7	10.7			11.9	11.6	11.1	7.2	10.5		20.5	21.0	19.4	20.9	21.2
Totals		10.3	11.4	8.6	13.7	10.8			9.9	8.9	10.8	7.5	9.9		20.2	20.3	19.4	21.1	20.7

Table 7:  $CO_2$  and  $O_2$  deviations of the Month of February 2020 \*Blank spaces indicate that the unit was offline during that period

# Comments on the performance and availability of each unit

# **Emergency Generation**

**Table 8: Emergency Generation for the month of February 2020** 

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

## Comments on the performance and availability of each unit

#### UNIT 1

The unit was on outage for the entire month.

#### UNIT 2

The unit base loaded for most of the days during the month and was off for two days. Thirty-five fabric filter bags were replaced during the month.

#### UNIT 3

The unit base loaded for the entire month. One hundred and sixteen fabric filter bags were replaced during the month.

#### **UNIT 4**

The unit base loaded for most of the days of the month and was off for two days. Twenty-three fabric filter bags were replaced during the month.

#### UNIT 5

The unit base loaded for most of the month and was off for one day. Thirty-six fabric filter bags were replaced during the month.

#### **UNIT 6**

The unit base loaded for the entire month. Thirty-three fabric filter bags were replaced during the month.

### **Complaints Register**

Table 9: Complaints for the month of February 2020

Source Code/ Name	Root Cause Analysis	Amissions associated		Measures implemented to prevent reoccurrence	Date by which measure will be implemented	
A5	Inadequate dust suppression on Haul Road	N/A	N/A	eri was notified of the complaint, a water tanker was sent to address the issue.	Complete	

#### General

Additional information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Report compiled by:

Faith Kagoda Date 11/02/2021

**ENVIRONMENTAL MANAGER: (MAJUBA)** 

Report verified by:

Lindani Madonsela Date 16/02/2021

**BOILER ENGINEERING MANAGER: (MAJUBA)** 

Hoping the above will meet your satisfaction

Yours sincerely

Bawinile Malope 2021/02/22

**ENGINEERING MANAGER: (MAJUBA)**