

Mr Dan Hlanyane  
Senior Manager Municipal Health & Environmental Services  
Gert Sibande District Municipality  
PO BOX 3016  
ERMELO  
2350

Date: 11 February 2021

Enquiries: Mrs B Malope  
Tel +27 17 799 8815

Dear Mr. Hlanyane

## MAJUBA POWER STATION'S REVISED MONTHLY EMISSIONS REPORT FOR THE MONTH OF JUNE 2020

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of June 2020. Verified emissions of particulates are included. SO<sub>2</sub> and NO<sub>x</sub> (as NO<sub>2</sub>) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting. This report was revised due to the parallel test curves that were back-fitted on all gaseous emissions monitors. Unity factors were used for CO<sub>2</sub> instead of correction factors as CO<sub>2</sub> values were over-and/or understated on Units 2, 3 and 5. The Unit 5 gaseous emissions monitor was reading incorrect values as identified during the parallel test that was conducted in October 2020. An average from the parallel test report was used for Unit 5 gaseous emissions.

### Raw Materials and Products

**Table 1. Quantity of Raw Materials and Products used/produced for the month of June 2020**

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of June 2020
	Coal	Tons/month	1 800 000	1 225 163
	Fuel Oil	Tons/month	6 000	2 613
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity - MW)	Production Rate in Month of June 2020
	Energy	GWh	4 110	2 366
	Ash	Tons/month	Not stated in the license	345 373

### Abatement Technology

**Table 2. Abatement Equipment Control Technology for the month of June 2020**

Associated Unit	Technology Type	Actual Utilisation (%) for the month of June 2020	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.94%
Unit 2	Fabric Filter Plant	100	99.92%
Unit 3	Fabric Filter Plant	100	99.92%


Unit 4	Fabric Filter Plant	100	99.91%
Unit 5	Fabric Filter Plant	100	99.89%
Unit 6	Fabric Filter Plant	100	99.98%

\*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal  
**Energy Source Characteristics**


**Table 3. Energy Source Material Characteristics for the month of June 2020**

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.6 to >0.94%	0.94%
Ash Content	28 to >30%	28.19%

**Emissions Reporting**

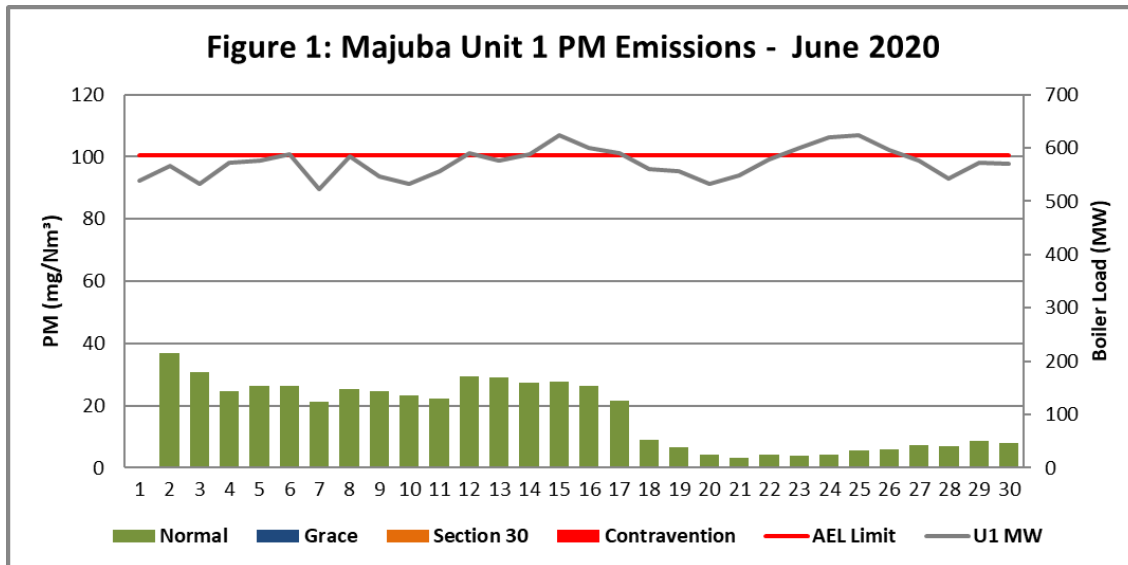

**Figure 1. Particulate Matter emissions (daily averages) for the month of June 2020 against emission limit for Unit 1.**

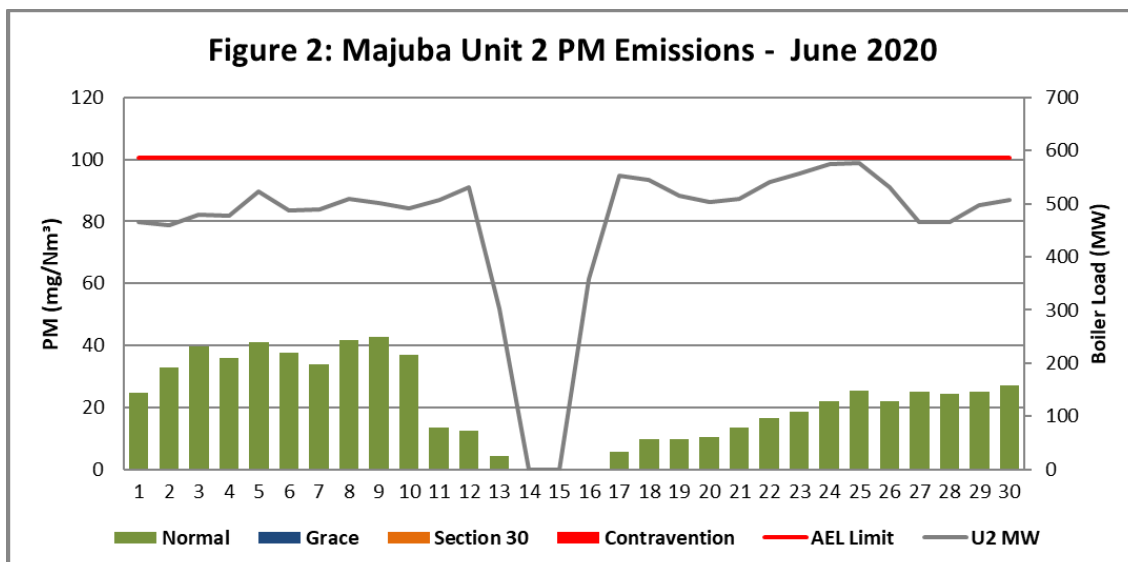

**Figure 2. Particulate Matter emissions (daily averages) for the month of June 2020 against emission limit for Unit 2**

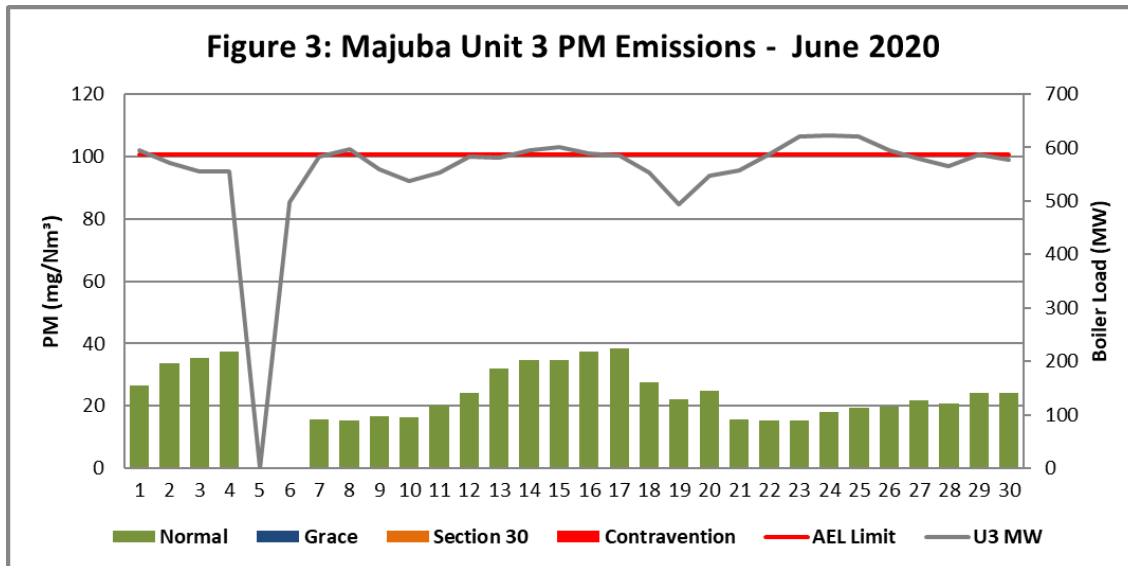


Figure 3. Particulate Matter emissions (daily averages) for the month of June 2020 against emission limit for Unit 3.

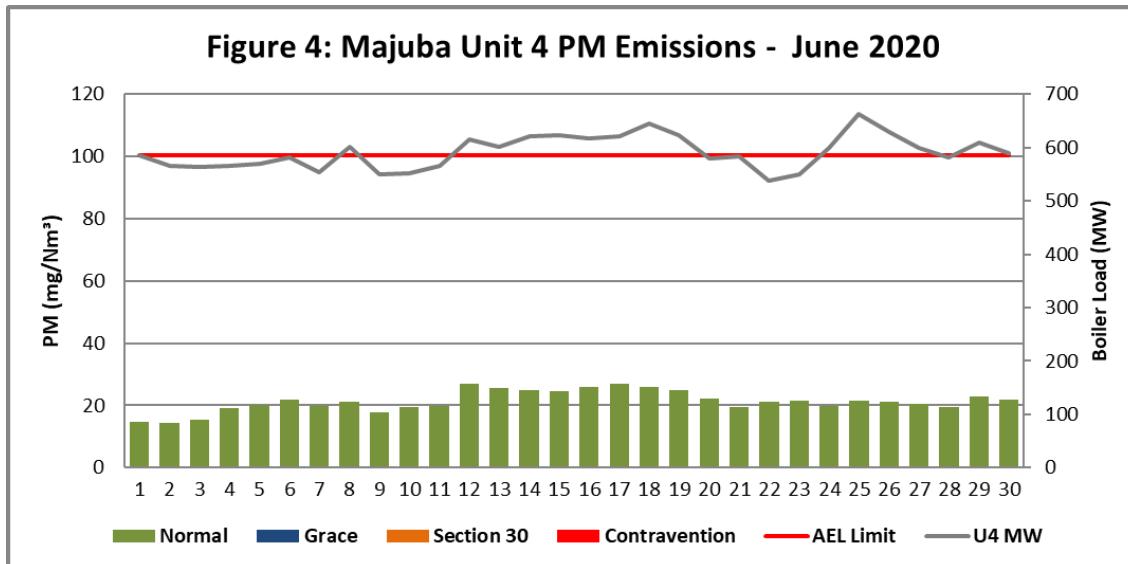


Figure 4. Particulate Matter emissions (daily averages) for the month of June 2020 against emission limit for Unit 4



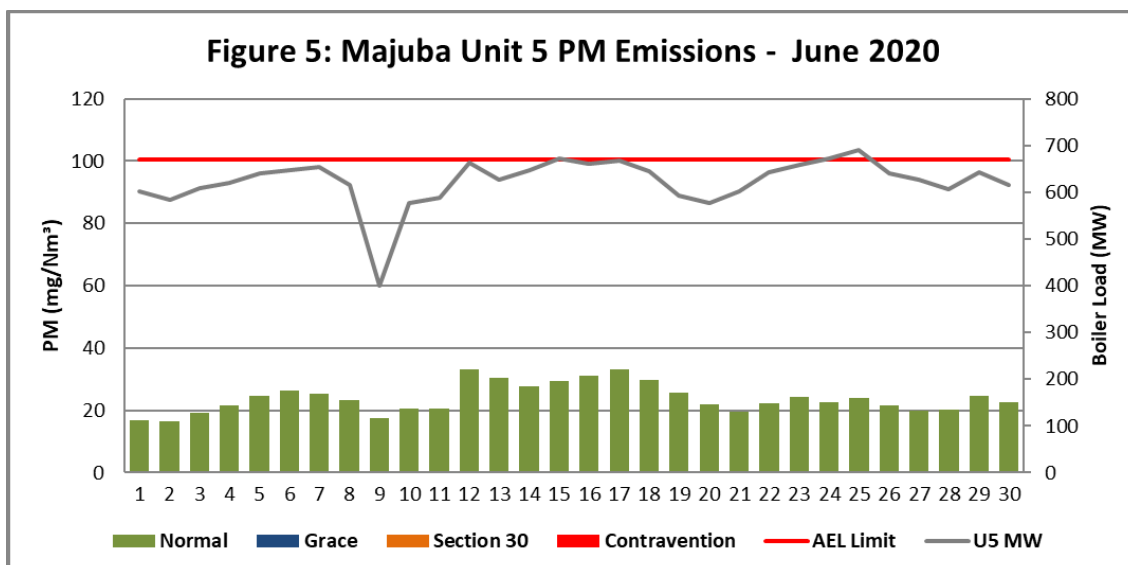



Figure 5. Particulate Matter emissions (daily averages) for the month of June 2020 against emission limit for Unit 5

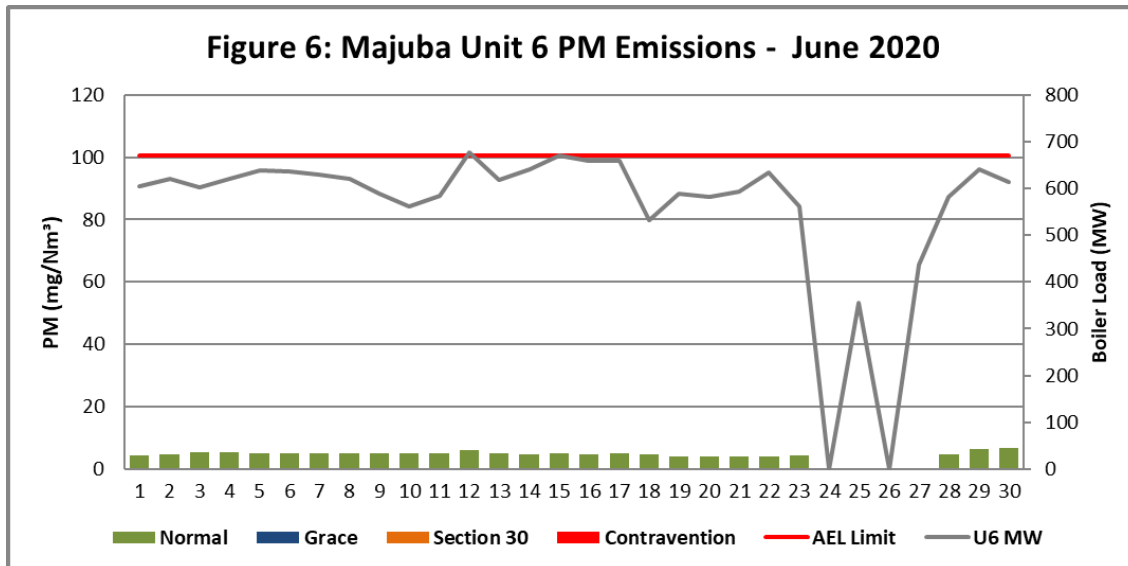

**Figure 6. Particulate Matter emissions (daily averages) for the month of June 2020 against emission limit for Unit 6.** \*Both servers failed on Unit 6 resulting in dataloss between 05 and 11 June 2020. An average was calculated for those days.

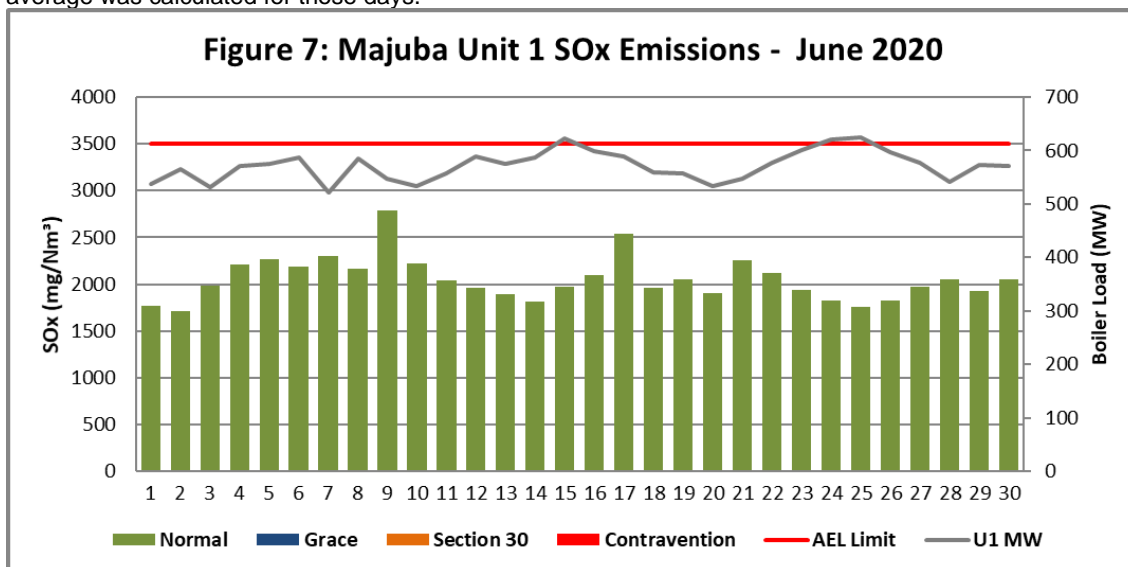

**Figure 7. SOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 1.**

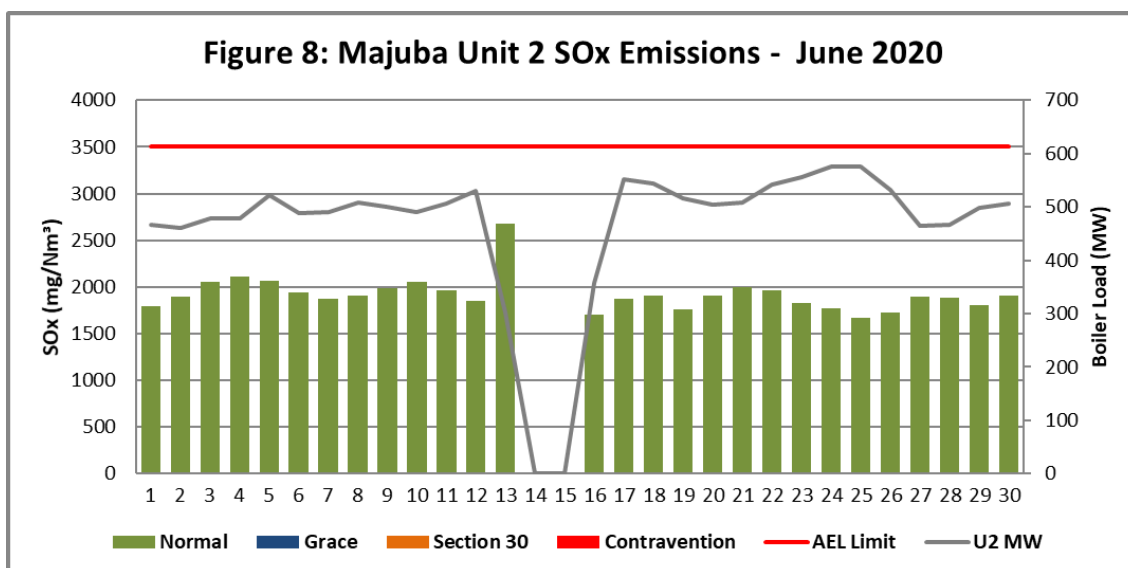

**Figure 8. SOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 2**

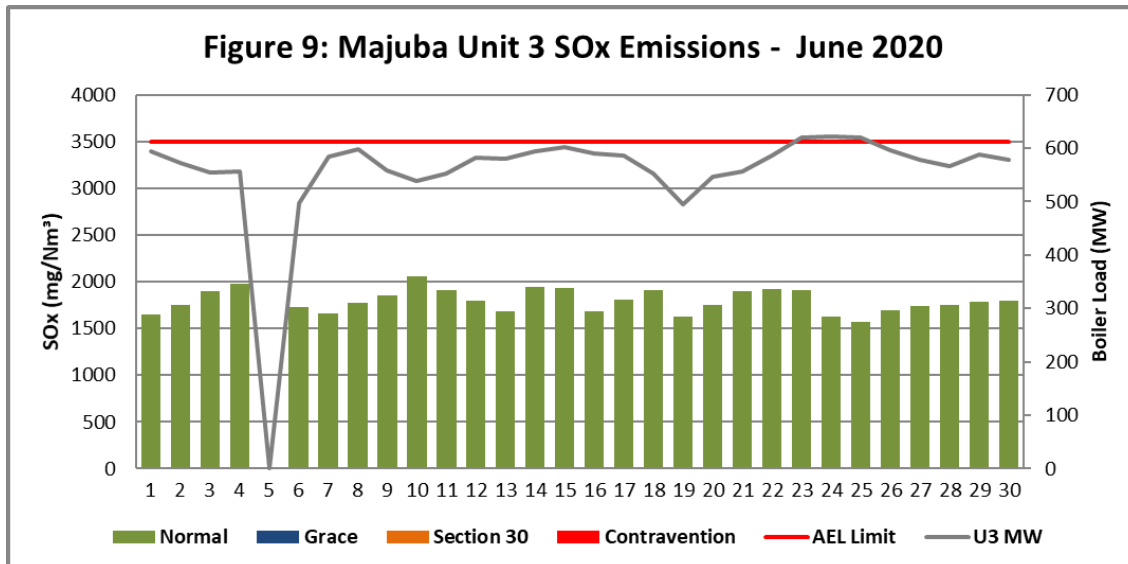


Figure 9. SOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 3.

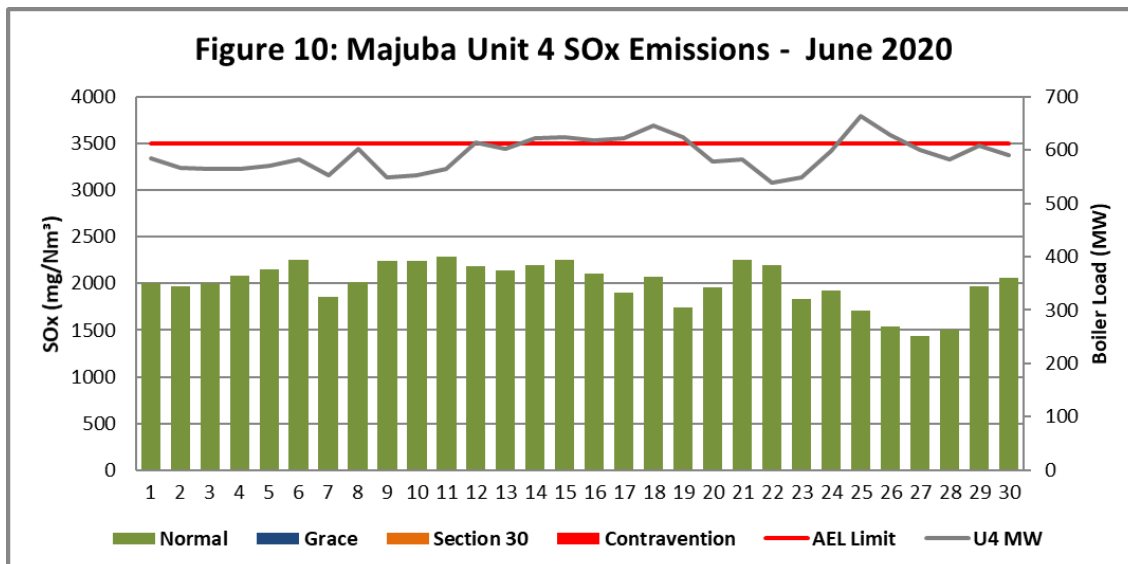


Figure 10. SOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 4



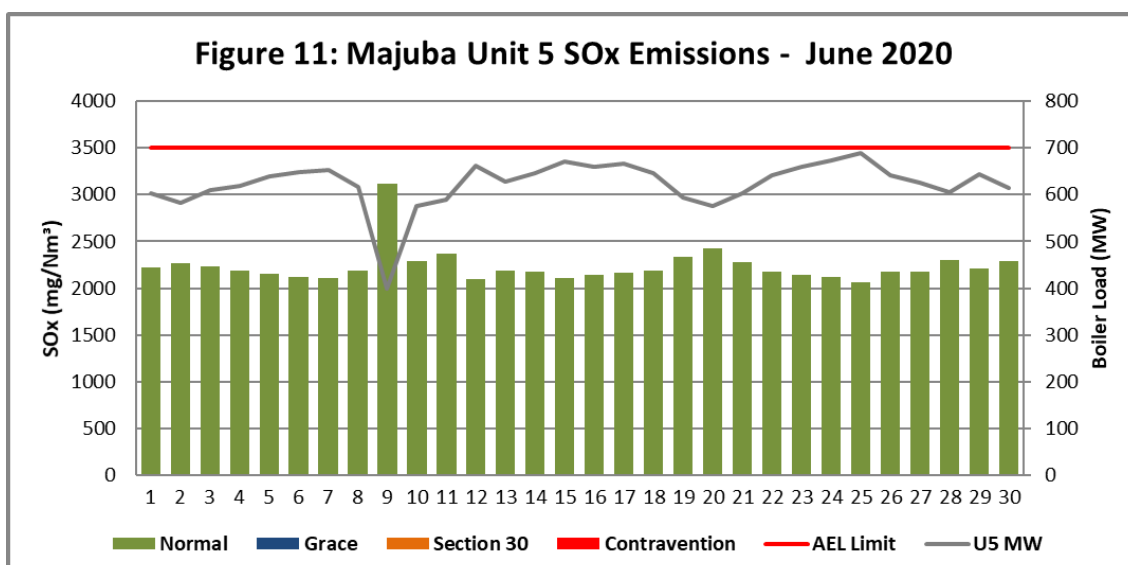



Figure 11. SOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 5

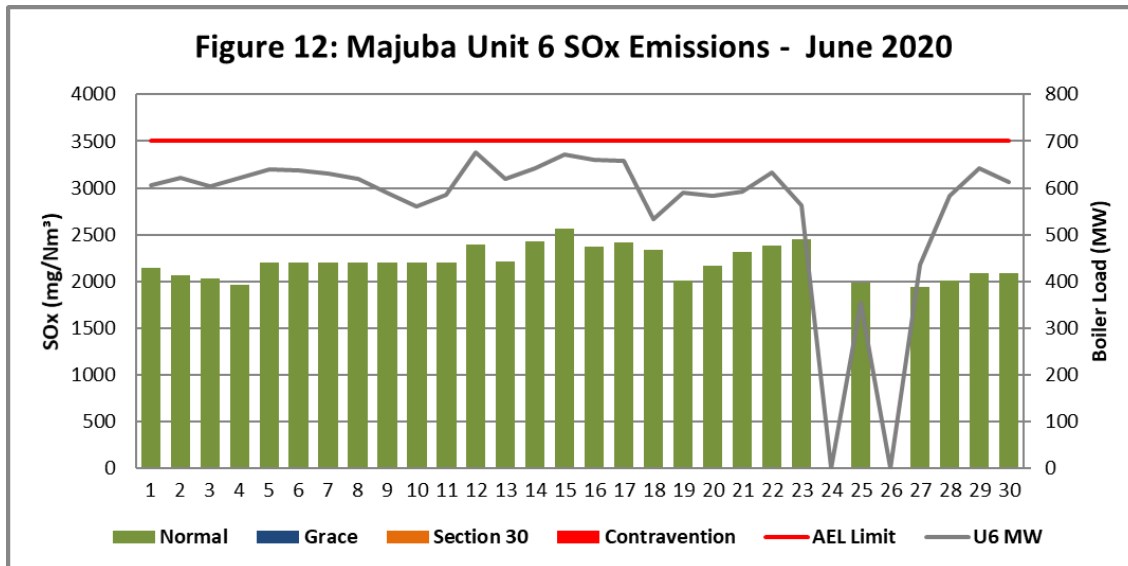


**Figure 12. SOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 6.** \*Both servers failed on Unit 6 resulting in dataloss between 05 and 11 June 2020. An average was calculated for those days.

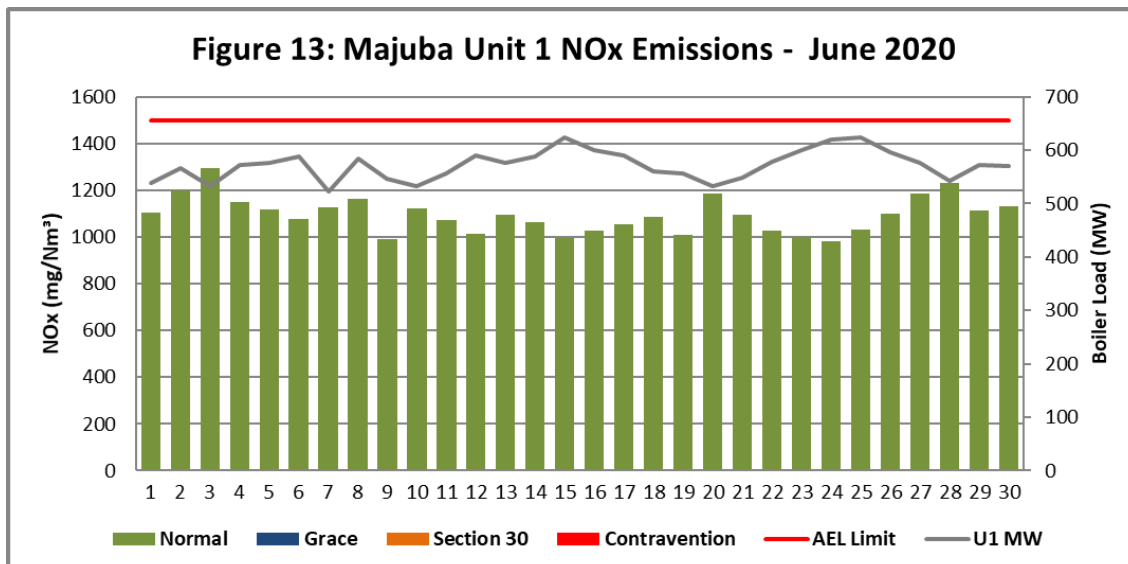


**Figure 13. NOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 1.**

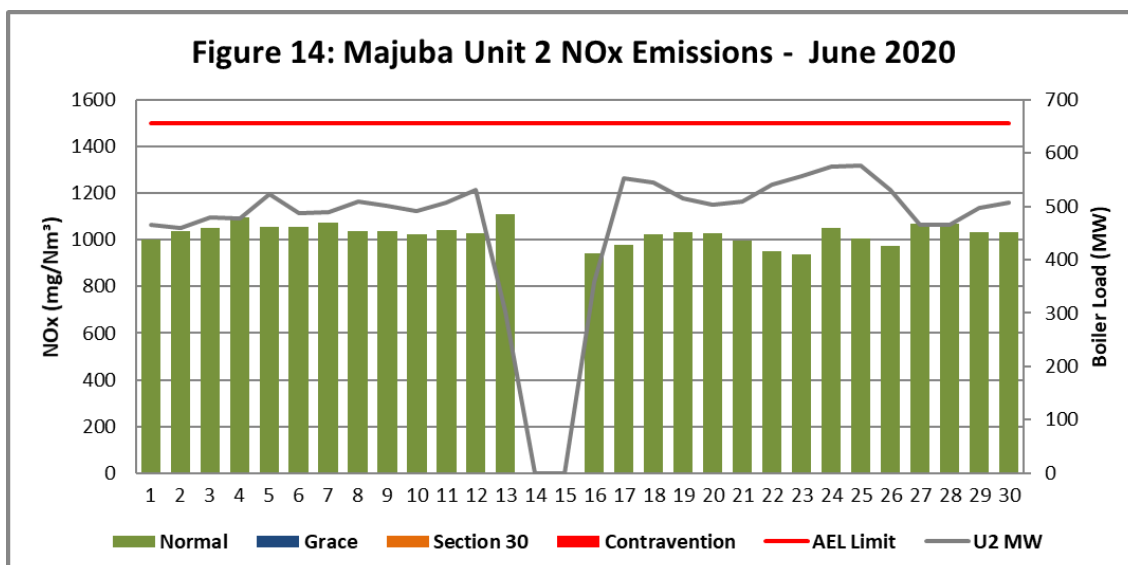


**Figure 14. NOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 2**

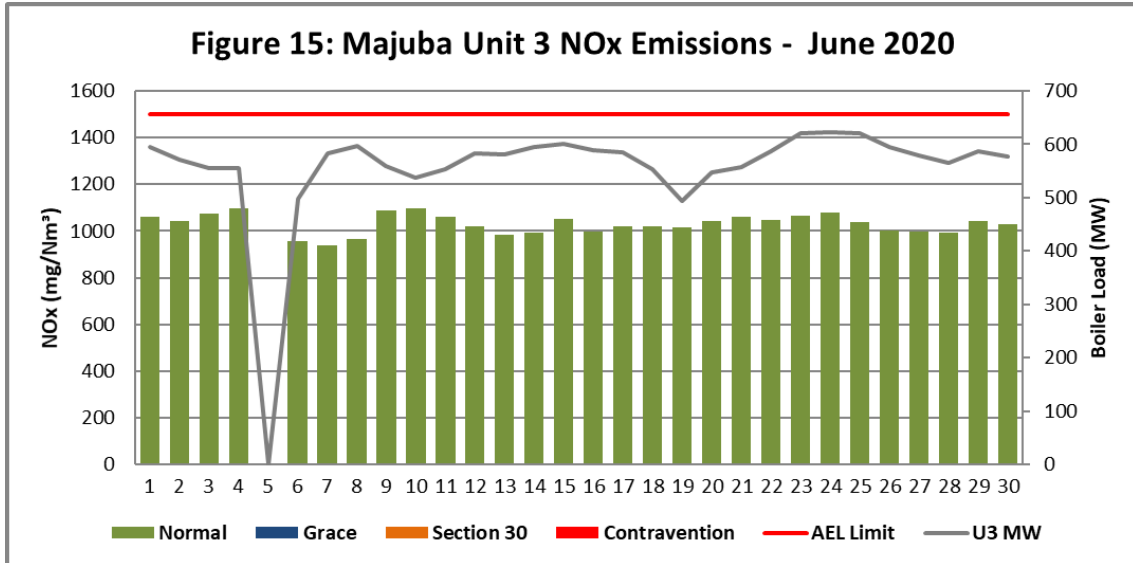


**Figure 15. NOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 3.**

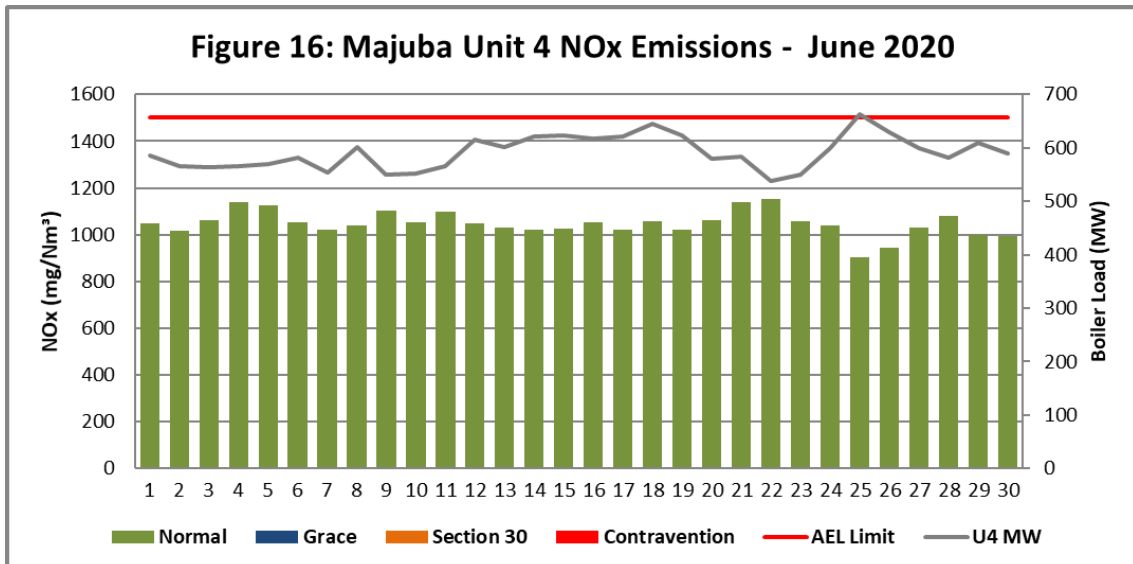

**Figure 16. NOx emissions (daily averages) for the month of June 2020 against emission limit for Unit 4**

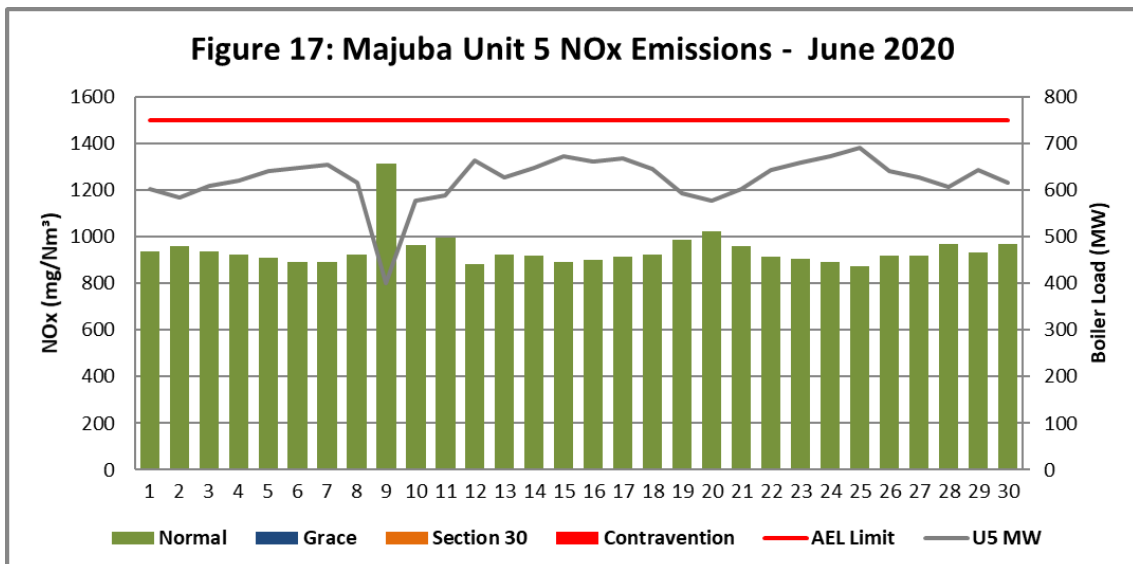

**Figure 17. NO<sub>x</sub> emissions (daily averages) for the month of June 2020 against emission limit for Unit 5**

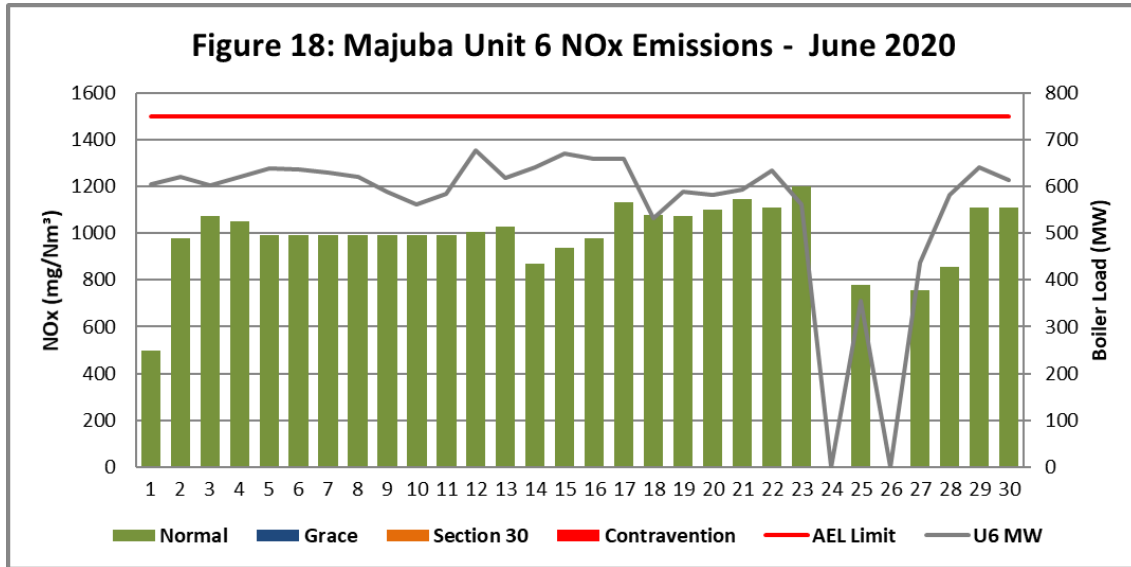

**Figure 18. NO<sub>x</sub> emissions (daily averages) for the month June 2020 against emission limit for Unit 6** \*Both servers failed on Unit 6 resulting in dataloss between 05 and 11 June 2020. An average was calculated for those days.

**Table 4: Monthly tonnages for the month of June 2020**

Unit	PM (tons)	SO <sub>2</sub> (tons)	NO <sub>x</sub> (tons)
1	33.1	4 136	2 199
2	32.5	2 613	1 414
3	43.7	3 298	1 895
4	48.7	4 668	2 443
5	62.1	5 734	2 416
6	9.1	4 468	2 017
<b>Sum</b>	<b>229.2</b>	<b>24 916</b>	<b>12 382</b>

**Table 5: Average monthly concentrations (mg/Nm<sup>3</sup>) for the month of June 2020**

Unit	PM (Mg/Nm <sup>3</sup> )	SO <sub>2</sub> (Mg/Nm <sup>3</sup> )	NO <sub>2</sub> (Mg/Nm <sup>3</sup> )
1	17.3	2 052.7	1 094.5
2	24.2	1 919.9	1 027.2
3	24.5	1 795.1	1 030.2
4	21.3	2 003.0	1 048.0
5	23.9	2 233.6	941.0
6	4.9	2 207.0	993.8

**Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits (SO<sub>x</sub>, NO<sub>x</sub> and PM)**

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	29	0	0	0	0
Unit 2	27	0	0	0	0
Unit 3	28	0	0	0	0
Unit 4	30	0	0	0	0
Unit 5	30	0	0	0	0
Unit 6	26	0	0	0	0



## CO<sub>2</sub> and O<sub>2</sub> Relationship

Calculation: CO<sub>2</sub>% + O<sub>2</sub>% = 19.5-21.5%

Date	Final Average CO <sub>2</sub> (%)						Final Average O <sub>2</sub> (%)						Final Average CO <sub>2</sub> + O <sub>2</sub> (%)					
	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
31-May	8.8	9.8	10.8	8.9	11.3		11.0	11.3	10.2	11.2	7.7	8.2	19.8	21.1	21.0	20.0	19.0	
01-Jun		9.8	11.7	10.1	11.0	12.2	9.2	11.2	9.2	9.7	8.1	7.6		21.0	20.9	19.9	19.1	19.8
02-Jun		9.7	11.6	9.9	10.8	12.3	9.2	11.4	9.2	10.1	8.4	7.6	9.2	21.1	20.8	20.1	19.3	19.8
03-Jun	11.0	9.7	11.2	10.1	11.1	12.1	9.7	11.4	9.6	9.9	8.2	7.7	20.7	21.1	20.9	20.0	19.2	19.8
04-Jun	11.2	9.6	11.4	10.1	11.3	12.6	8.9	11.6	9.6	9.8	7.9	7.3	20.2	21.2	21.0	20.0	19.2	19.9
05-Jun	11.5	10.1		10.1	11.5		8.8	10.9		9.9	7.7	8.1	20.2	21.0		20.0	19.2	8.1
06-Jun	11.5	9.7		10.3	11.6		8.7	11.6	9.7	9.7	7.5	8.1	20.2	21.3		19.9	19.1	8.1
07-Jun	10.3	9.6	11.7	9.8	11.6		10.1	11.6	8.5	10.2	7.5	8.1	20.4	21.1	20.1	20.0	19.0	8.1
08-Jun	11.5	10.2	11.8	10.5	11.2		8.7	10.7	8.4	9.4	7.9	8.1	20.1	20.9	20.3	19.9	19.1	8.1
09-Jun	10.8	10.0	11.1	10.1	10.2		9.5	11.0	9.9	9.8	11.1	8.1	20.3	21.0	21.1	19.9	21.3	8.1
10-Jun	10.5	10.0	10.6	10.0	10.7		9.7	11.0	10.8	10.0	8.4	8.1	20.2	21.0	21.4	20.0	19.2	8.1
11-Jun	10.7	10.1	10.8	10.0	10.5		9.5	10.9	10.4	9.9	8.8	8.1	20.2	20.9	21.1	19.9	19.2	8.1
12-Jun	11.4	10.3	11.0	10.5	11.5	13.1	9.0	10.5	9.5	9.4	7.3	8.0	20.4	20.8	20.5	19.8	18.8	21.1
13-Jun	11.3	7.5	11.1	10.5	11.1	12.6	9.1	14.5	9.4	9.2	8.0	8.0	20.3	21.9	20.5	19.6	19.1	20.6
14-Jun	11.5		11.2	10.5	11.3	12.8	8.9		9.2	9.2	7.8	8.0	20.3		20.5	19.6	19.2	20.8
15-Jun	12.2		11.2	10.4	11.6	13.1	8.0		9.3	9.2	7.5	8.0	20.2		20.5	19.6	19.1	21.2
16-Jun	12.2		11.6	10.4	11.5	13.3	8.2	12.4	8.8	9.3	7.6	8.1	20.3		20.4	19.7	19.1	21.4
17-Jun	12.0	10.6	11.6	10.4	11.5	13.4	8.5	10.1	9.0	9.2	7.7	8.1	20.5	20.7	20.6	19.6	19.2	21.5
18-Jun	11.3	10.5	10.7	10.6	11.3	13.2	9.3	10.4	10.2	9.0	7.8	8.1	20.6	20.9	20.9	19.6	19.1	21.4
19-Jun	11.1	10.2	10.1	10.7	10.6	13.6	9.5	10.9	11.0	9.0	8.6	8.1	20.6	21.1	21.1	19.7	19.2	21.8
20-Jun	10.9	10.1	10.8	10.3	10.3	13.8	9.6	11.1	10.3	9.5	9.1	8.1	20.5	21.2	21.0	19.8	19.4	22.0
21-Jun	11.1	10.1	10.8	10.7	10.7	13.9	9.1	10.8	10.1	9.1	8.4	8.1	20.3	20.9	20.9	19.7	19.0	22.0
22-Jun	11.4	10.5	11.2	10.1	11.2	13.9	8.9	10.0	9.7	9.7	7.8	8.1	20.3	20.5	20.9	19.8	19.0	22.1
23-Jun	11.8	10.9	11.6	10.1	11.4	13.7	8.5	9.9	9.5	9.7	7.6	8.1	20.3	20.8	21.1	19.7	19.0	21.9
24-Jun	11.7	11.1	11.6	10.5	11.5		8.2	9.7	9.3	9.3	7.4		19.9	20.8	20.8	19.8	18.9	
25-Jun	11.6	11.1	11.6	11.2	11.8		8.1	9.7	9.0	8.5	7.2	8.1	19.6	20.8	20.6	19.7	19.0	
26-Jun	11.2	10.4	11.4	10.8	11.3		8.7	10.6	9.5	8.9	7.8		19.9	21.0	20.9	19.7	19.0	
27-Jun	11.0	9.3	11.2	10.7	11.2		8.8	12.2	9.8	9.1	7.8	8.0	19.8	21.5	20.9	19.8	19.1	
28-Jun	10.5	9.2	11.0	10.3	10.7	12.3	9.5	12.3	10.2	9.6	8.5	8.1	20.0	21.5	21.1	19.9	19.1	20.3
29-Jun	10.9	9.9	10.9	10.6	11.1	12.8	9.2	11.3	10.0	9.2	8.0	8.1	20.1	21.2	21.0	19.8	19.1	20.9
30-Jun	11.0	9.8	11.3	10.5	10.8	12.6	9.1	11.4	9.6	9.3	8.4	8.1	20.1	21.2	20.9	19.8	19.2	20.8
<b>Totals</b>	<b>11.2</b>	<b>10.0</b>	<b>11.2</b>	<b>10.4</b>	<b>11.1</b>	<b>13.0</b>	<b>9.0</b>	<b>11.1</b>	<b>9.6</b>	<b>9.5</b>	<b>8.1</b>	<b>8.0</b>	<b>19.9</b>	<b>21.1</b>	<b>20.8</b>	<b>19.8</b>	<b>19.2</b>	<b>17.5</b>

**Table 7: CO<sub>2</sub> and O<sub>2</sub> deviations of the Month of June 2020**

\*Blank spaces indicate that the unit was offline during that period

## Comments on the performance and availability of each unit

### Emergency Generation

**Table 8: Emergency Generation for the month of June 2020**

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
<b>Emergency Generation hours declared by national Control</b>	0	0	0	0	0	0
<b>Emergency Hours declared including hours after stand down</b>	0	0	0	0	0	0
<b>Hours over the Limit during Emergency Generation</b>	0	0	0	0	0	0

## Comments on the performance and availability of each unit

### UNIT 1

The unit base loaded for all of the days of the month. Ten fabric filter bags were replaced during the month.

### UNIT 2

The unit base loaded for most of the days of the month and off for two days. Fifteen fabric filter bags were replaced during the month.

### UNIT 3

The unit base loaded for most of the days of the month and off for one day. Forty-eight fabric filter bags were replaced during the month.

### UNIT 4

The unit base loaded for all of the days of the month. Eight fabric filter bags were replaced during the month.

### UNIT 5

The unit base loaded for all of the days of the month. Three fabric filter bags were replaced during the month.

### UNIT 6

The unit base loaded for most of the days of the month and off for two days. Twenty-one fabric filter bags were replaced during the month.

## Complaints Register


**Table 9: Complaints for the month of June 2020**

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received in the month of June 2020				

**General**

Additional information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Report compiled by:



Faith Kagoda  
**ENVIRONMENTAL MANAGER: (MAJUBA)**

Date 11/02/2021

Report verified by:




Lindani Madonsela  
**BOILER ENGINEERING MANAGER: (MAJUBA)**

Date 16/02/2021

Hoping the above will meet your satisfaction

Yours sincerely



Bawinile Malope  
**ENGINEERING MANAGER: (MAJUBA)**

2021/02/22

Date