

Mr Dan Hlanyane Senior Manager Municipal Health & Environmental Services Gert Sibande District Municipality PO BOX 3016 ERMELO 2350

Date: 11 February 2021

Enquiries: Mrs B Malope Tel +27 17 799 8815

Dear Mr. Hlanyane

#### MAJUBA POWER STATION'S REVISED MONTHLY EMISSIONS REPORT FOR THE MONTH OF JULY 2020

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of July 2020. Verified emissions of particulates are included.  $SO_2$  and  $NO_x$  (as  $NO_2$ ) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting. This report was revised due to the parallel test curves that were back-fitted on all gaseous emissions monitors. Unity factors were used for  $CO_2$  instead of correction factors as  $CO_2$  values were overand/or understated on Units 2, 3 and 5. The Unit 5 gaseous emissions monitor was reading incorrect values as identified during the parallel test that was conducted in October 2020. An average from the parallel test report was used for Unit 5 gaseous emissions.

#### **Raw Materials and Products**

#### Table 1. Quantity of Raw Materials and Products used/produced for the month of July 2020

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of July 2020		
Products used	Coal	Tons/month	1 800 000	1 197 839		
	Fuel Oil	Tons/month	6 000	4 862		
	Product/ By- Product Name	Unit	Maximum Production Capacity Permitted (Quantity - MW)	Production Rate in Month of July 2020		
Production Rates	Energy	GWh	4 110	2 289		
	Ash	Tons/month	Not stated in the license	348 931		

#### Abatement Technology Table 2. Abatement Equipment Control Technology for the month of July 2020

Associated Unit	Technology Type	Actual Utilisation (%) for the month of July 2020	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.95%

Generation Division (Operating Unit Coal 2) Majuba Power Station Between Amersfoort and Volksrust Private Bag x9001 Volksrust 2470 SA Tel +27 17 799 2100 Fax +27 17 799 3615 www.eskom.co.za

Eskom Holdings SOC Ltd Reg No 2002/015527/30

Unit 2	Fabric Filter Plant	100	99.92%
Unit 3	Fabric Filter Plant	100	99.92%
Unit 4	Fabric Filter Plant	100	99.93%
Unit 5	Fabric Filter Plant	100	99.90%
Unit 6	Fabric Filter Plant	100	99.97%

\*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal **Energy Source Characteristics** 

Characteristic	Stipulated Range (Unit)	Monthly Average Content			
Sulphur Content	0.6 to >0.94%	0.99%			
Ash Content	28 to >30%	29.13%			

#### **Emissions Reporting**

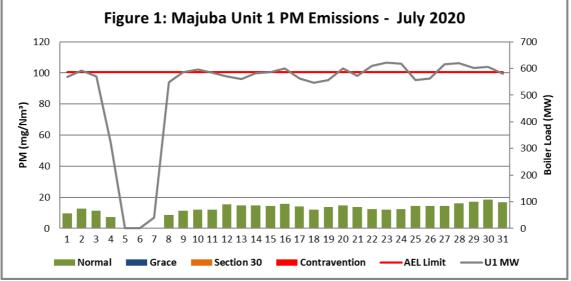


Figure 1. Particulate Matter emissions (daily averages) for the month of July 2020 against emission limit for Unit 1.

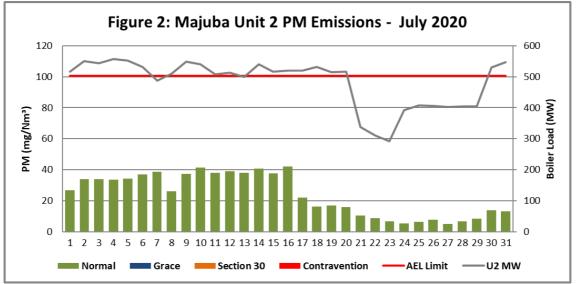


Figure 2. Particulate Matter emissions (daily averages) for the month of July 2020 against emission limit for Unit 2

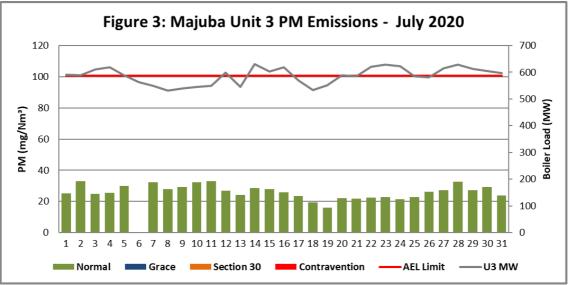


Figure 3. Particulate Matter emissions (daily averages) for the month of July 2020 against emission limit for Unit 3.

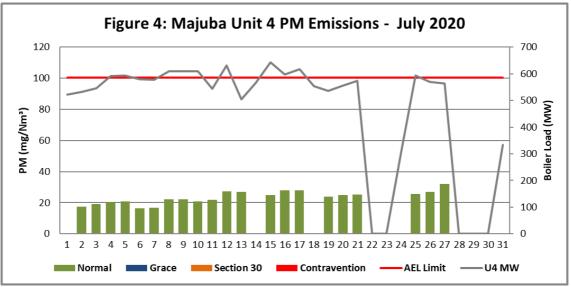


Figure 4. Particulate Matter emissions (daily averages) for the month of July 2020 against emission limit for Unit 4

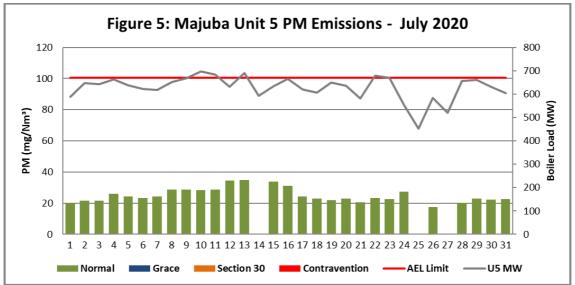


Figure 5. Particulate Matter emissions (daily averages) for the month of July 2020 against emission limit for Unit 5

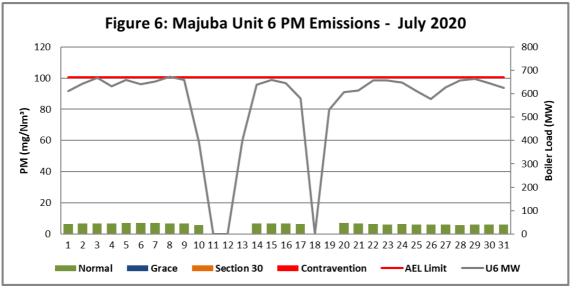


Figure 6. Particulate Matter emissions (daily averages) for the month of July 2020 against emission limit for Unit 6

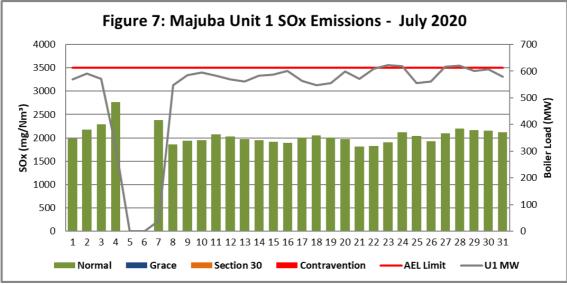


Figure 7. SOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 1.

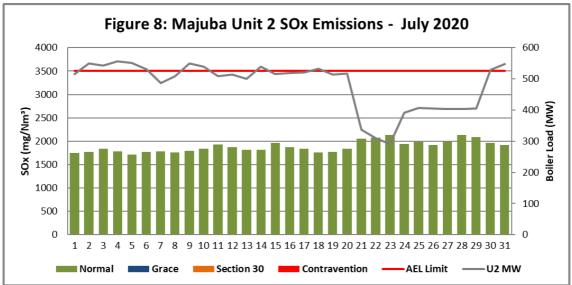


Figure 8. SOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 2

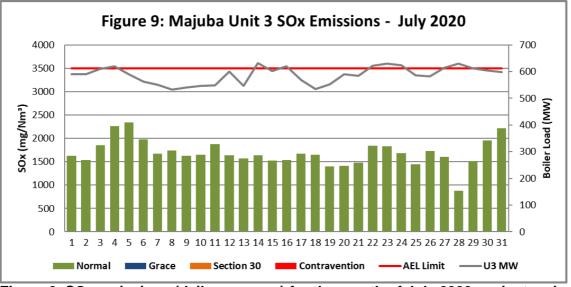


Figure 9. SOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 3.

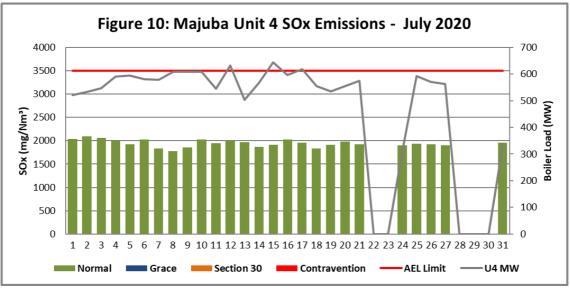


Figure 10. SOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 4

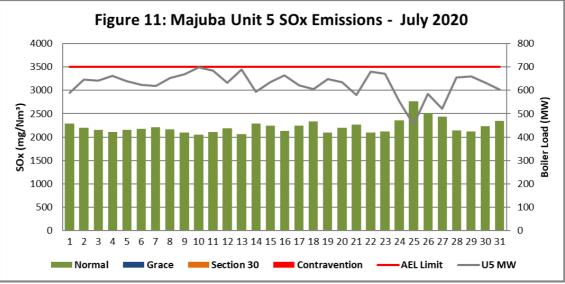


Figure 11. SOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 5

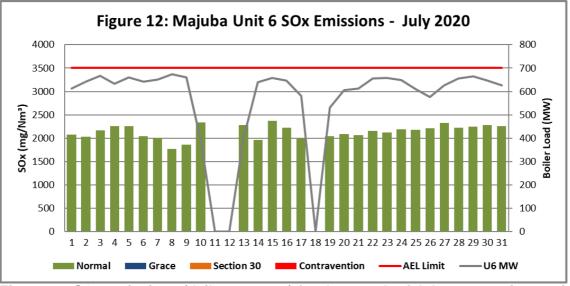


Figure 12. SOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 6

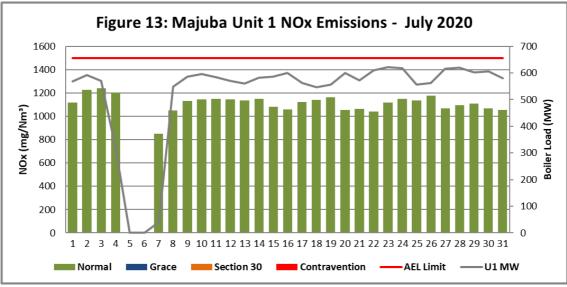


Figure 13. NOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 1.

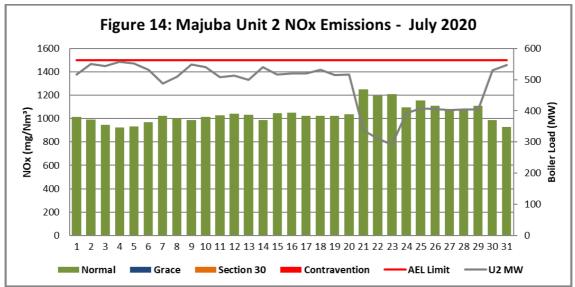


Figure 14. NOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 2

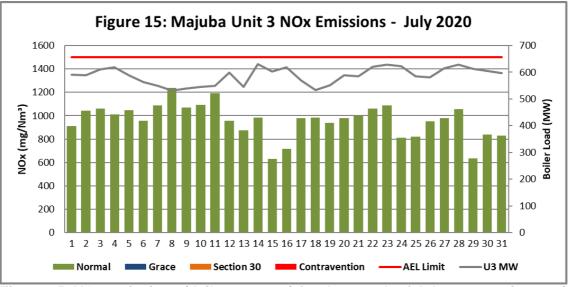


Figure 15. NOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 3.

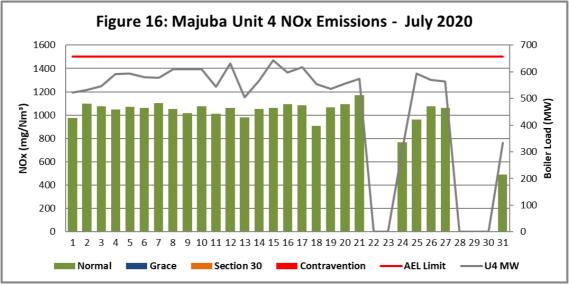


Figure 16. NOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 4

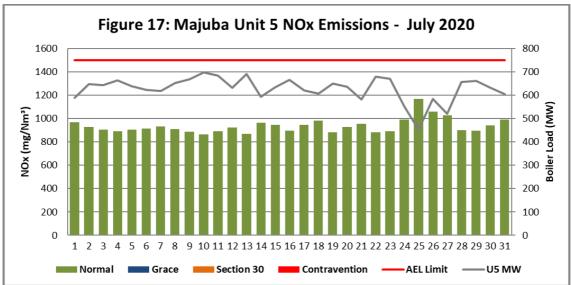


Figure 17. NOx emissions (daily averages) for the month of July 2020 against emission limit for Unit 5

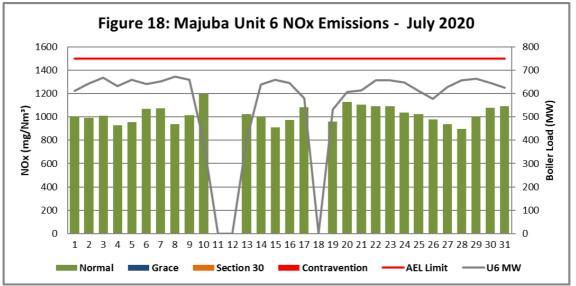


Figure 18. NOx emissions (daily averages) for the month July 2020 against emission limit for Unit 6

Unit	PM (tons)	SO <sub>2</sub> (tons)	NO <sub>x</sub> (tons)
1	24.9	3 737	2 071
2	38.9	2 852	1 571
3	46.3	3 294	1 872
4	31.5	3 380	1 821
5	56.8	5 531	2 330
6	12.9	4 590	2 177
Sum	211.3	23 385	11 842

Table 4: Monthly	v tonnages	for the	month	of July	2020

#### Table 5: Average monthly concentrations (mg/Nm<sup>3</sup>) for the month of July 2020

Unit	PM (Mg/Nm³)	SO <sub>2</sub> (Mg/Nm <sup>3</sup> )	NO <sub>2</sub> (Mg/Nm <sup>3</sup> )
1	13.5	2 053.5	1 111.6
2	23.9	1 885.8	1 042.4
3	26.2	1 689.6	962.0
4	23.4	1 945.8	1 020.6
5	25.0	2 221.3	935.8
6	6.5	2 144.3	1 021.3

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits
(SO <sub>x</sub> , NO <sub>x</sub> and PM)

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	28	0	0	0	0
Unit 2	31	0 0 0		0	0
Unit 3	30	0	0	0	0
Unit 4	21		0	0	0
Unit 5	28	0	0 0		0
Unit 6	26	0	0	0	0

CO<sub>2</sub> and O<sub>2</sub> Relationship

# Calculation: $CO_2$ % + $O_2$ % = 19.5-21.5%

		Final	Avera	ge CO	2 (%)		Final Average O₂ (%)					Fina	al Ave	erage	CO2	+ 0 <sub>2</sub>	(%)	
Date	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
01-Jul	10.8	10.1	11.7		10.8	12.7	10.1	11.0	8.9	9.7	8.5	7.9	20.8	21.1	20.6		19.3	20.6
02-Jul	10.9	10.7	11.5	10.0	11.1	12.8	9.3	10.2	9.3	9.9	7.9	7.2	20.1	20.9	20.8	19.9	19.0	20.0
03-Jul	10.8	10.7	11.8	10.2	11.3	12.9	9.2	10.2	9.0	9.6	7.6	7.2	19.9	20.8	20.8	19.9	18.9	20.1
04-Jul	8.3	10.9	11.9	10.7	11.5	12.6	12.4	9.8	8.5	9.1	7.5	7.5	20.6	20.8	20.5	19.8	19.0	20.1
05-Jul		10.9	11.6	10.7	11.1	12.7		9.8	9.1	9.6	7.8	7.2		20.7	20.6	20.3	18.9	20.0
06-Jul		10.6		10.4	11.1	12.7		10.3	8.1	9.9	7.9	7.4		20.9		20.3	19.0	20.0
07-Jul		9.8	11.0	10.3	11.0	12.6	15.7	11.4	10.1	9.6	8.0	7.5		21.2	21.1	19.9	19.0	20.0
08-Jul	10.5	9.9	10.8	10.7	11.5	13.0	9.6	11.2	11.1	9.0	7.7	7.3	20.1	21.1	21.9	19.8	19.1	20.3
09-Jul	10.9	10.5	10.6	10.9	11.6	12.8	9.1	10.5	10.4	8.8	7.2	7.5	20.0	21.0	21.0	19.7	18.9	20.3
10-Jul	10.8	10.5	10.7	11.0	11.9	10.8	9.1	10.6	10.4	8.7	7.0	9.2	19.9	21.0	21.1	19.7	18.8	20.0
11-Jul	10.7	10.2	10.8	10.2	11.7		9.2	10.9	10.7	9.6	7.4		19.9	21.1	21.5	19.8	19.1	
12-Jul	10.8	10.1	11.7	11.0	11.1		9.3	10.9	8.7	8.7	8.0		20.0	21.0	20.3	19.7	19.0	
13-Jul	10.7	10.2	11.0	10.2	11.8		9.2	10.9	9.5	9.7	7.1	9.8	19.9	21.1	20.5	20.0	18.9	
14-Jul	10.7	10.6	11.7			12.7	9.2	10.3	9.2	9.3	8.4	7.5	20.0	20.9	20.9			20.2
15-Jul	11.0	10.0	11.4	10.9	10.8	12.7	9.0	11.0	9.0	8.8	8.3	7.6	20.0	21.0	20.4	19.6	19.0	20.3
16-Jul	11.3	10.0	11.4	10.7	11.4	12.6	8.4	11.1	8.7	9.0	7.6	7.6	19.7	21.1	20.1	19.7	19.0	20.1
17-Jul	10.8	10.3	10.9	10.9	10.8	12.1	8.9	10.7	9.7	8.8	8.3	8.1	19.6	21.0	20.7	19.8	19.1	20.1
18-Jul	10.5	10.6	10.7		10.5		9.2	10.3	10.1	9.4	8.7		19.8	20.8	20.9		19.3	
19-Jul	10.7	10.2	10.9	9.8	11.4		9.0	10.8	9.9	10.2	7.4	8.5	19.7	21.0	20.8	20.0	18.8	
20-Jul	11.1	9.9	11.1	10.2	11.0	12.2	8.7	11.2	10.0	9.6	8.0	7.8	19.8	21.1	21.1	19.8	18.9	20.0
21-Jul	10.9	8.4	11.1	10.3	10.7	12.3	8.9	13.3	10.0	9.6	8.4	7.8	19.8	21.7	21.1	19.9	19.0	20.1
22-Jul	11.4	8.1	11.5		11.5	12.6	8.5	13.3	9.5		7.4	7.6	19.8	21.4	21.1		18.9	20.2
23-Jul	11.6	7.9	11.9		11.6	12.7	8.3	13.8	9.0		7.4	7.6	19.9	21.8	20.9		19.0	20.3
24-Jul	11.4	9.4	11.8		10.5	12.6	8.5	11.7	9.0	11.6	8.7	7.8	19.9	21.1	20.8		19.2	20.4
25-Jul	10.5	8.5	11.5	10.5		12.4	9.6	13.2	9.0	9.1	10.5	8.0	20.0	21.7	20.5	19.6		20.4
26-Jul	10.5	8.3	11.1	10.4	10.4	12.0	9.4	13.2	9.6	9.3	9.5	8.4	19.9	21.6	20.7	19.7	19.9	20.4
27-Jul	11.2	8.0	11.7	10.0		12.5	8.7	13.6	9.9	9.7	9.0	8.0	19.9	21.6	21.7	19.8		20.5
28-Jul	11.3	8.0	11.9		11.4	12.8	8.4	13.6	9.3		7.6	7.5	19.8	21.7	21.2		19.0	20.3
29-Jul	11.1	8.1	11.5		11.4	12.9	8.6	13.5	9.9		7.5	7.3	19.8	21.6	21.4		18.9	20.2
30-Jul	11.2	10.4	11.6		11.1	12.7	8.4	10.4	10.2		8.2	7.5	19.7	20.8	21.7		19.3	20.2
31-Jul	10.9	10.7	11.6		10.8	12.7	8.9	10.2	9.9	10.9	8.9	7.7	19.8	20.9	21.5		19.6	20.3
Totals	10.8	9.8	11.3	10.5	11.2	12.5	9.3	11.4	9.5	9.5	8.0	7.8	19.9	21.2	20.9	19.8	19.1	20.2

# Table 7: $CO_2$ and $O_2$ deviations of the Month of July 2020 \*Blank spaces indicate that the unit was offline during that period

# Comments on the performance and availability of each unit

#### **Emergency Generation**

## Table 8: Emergency Generation for the month of July 2020

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

## Comments on the performance and availability of each unit

#### UNIT 1

The unit was on base load for most days during the month of July 2020. Unit was off for two days. Six fabric filter bags were replaced in July 2020.

## UNIT 2

The unit base loaded for all of the days during the month. Thirty-nine (39) filter bags were replaced during the month.

#### UNIT 3

The unit base loaded for all of the days during the month. Thirty-seven (37) fabric filter bags were replaced during the month.

#### **UNIT 4**

The unit base loaded for most of the days during the month and off for six days. Seventeen (17) fabric filter bags were replaced during the month.

#### UNIT 5

The unit base loaded for all of the days during the month. Eleven (11) fabric filter bags were replaced during the month.

#### UNIT 6

The unit base loaded for most of the days during the month and off for three days. Six fabric filter bags were replaced during the month.

## **Complaints Register**

#### Table 9: Complaints for the month of July 2020

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received in the month of July 2020				

## General

Additional information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Report compiled by:

Faith Kagoda ENVIRONMENTAL MANAGER: (MAJUBA)

Date 11/02/2021

Report verified by:

Lindani Madonsela BOILER ENGINEERING MANAGER: (MAJUBA)

Hoping the above will meet your satisfaction

Yours sincerely

Bawihite Malope ENGINEERING MANAGER: (MAJUBA) Date 16/02/2021

2021/02/22 Date