

Mr Dan Hlanyane Senior Manager Municipal Health & Environmental Services Gert Sibande District Municipality PO BOX 3016 ERMELO 2350

Enquiries: Mrs B Malope Tel +27 17 799 8815

Date: 11 February 2021

Dear Mr. Hlanyane

MAJUBA POWER STATION'S REVISED MONTHLY EMISSIONS REPORT FOR THE MONTH OF AUGUST 2020

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of August 2020. Verified emissions of particulates are included. SO_2 and NO_x (as NO_2) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting. This report was revised due to the parallel test curves that were back-fitted on all gaseous emissions monitors. Unity factors were used for CO_2 instead of correction factors as CO_2 values were overand/or understated on Units 2, 3 and 5. The Unit 5 gaseous emissions monitor was reading incorrect values as identified during the parallel test that was conducted in October 2020. An average from the parallel test report was used for Unit 5 gaseous emissions.

Raw Materials and Products

Table 1. Quantity of Raw Materials and Products used/produced for the month of August 2020

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of August 2020	
Froducts used	Coal	Tons/month	1 800 000	1 065 615	
	Fuel Oil	Tons/month	6 000	2 769	
Due diestien Detec	Product/ By- Product Name	Unit	Maximum Production Capacity Permitted (Quantity - MW)	Production Rate in Month of August 2020	
Production Rates	Energy	GWh	4 110	2 026	
	Ash	Tons/month	Not stated in the license	316 381	

Abatement Technology

Table 2. Abatement Equipment Control Technology for the month of August 2020

Associated Unit	Technology Type	Actual Utilisation (%) for the month of August 2020	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.93%

Unit 2	Fabric Filter Plant	100	99.93%
Unit 3	Fabric Filter Plant	100	99.91%
Unit 4	Fabric Filter Plant	100	99.93
Unit 5	Fabric Filter Plant	100	99.93
Unit 6	Fabric Filter Plant	100	99.98

^{*}Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal. Unit 5 was on outage from 03 August 2020.

Energy Source Characteristics

Table 3. Energy Source Material Characteristics for the month of August 2020

Characteristic	Stipulated Range (Unit)	Monthly Average Content			
Sulphur Content	0.6 to >0.94%	1.08%			
Ash Content	28 to >30%	29.69%			

Emissions Reporting

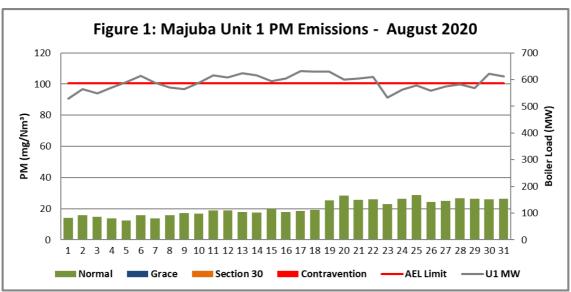


Figure 1. Particulate Matter emissions (daily averages) for the month of August 2020 against emission limit for Unit 1.

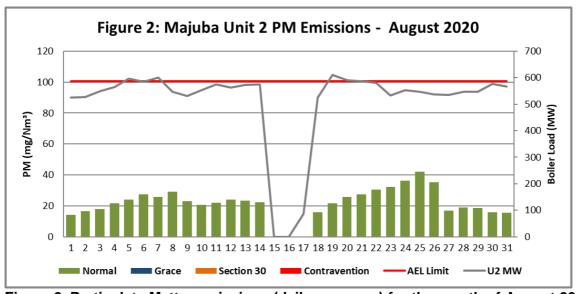


Figure 2. Particulate Matter emissions (daily averages) for the month of August 2020 against emission limit for Unit 2

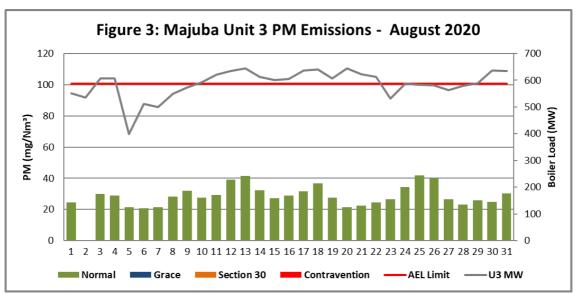


Figure 3. Particulate Matter emissions (daily averages) for the month of August 2020 against emission limit for Unit 3.

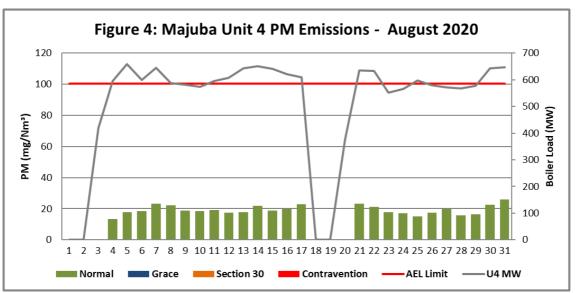


Figure 4. Particulate Matter emissions (daily averages) for the month of August 2020 against emission limit for Unit 4

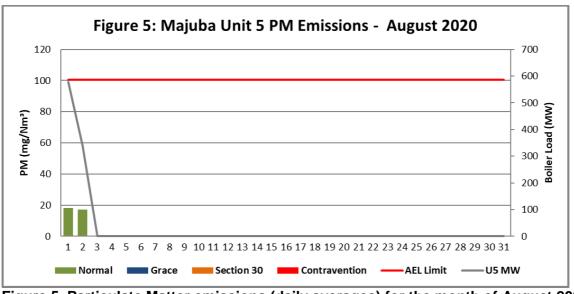


Figure 5. Particulate Matter emissions (daily averages) for the month of August 2020 against emission limit for Unit 5. Unit 5 went on outage on the 3rd of August 2020.

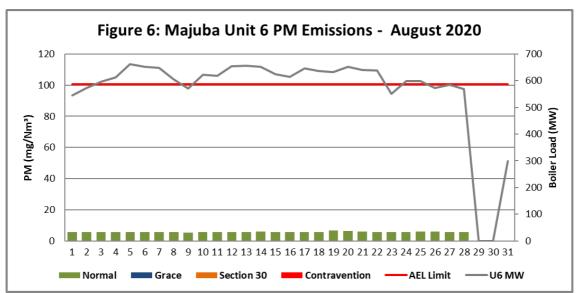


Figure 6. Particulate Matter emissions (daily averages) for the month of August 2020 against emission limit for Unit 6

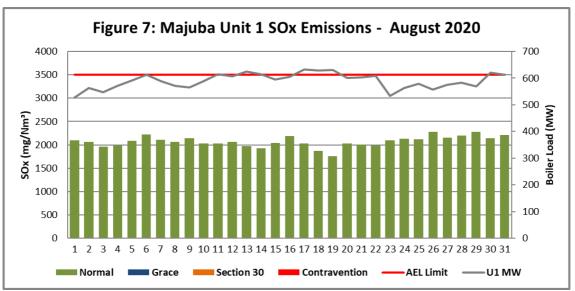


Figure 7. SOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 1

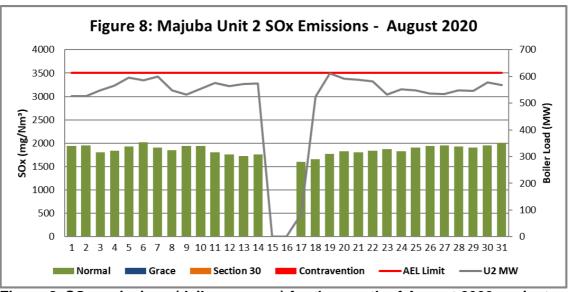


Figure 8. SOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 2

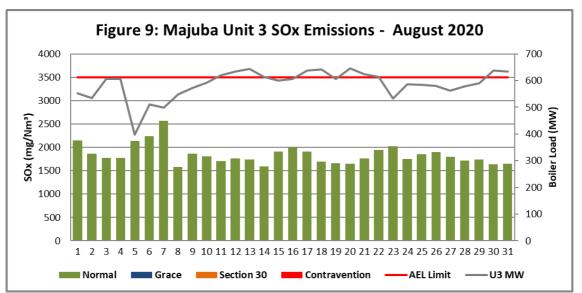


Figure 9. SOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 3

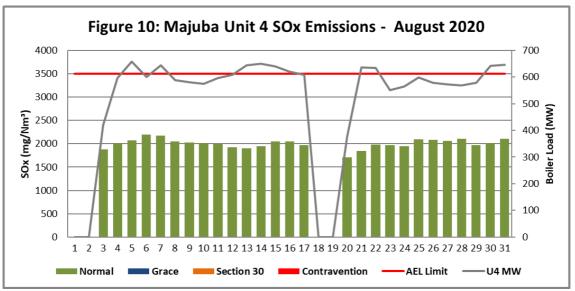


Figure 10. SOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 4

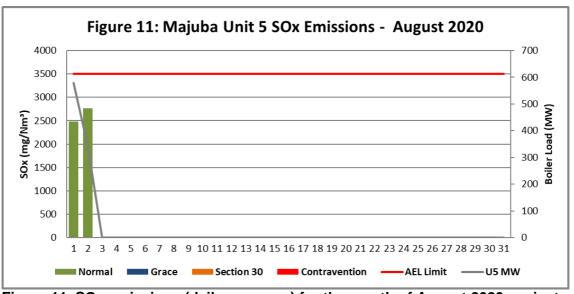


Figure 11. SOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 5. Unit 5 went on outage on the 3rd of August 2020

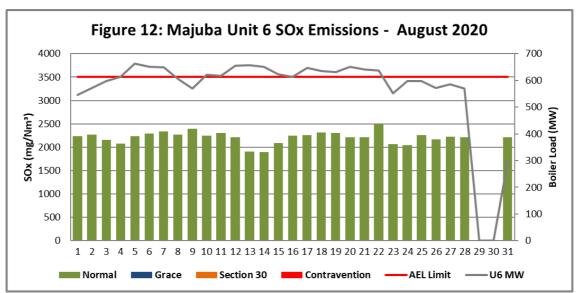


Figure 12. SOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 6

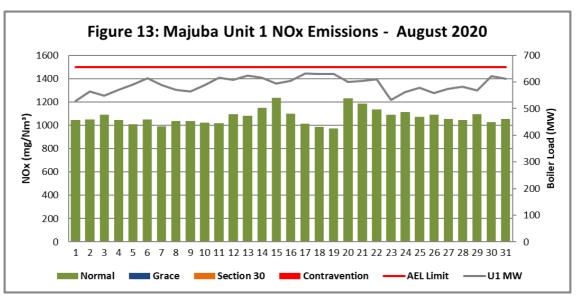


Figure 13. NOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 1.

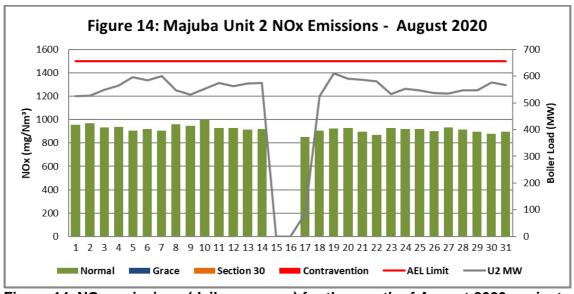


Figure 14. NOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 2

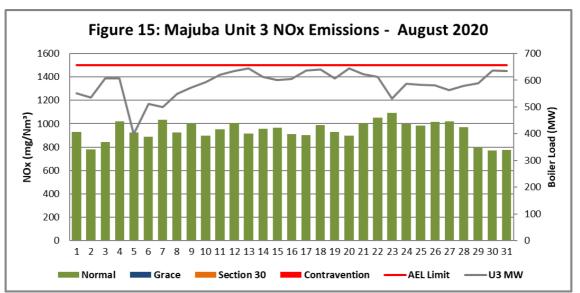


Figure 15. NOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 3.

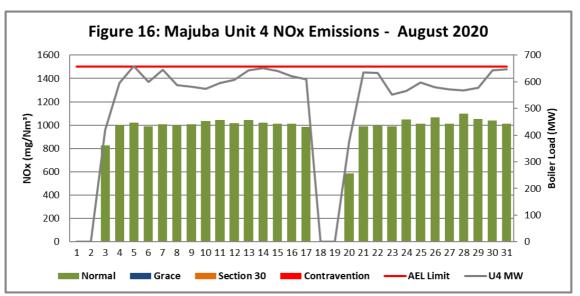


Figure 16. NOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 4

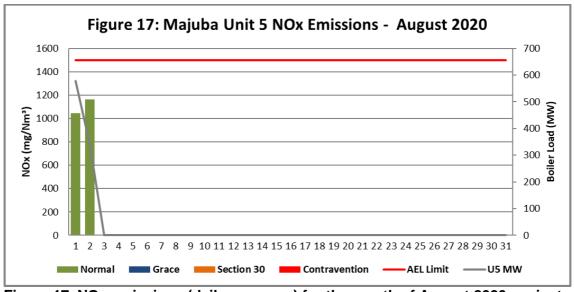


Figure 17. NOx emissions (daily averages) for the month of August 2020 against emission limit for Unit 5. Unit 5 went on outage on the 3rd of August 2020

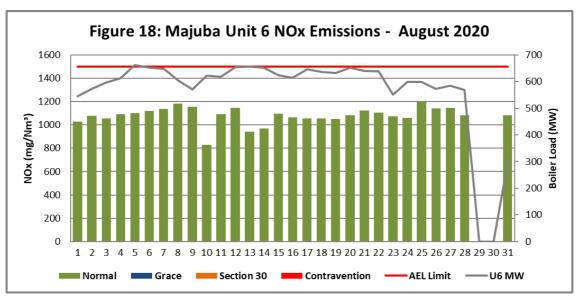


Figure 18. NOx emissions (daily averages) for the month August 2020 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of August 2020

<u> </u>								
Unit	PM (tons)	SO ₂ (tons)	NO _x (tons)					
1	44.6	4 479	2 317					
2	36.7	3 035	1 498					
3	51.7	3 507	1 812					
4	36.5	4 117	2 069					
5	1.4	194	82					
6	13.2	5 081	2 481					
Sum	184.1	20 413	10 259					

Table 5: Average monthly concentrations (mg/Nm³) for the month of August 2020

Unit	PM (Mg/Nm³)	SO ₂ (Mg/Nm ³)	NO ₂ (Mg/Nm ³)
1	20.6	2 072.1	1 071.1
2	23.8	1 861.4	920.3
3	29.0	1 844.0	940.1
4	19.3	2 005.9	997.1
5	17.6	2 622.3	1 104.7
6	5.8	2 211.3	1 080.2

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits (SO_x , NO_x and PM)

Associated Unit/Stack	Normal	Normal Grace Section Contravention		Contravention	Total Exceedance
Unit 1	31	0	0	0	0
Unit 2	28	0	0	0	0
Unit 3	30	0	0	0	0
Unit 4	25	0	0	0	0
Unit 5	2	0	0	0	0
Unit 6	28	0	0	0	0

CO₂ and O₂ Relationship

Calculation: $CO_2\% + O_2\% = 19.5-21.5\%$

		Final	Averaç	ge CO	2 (%)			Final	Avera	age O	2 (%)		Fina	al Ave	erage	CO ₂	+ O ₂	(%)
Date	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
01-Aug	10.1	10.3	11.0		10.3	11.7	9.8	10.9	10.3		9.5	8.6	19.8	21.1	21.2		19.8	20.2
02-Aug	10.6	10.2			9.2	12.0	9.1	11.0	8.5		10.8	8.2	19.6	21.2			20.0	20.2
03-Aug	10.4	10.4	11.7			12.1	9.3	10.6	9.1	9.7		8.1	19.7	21.0	20.8			20.2
04-Aug	10.7	10.6	11.5	10.8		12.3	8.8	10.3	9.5	8.9		7.8	19.5	20.9	21.0	19.7		20.1
05-Aug	11.0	11.2	9.2	11.2		12.9	8.7	9.5	12.9	8.7		7.4	19.7	20.7	22.1	19.9		20.2
06-Aug	11.3	11.1	10.3	10.9		12.8	8.4	9.7	11.1	8.9		7.4	19.7	20.8	21.5	19.8		20.3
07-Aug	11.1	11.2	10.2	11.1		12.9	8.8	9.5	11.3	8.7		7.6	19.9	20.7	21.5	19.8		20.5
08-Aug	10.8	10.7	10.8	10.9		12.4	9.1	10.3	10.1	8.9		8.0	19.9	21.0	20.9	19.8		20.4
09-Aug	10.6	10.5	11.0	10.7		12.1	9.2	10.5	10.0	9.2		8.2	19.8	21.0	21.0	19.9		20.3
10-Aug	10.8	10.4	11.2	10.5		12.3	8.8	10.7	9.8	9.5		7.9	19.6	21.1	21.0	20.0		20.2
11-Aug	11.3	10.9	11.6	10.9		12.5	8.2	9.9	9.4	9.0		7.7	19.5	20.8	21.0	19.9		20.3
12-Aug	10.9	10.7	11.6	11.2		12.8	8.6	10.1	9.4	8.7		7.4	19.5	20.8	20.9	19.9		20.2
13-Aug	11.2	10.8	11.6	11.4		12.8	8.4	9.9	9.1	8.6		7.3	19.5	20.7	20.7	19.9		20.1
14-Aug	11.2	10.8	11.5	11.3		12.8	8.5	9.9	9.1	8.5		7.4	19.7	20.7	20.7	19.8		20.2
15-Aug	11.0		11.7	11.4		12.6	8.7		9.1	8.4		7.6	19.8		20.8	19.8		20.3
16-Aug	11.1		11.3	11.1		12.4	8.6		10.0	8.7		7.7	19.7		21.2	19.8		20.1
17-Aug	11.5		11.9	11.0		12.8	8.3	14.1	9.0	8.8		7.5	19.8		20.9	19.8		20.3
18-Aug	11.4	10.0	11.9			12.7	8.3	9.9	9.0			7.7	19.7	19.9	20.9			20.4
19-Aug	11.3	11.0	11.6			12.6	8.4	9.6	8.9			7.8	19.6	20.6	20.5			20.4
20-Aug	11.1	11.0	12.1			12.9	8.7	9.7	8.3	10.2		7.6	19.8	20.7	20.3			20.5
21-Aug	11.5	11.1	11.7	11.1		12.8	8.6	9.5	9.5	8.6		7.8	20.1	20.7	21.2	19.7		20.5
22-Aug	11.7	11.1	11.6	11.1		12.7	8.2	9.6	9.4	8.6		7.8	19.9	20.7	21.0	19.7		20.5
23-Aug	10.6	10.5	10.4	10.1		11.4	9.2	10.6	10.7	9.8		9.0	19.8	21.0	21.2	19.9		20.4
24-Aug	10.6	10.7	11.1	10.2		12.2	9.2	10.2	10.3	9.7		8.1	19.8	20.9	21.4	20.0		20.3
25-Aug	10.9	10.6	11.2	11.0		12.3	8.8	10.3	10.0	9.1		8.0	19.7	20.9	21.2	20.2		20.4
26-Aug	10.8	10.5	11.4	10.6		12.0	9.0	10.4	10.0	9.6		8.4	19.8	20.9	21.4	20.2		20.3
27-Aug	11.0	10.4	11.0	10.7		12.3	9.0	10.5	10.7	9.1		8.1	20.0	21.0	21.7	19.8		20.4
28-Aug	11.1	10.4	11.2	10.9		12.3	8.7	10.7	10.1	9.2		8.1	19.8	21.1	21.3	20.1		20.4
29-Aug	10.5	10.4	11.3	10.8			9.2	10.7	9.7	9.2			19.7	21.1	21.0	20.0		
30-Aug	11.5	10.7	12.1	11.4			8.4	10.2	9.1	8.5			20.0	20.9	21.2	19.9		
31-Aug	11.4	10.6	12.2	11.4			8.6	10.4	9.2	8.4		10.7	20.0	21.1	21.3	19.8		
Totals	11.0	10.7	11.3	11.0	9.8	12.4	8.8	10.3	9.8	9.0	10.1	8.0	19.8	20.9	21.1	19.9	19.9	20.3

Table 7: CO_2 and O_2 deviations of the Month of August 2020 *Blank spaces indicate that the unit was offline during that period

Comments on the performance and availability of each unit

Emergency Generation

Table 8: Emergency Generation for the month of August 2020

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

Comments on the performance and availability of each unit

UNIT 1

The unit base loaded for the entire month. Two fabric filter bags were replaced during the month.

UNIT 2

The unit base loaded for most of the days of the month and was off for two days. Forty fabric filter bags were replaced during the month.

UNIT 3

The unit base loaded for the entire month. Sixty fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for most days of the month and was off for four days. No fabric filter bags were replaced during the month.

UNIT 5

The unit was on Outage for almost all of the days of the month. No fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for most days of the month and was off for two days. Five fabric filter bags were replaced during the month.

Complaints Register

Table 9: Complaints for the month of August 2020

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received in the month of August 2020				

General

Additional information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Report compiled by:

Faith Kagoda Date 11/02/2021

ENVIRONMENTAL MANAGER: (MAJUBA)

Report verified by:

Lindani Madonsela Date 16/02/2021

BOILER ENGINEERING MANAGER: (MAJUBA)

Hoping the above will meet your satisfaction

Yours sincerely

Bawinile Malope 2021/02/22

Bawinile Malope
ENGINEERING MANAGER: (MAJUBA)