

Mr Dan Hlanyane
 Senior Manager Municipal Health & Environmental Services
 Gert Sibande District Municipality
 PO BOX 3016
 ERMELO
 2350

Date: 11 March 2021

Enquiries: Mrs B Malope
 Tel +27 17 799 8815

Dear Mr. Hlanyane

MAJUBA POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF FEBRUARY 2021

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of February 2021. Verified emissions of particulates are included. SO₂ and NO_x (as NO₂) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting.

Raw Materials and Products

Table 1. Quantity of Raw Materials and Products used/produced for the month of February 2021

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of February 2021
	Coal	Tons/month	1 800 000	990 500
	Fuel Oil	Tons/month	6 000	4 758
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity - MW)	Production Rate in Month of February 2021
	Energy	GWh	4 110	1 803
	Ash	Tons/month	Not stated in the license	279 321

Abatement Technology

Table 2. Abatement Equipment Control Technology for the month of February 2021

Associated Unit	Technology Type	Actual Utilisation (%) for the month of February 2021	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.94%
Unit 2	Fabric Filter Plant	100	99.97%
Unit 3	Fabric Filter Plant	100	99.90%
Unit 4	Fabric Filter Plant	100	99.96%

Unit 5	Fabric Filter Plant	100	99.93%
Unit 6	Fabric Filter Plant	100	99.98%

*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal. Unit 2 was returned to service on 30 February 2021 after being on outage. The unit did not achieve full load during this period.

Energy Source Characteristics

Table 3. Energy Source Material Characteristics for the month of February 2021

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.6 to >0.94%	0.7%
Ash Content	28 to >30%	28.2%

Emissions Reporting

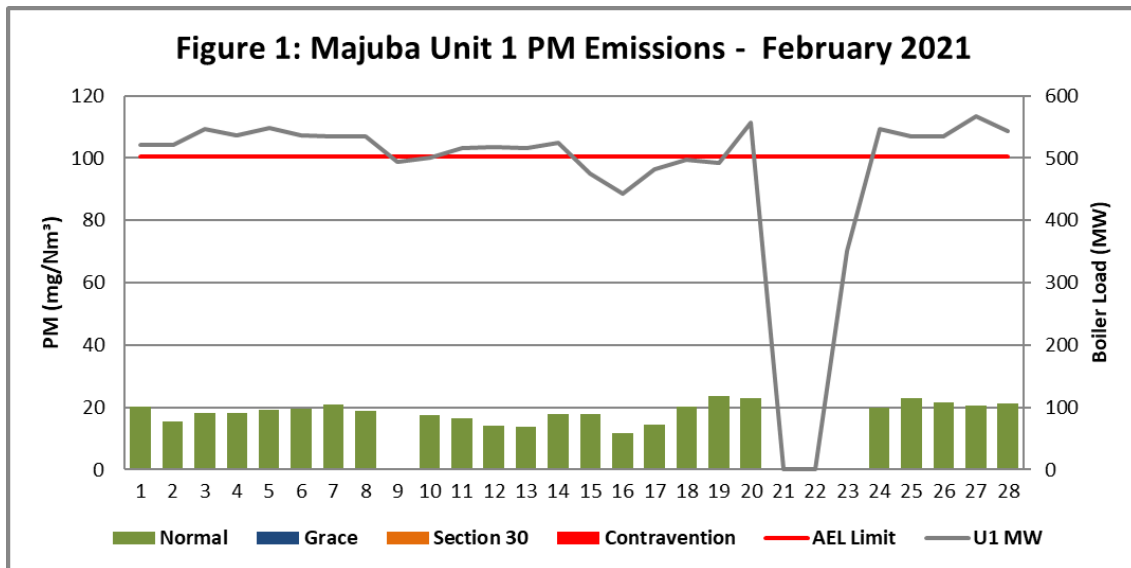


Figure 1. Particulate Matter emissions (daily averages) for the month of February 2021 against emission limit for Unit 1.

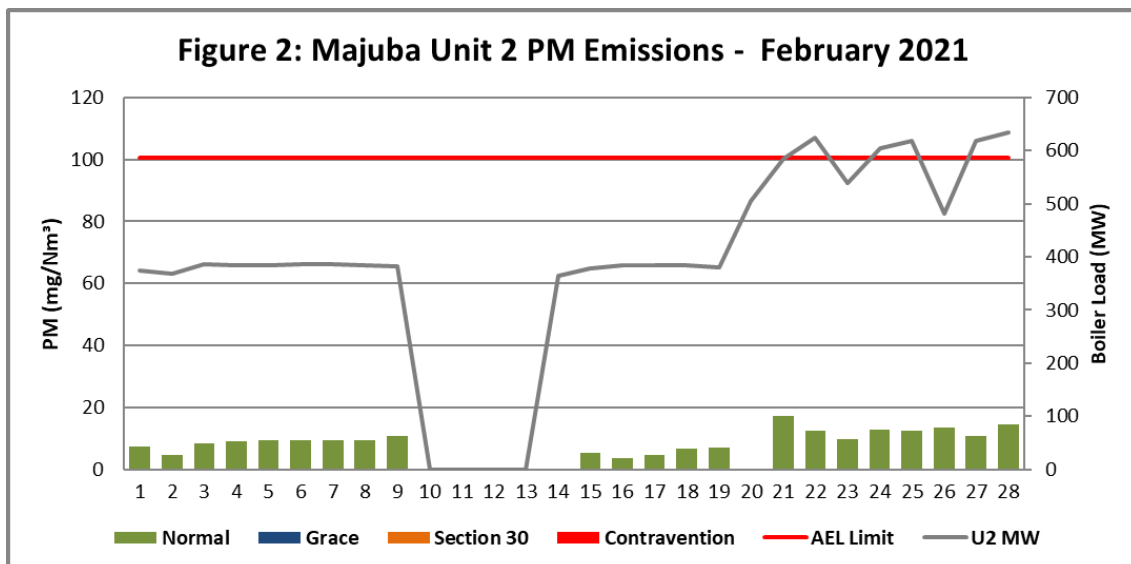


Figure 2. Particulate Matter emissions (daily averages) for the month of February 2021 against emission limit for Unit 2.

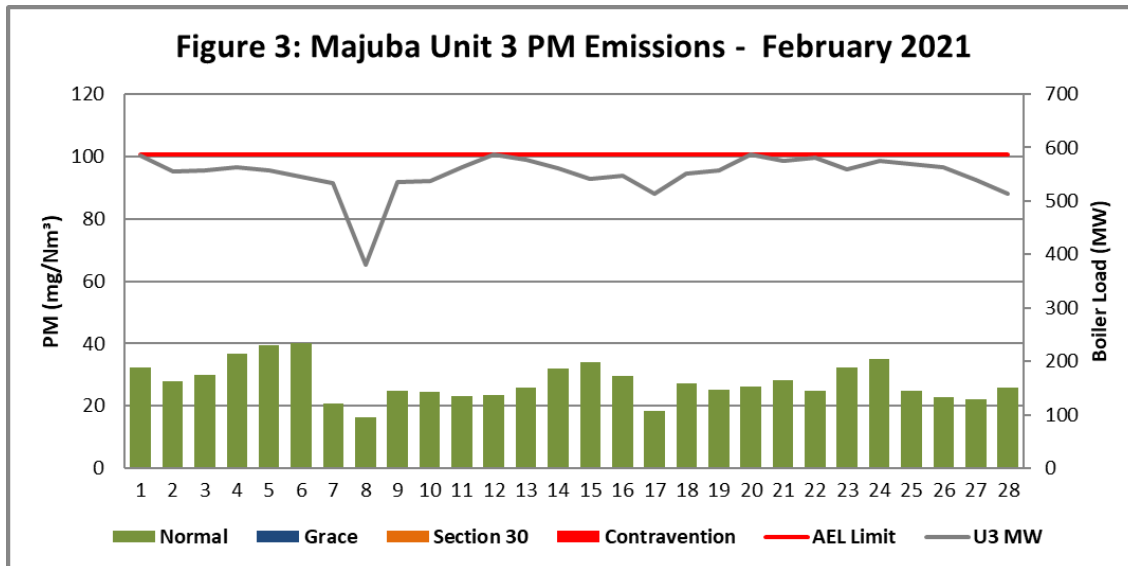


Figure 3. Particulate Matter emissions (daily averages) for the month of February 2021 against emission limit for Unit 3.

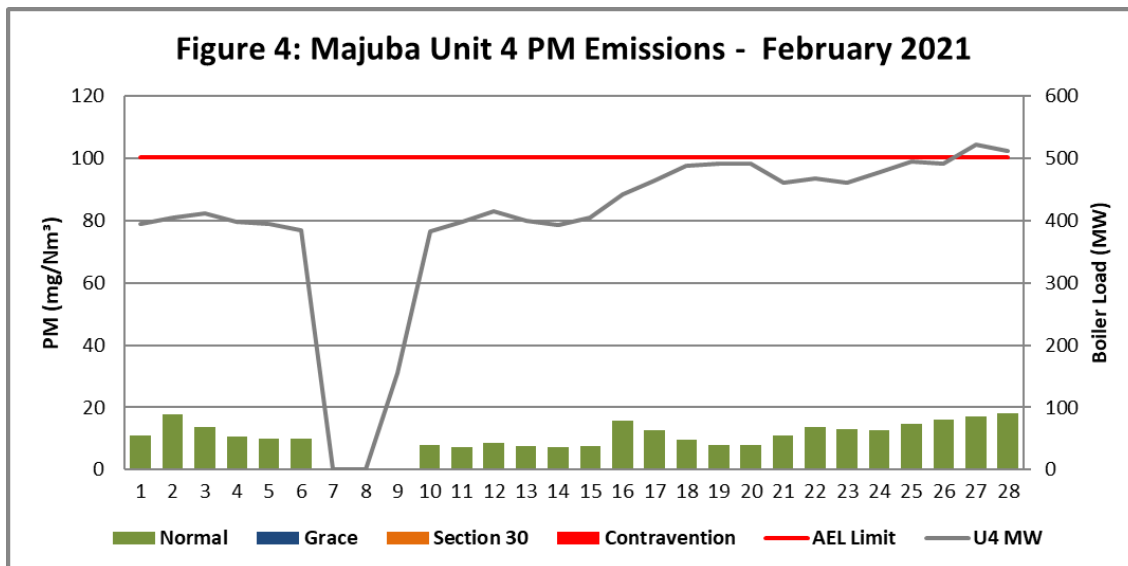


Figure 4. Particulate Matter emissions (daily averages) for the month of February 2021 against emission limit for Unit 4.

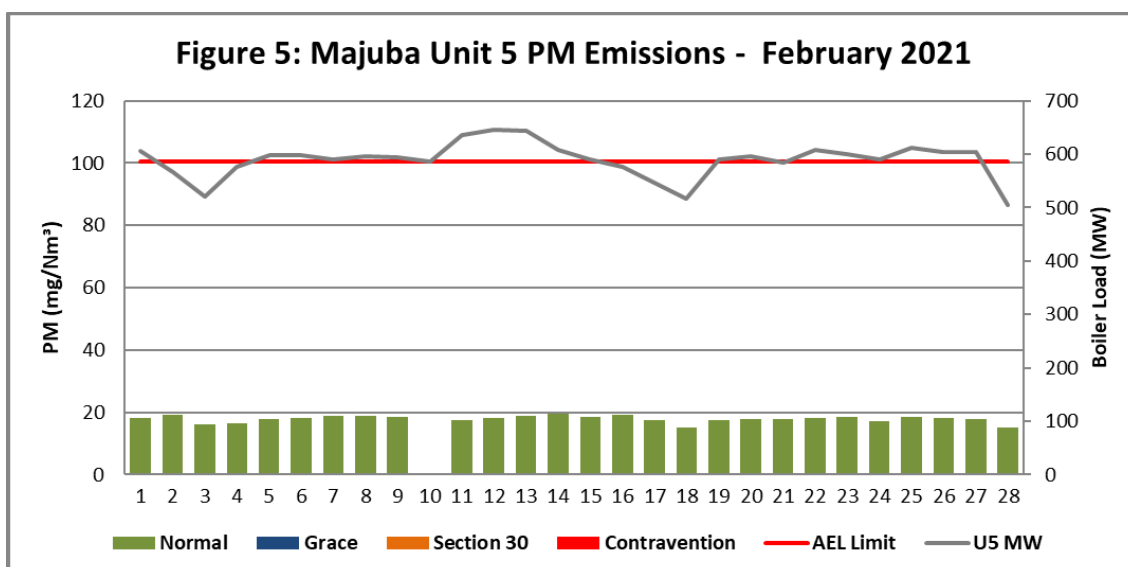


Figure 5. Particulate Matter emissions (daily averages) for the month of February 2021 against emission limit for Unit 5.

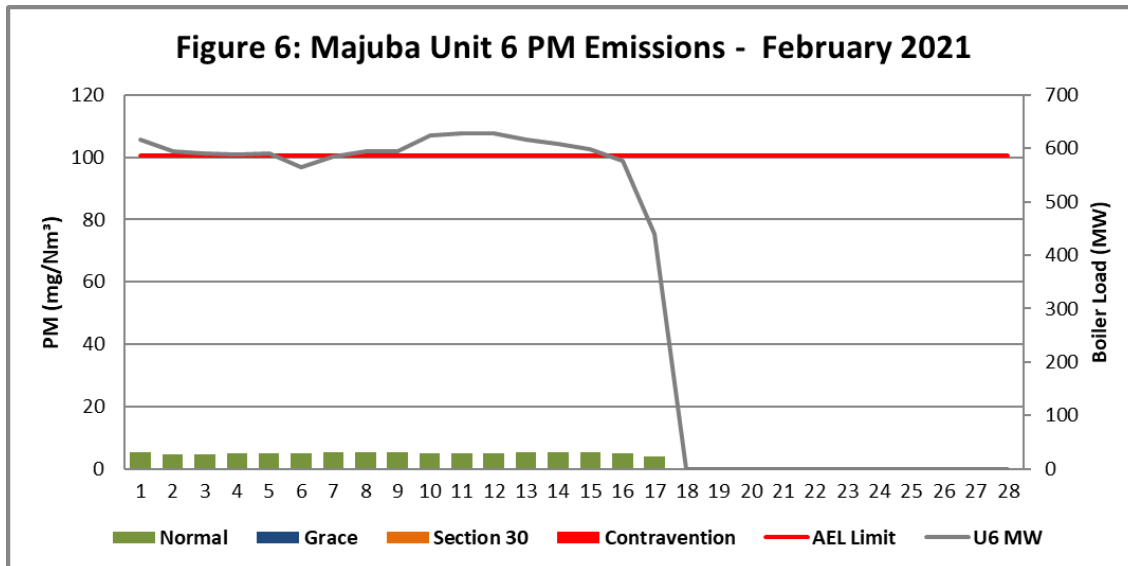


Figure 6. Particulate Matter emissions (daily averages) for the month of February 2021 against emission limit for Unit 6.

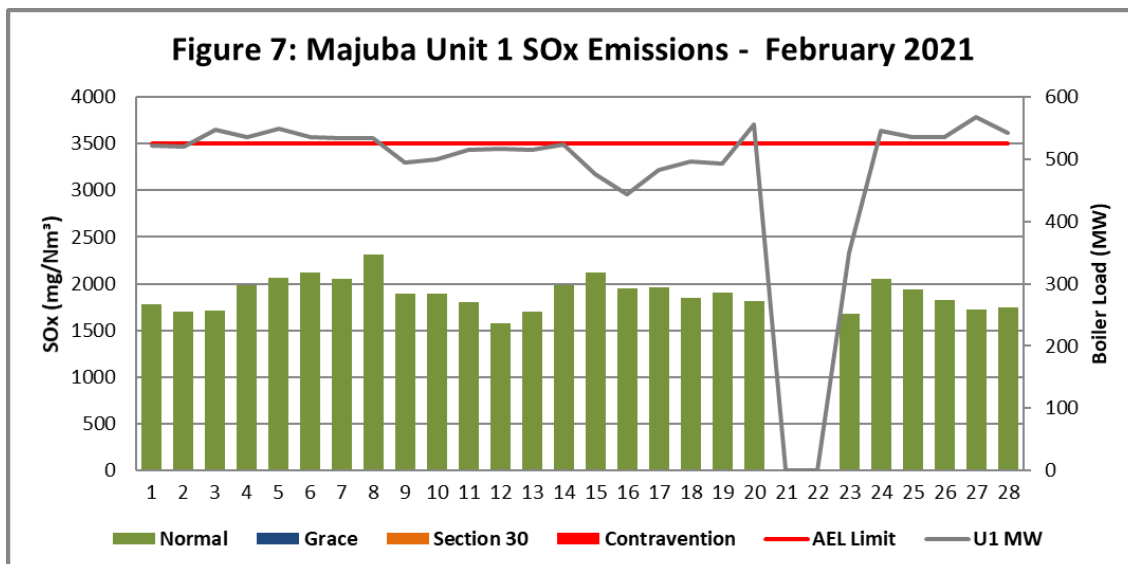


Figure 7. SOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 1.

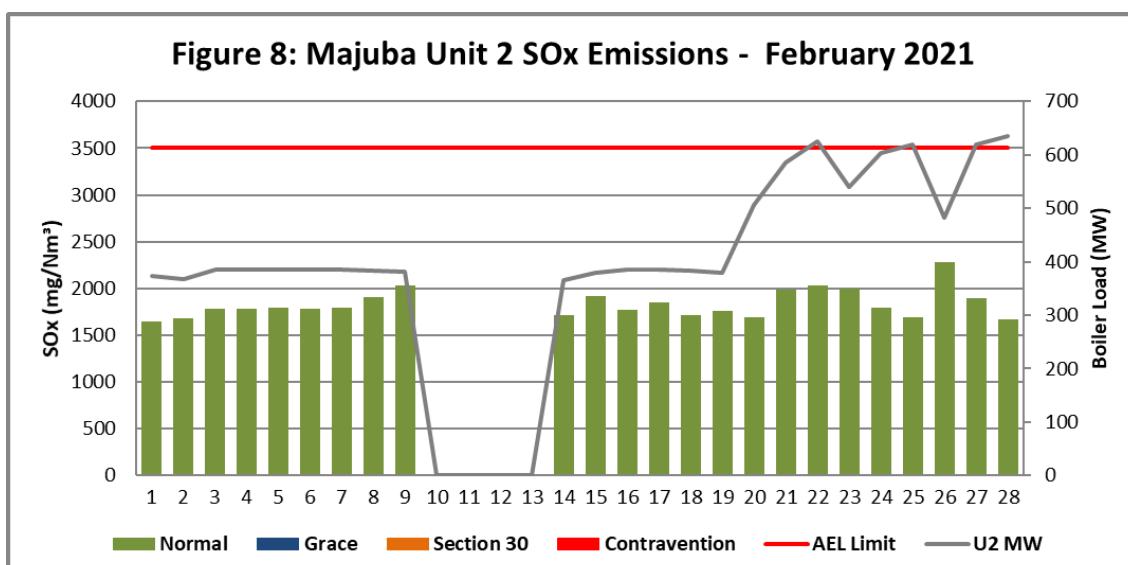


Figure 8. SOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 2.

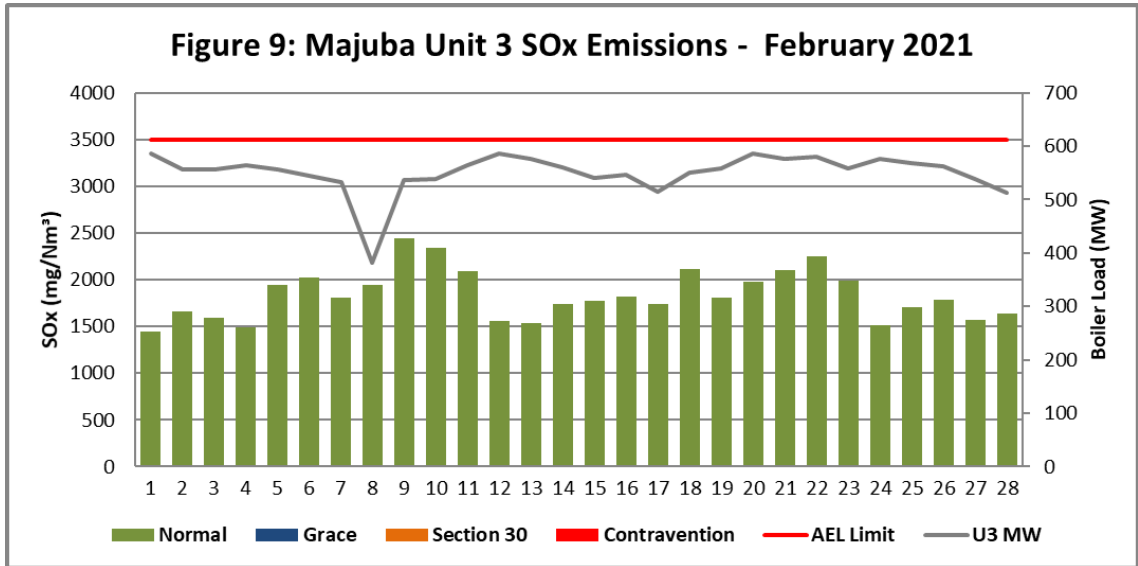


Figure 9. SOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 3.

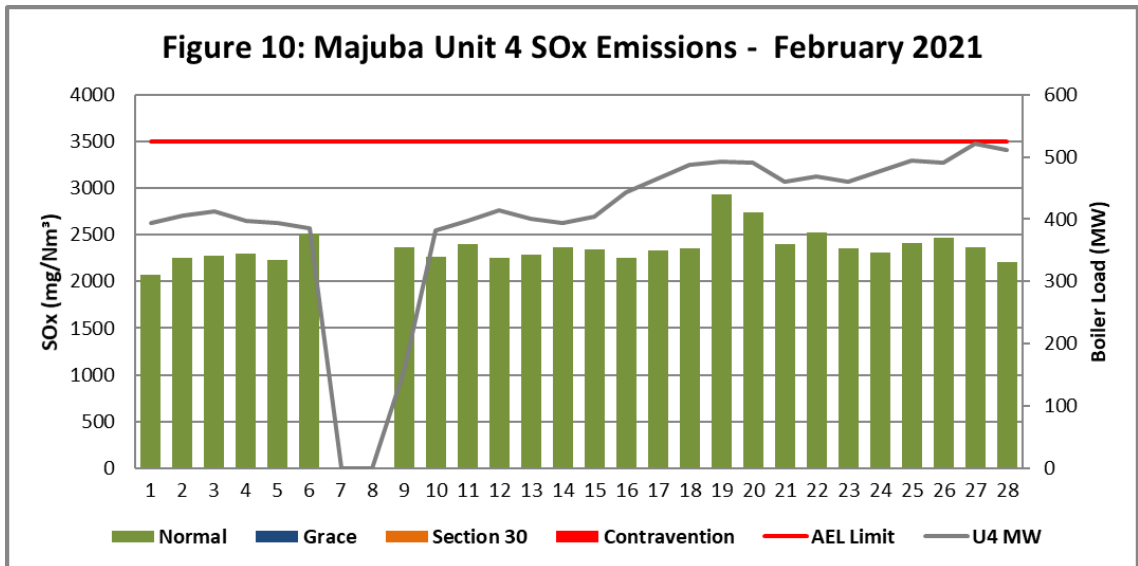


Figure 10. SOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 4.

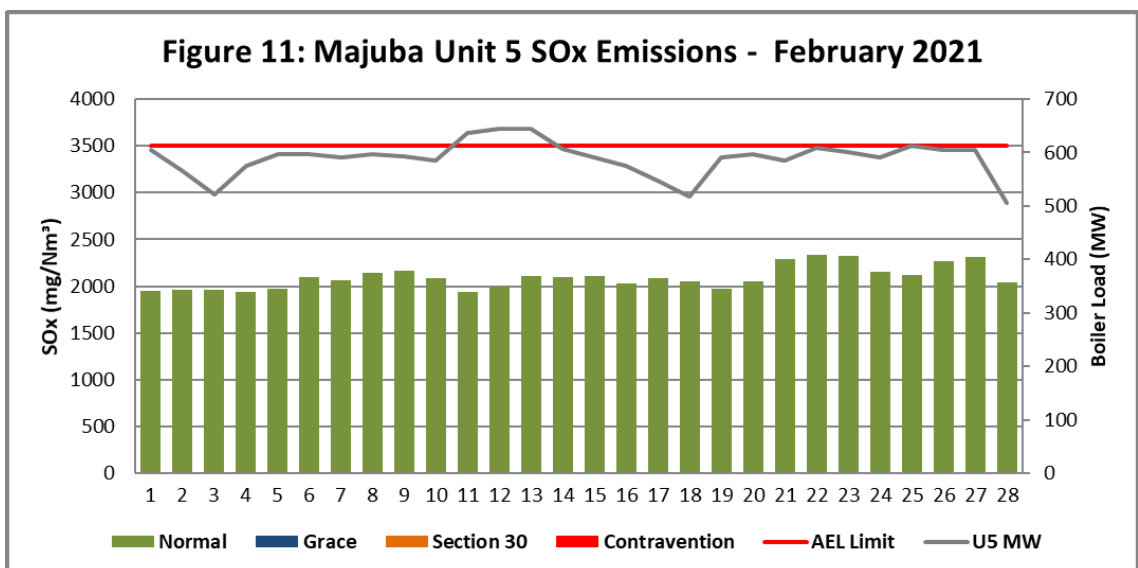


Figure 11. SOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 5.

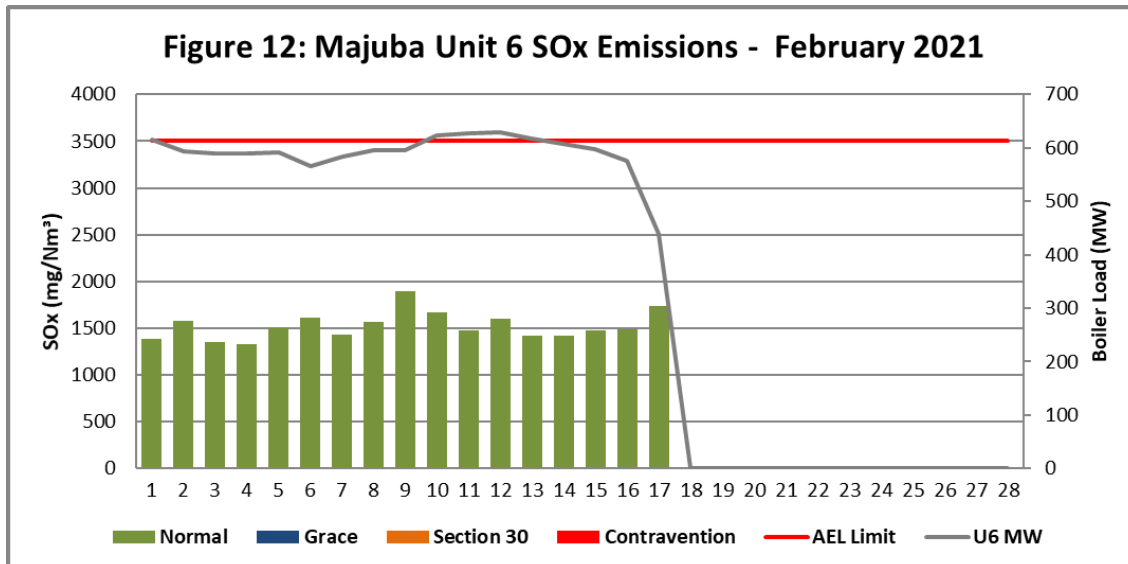


Figure 12. SOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 6.

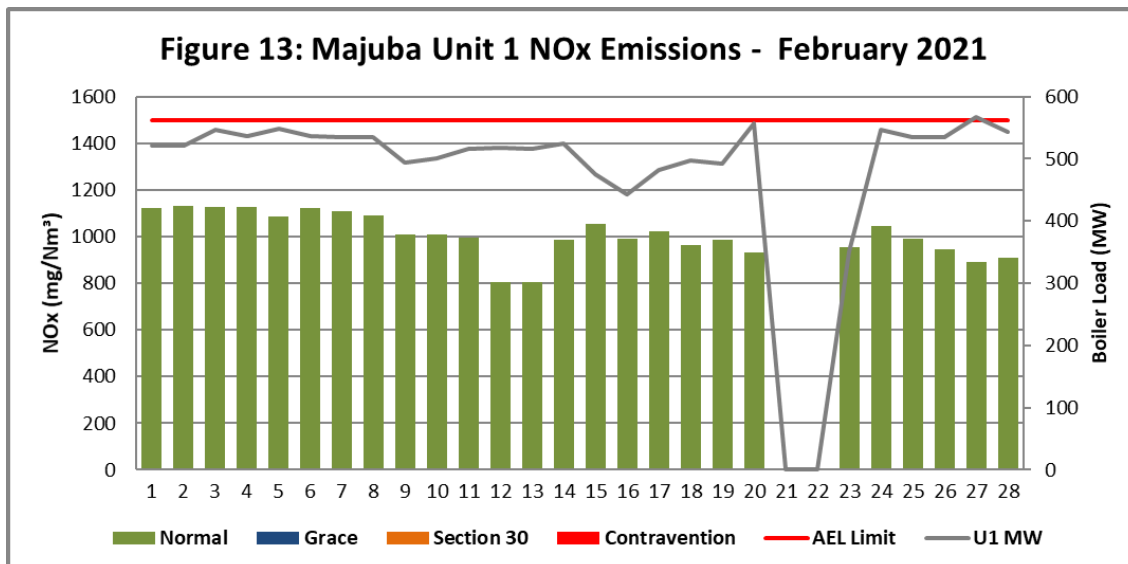


Figure 13. NOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 1.

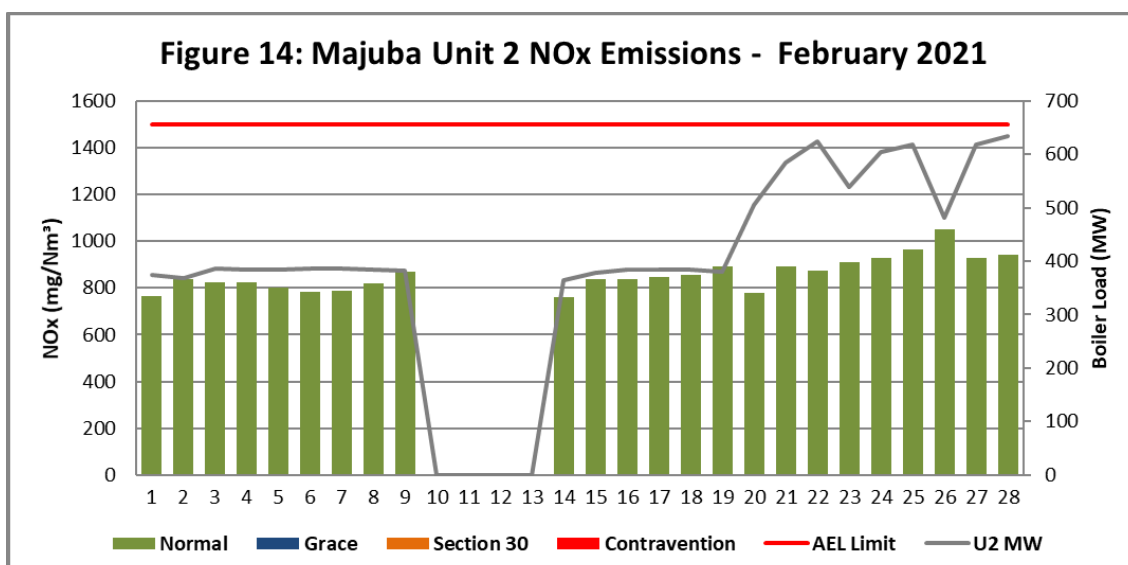


Figure 14. NOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 2.

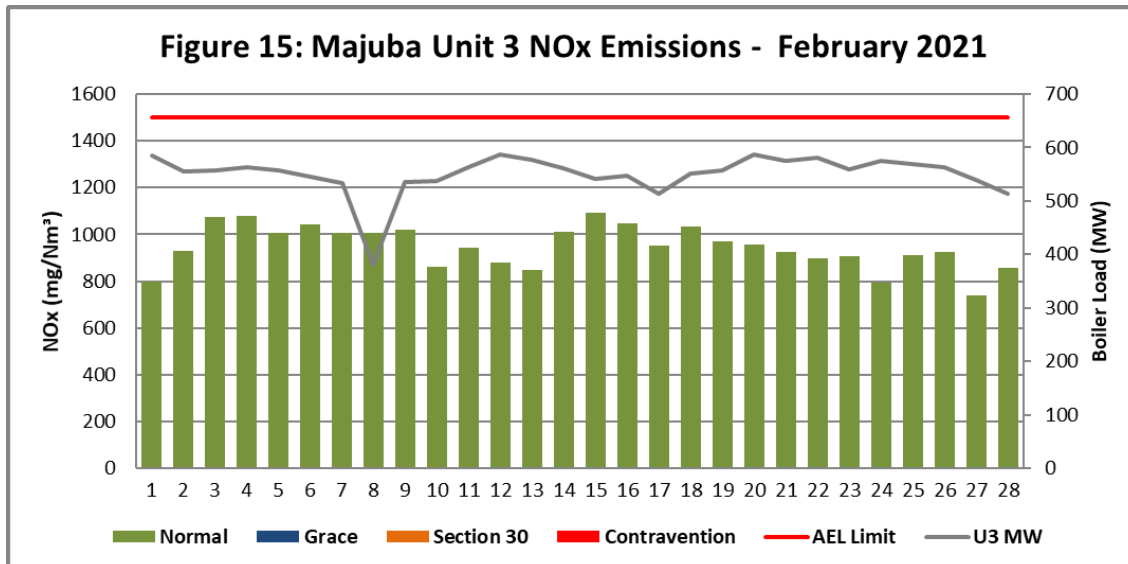


Figure 15. NOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 3.

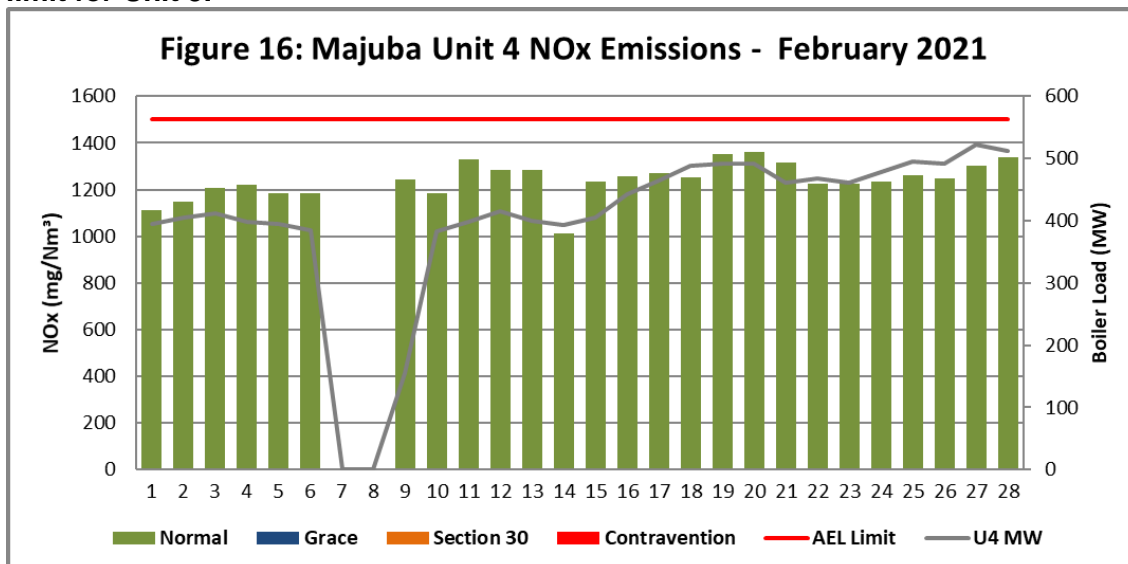


Figure 16. NOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 4

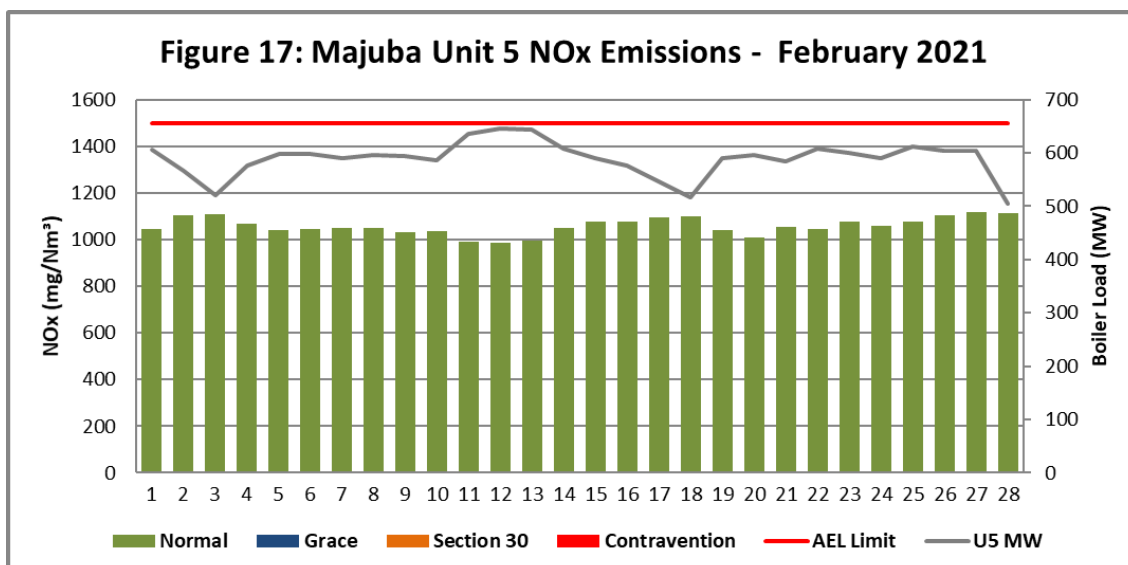


Figure 17. NOx emissions (daily averages) for the month of February 2021 against emission limit for Unit 5

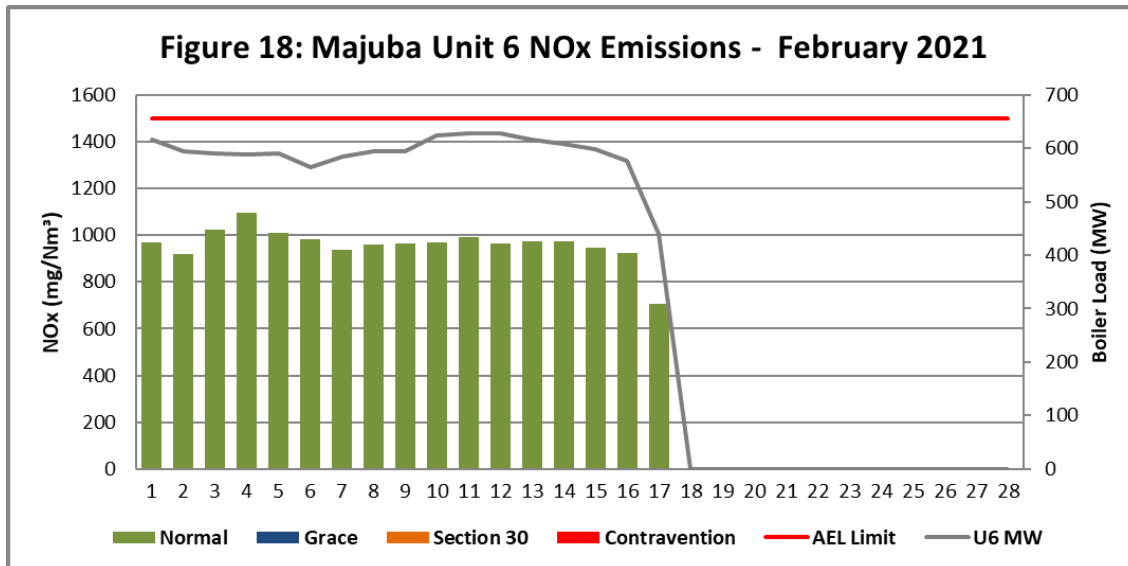


Figure 18. NOx emissions (daily averages) for the month February 2021 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of February 2021

Unit	PM (tons)	SO ₂ (tons)	NO _x (tons)
1	25.0	2 762	1 477
2	9.9	2 223	1 050
3	52.0	3 409	1 763
4	14.7	3 187	1 671
5	37.3	4 511	2 278
6	6.6	1 955	1 258
Sum	145.5	18 047	9 497

Table 5: Average monthly concentrations (mg/Nm³) for the month of February 2021

Unit	PM (Mg/Nm ³)	SO ₂ (Mg/Nm ³)	NO ₂ (Mg/Nm ³)
1	18.7	1 888.9	1 007.6
2	9.5	1 831.6	858.9
3	27.6	1 835.4	947.4
4	11.6	2 367.0	1 241.0
5	17.9	2 093.3	1 058.5
6	5.1	1 527.0	959.5

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits (SO_x, NO_x and PM)

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	24	0	0	0	0
Unit 2	22	0	0	0	0
Unit 3	28	0	0	0	0
Unit 4	25	0	0	0	0
Unit 5	27	0	0	0	0
Unit 6	17	0	0	0	0

CO₂ and O₂ Relationship

Date	Final Average CO ₂ (%)						Final Average O ₂ (%)						Final Average CO ₂ + O ₂ (%)					
	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
29-Jan	10.9		11.3	9.4	11.7	12.3	9.3		9.1	12.3	7.9	8.4	20.2		20.5	21.7	19.6	20.7
30-Jan	10.6		11.8	9.6	11.3	12.1	9.7		9.5	12.7	8.5	8.5	20.3		21.3	22.3	19.8	20.7
31-Jan	10.1	7.9	11.7	9.6	11.1	12.3	10.3	12.7	9.9	13.0	8.8	8.2	20.4	20.6	21.6	22.7	19.9	20.5
01-Feb	10.0	8.5	11.9	9.6	11.1	12.2	10.4	12.1	8.7	12.7	8.9	8.3	20.4	20.5	20.7	22.2	20.0	20.5
02-Feb	10.0	8.4	11.3	9.4	10.2	12.0	10.4	12.6	10.5	12.8	9.9	8.6	20.4	20.9	21.8	22.2	20.2	20.6
03-Feb	10.1	8.0	11.0	9.5	10.0	11.9	10.3	13.3	10.6	12.7	10.2	8.7	20.4	21.3	21.7	22.3	20.2	20.6
04-Feb	10.1	8.1	11.0	9.6	10.4	12.0	10.3	13.0	9.4	12.7	9.7	8.5	20.4	21.1	20.3	22.3	20.1	20.5
05-Feb	10.3	8.1	11.0	9.6	10.9	12.0	9.9	12.9	9.1	12.6	9.1	8.5	20.3	21.0	20.1	22.2	20.0	20.5
06-Feb	10.0	8.3	10.7	9.6	10.7	11.6	10.3	12.5	9.7	12.9	9.2	8.9	20.4	20.9	20.4	22.5	19.9	20.5
07-Feb	10.1	8.6	10.7		10.8	11.8	10.3	12.2	10.2		9.2	8.8	20.3	20.8	20.8		20.0	20.6
08-Feb	10.1	8.7	9.2		11.0	12.1	10.2	12.2	11.7		9.0	8.4	20.4	20.9	20.9		20.0	20.5
09-Feb	9.5	8.5	10.8	8.8	11.0	12.2	10.6	12.6	11.2	13.1	9.0	8.4	20.2	21.0	21.9	21.8	20.0	20.6
10-Feb	9.5		10.6	9.4	10.7	12.2	11.2		10.1	12.6	9.3	8.3	20.7		20.7	21.9	20.0	20.5
11-Feb	9.9		11.2	9.5	11.3	12.1	10.9		10.3	13.5	8.5	8.4	20.8		21.4	23.0	19.8	20.5
12-Feb			11.6	9.5	11.4	12.2	10.8		8.9	13.3	8.4	8.4	10.8		20.6	22.9	19.8	20.5
13-Feb			11.7	9.6	11.4	12.1	10.6		8.6	13.4	8.2	8.4	10.6		20.3	23.0	19.7	20.5
14-Feb		8.9	11.3	9.4	10.9	12.1	10.1	11.1	9.7	12.6	9.1	8.4	10.1	19.9	21.0	22.0	20.0	20.5
15-Feb		8.7	10.7	9.5	10.5	12.0	10.9	12.2	10.7	13.2	9.5	8.5	10.9	20.9	21.4	22.8	20.0	20.5
16-Feb	9.6	8.7	11.0	9.4	10.2	11.8	11.4	12.0	10.5	12.4	9.9	8.8	20.9	20.6	21.5	21.8	20.1	20.5
17-Feb	9.6	8.4	10.2	9.5	9.9	10.1	11.0	12.5	10.2	12.0	10.3	10.5	20.6	20.9	20.4	21.6	20.2	20.6
18-Feb	9.9	8.5	11.0	9.7	9.7		10.4	12.4	9.4	11.8	10.7		20.3	20.9	20.5	21.4	20.4	
19-Feb	9.8	8.8	11.2	9.7	10.8		10.6	11.7	10.1	12.0	9.3		20.4	20.5	21.3	21.6	20.1	
20-Feb	10.7	10.3	11.6	9.7	10.8		9.6	8.9	10.2	11.9	9.0		20.3	19.3	21.9	21.6	19.8	
21-Feb		10.8	11.5	9.6	10.6			9.4	10.3	12.5	9.6			20.2	21.8	22.1	20.2	
22-Feb		11.3	11.9	9.5	10.7			8.8	10.3	12.0	9.5			20.1	22.3	21.5	20.2	
23-Feb	8.1	10.6	11.2	9.5	10.5		12.1	10.1	9.3	11.6	9.8		20.2	20.7	20.5	21.1	20.3	
24-Feb	10.4	10.9	11.4	9.5	10.4		9.7	9.2	7.6	11.3	9.8		20.1	20.1	19.0	20.8	20.2	
25-Feb	10.0	11.0	11.3	9.6	10.4		10.1	9.4	7.8	11.3	9.8		20.2	20.4	19.1	20.9	20.2	
26-Feb	10.1	9.5	11.0	9.6	10.1		10.5	11.2	7.7	11.4	10.1		20.6	20.7	18.7	21.0	20.2	
27-Feb	10.3	11.2	10.5	9.7	10.0		9.9	9.0	8.0	11.1	10.3		20.2	20.2	18.5	20.9	20.2	
28-Feb	10.1	11.3	10.4	9.7	9.6		10.1	8.8	9.8	11.6	10.8		20.2	20.1	20.1	21.3	20.4	
Totals	9.9	9.3	11.0	9.5	10.6	11.9	10.5	11.2	9.7	12.4	9.5	8.6	20.4	20.6	20.7	21.9	20.1	20.5

Calculation: CO₂% + O₂% = 19.5-21.5%

Table 7: CO₂ and O₂ deviations of the Month of February 2021

*Blank spaces indicate that the unit was offline during that period

Emergency Generation

Table 8: Emergency Generation for the month of February 2021

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

Comments on the performance and availability of each unit

UNIT 1

The unit base loaded for most of the month and was off for two days. No fabric filter bags were replaced during the month.

UNIT 2

The unit base loaded for most of the month and was off for six days. No fabric filter bags were replaced during the month.

UNIT 3

The unit base loaded for the entire month. Sixty fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for most of the month and was off for two days. Seven fabric filter bags were replaced during the month.

UNIT 5

The unit base loaded for the entire month. No fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for most the month and was shut down for an outage on the 18th. No fabric filter bags were replaced during the month.

Complaints Register

Table 9: Complaints for the month of February 2021

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received during February 2021				


General

Additional information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Hoping the above will meet your satisfaction

Yours sincerely

Report compiled by:



Faith Kagoda
ENVIRONMENTAL MANAGER: (MAJUBA)

Date 16/04/2021

Report verified by:



Lindani Madonsela
BOILER ENGINEERING MANAGER: (MAJUBA)

Date 20/04/2021

Report approved by:


pp

Bawinile Malope
ENGINEERING MANAGER: (MAJUBA)

Date 28/04/2021