

Mr. Vusi Mahlangu
Air Quality Officer
DEDET
Private bag X11215
NELSPRUIT
1200

Date:
10 June 2021

Enquiries:
Mariam Joseph
Tel +27 13 297 9828
Fax + 27 86 661 7663

Dear Mr. Mahlangu

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021

This serves as the monthly report required in terms of Section 6 in Arnot Power Station's Atmospheric Emission License. The emissions are for the month of May 2021, Verified emissions of particulates; SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table1: Quantity of Raw Materials and Products used/produced for the Month of May 2021

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of May 2021
	Coal	Tons/month	1 050 330	511916.25
	Fuel Oil	Tons/month	10 000	2221.92
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of May 2021
	Energy	GWh	1 785 600	1002.11
	Ash	Tons/month	421 000	119 839.59

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021

Abatement Technology

Table 2 Abatement Equipment Control Technology for month of May 2021

Associated Unit/Stack	Technology Type	Actual Utilisation (%) for the month of May 2021
North Stack	Fabric Filter Bags	99.7%
South Stack	Fabric Filter Bags	99.8%

Table 2.1 Efficiency of Fabric Filter Bags for Month of May 2021

Associated Unit/Stack	Technology Type	Actual Efficiency (%) for the month of May 2021
North Stack	Fabric Filter Bags	100%
South Stack	Fabric Filter Bags	100%

Energy Source Characteristics

Table 3 Energy Source Material Characteristics for the month of May 2021

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.5 to < 1 (%)	0.677
Ash Content	17 to < 40 (%)	23.45

Table 4 Operating days in compliance to PM AEL Limit –May 2021

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average PM (mg/Nm ³)
North	31	0	0	0	0	62.9
South	31	0	0	0	0	42.1
SUM	62	0	0	0	0	

Table 5 Operating days in compliance to NOx AEL Limit – May 2021

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm ³)
North	31	0	0	0	0	709.1
South	31	0	0	0	0	634.6
SUM	62	0	0	0	0	

Table 6 Operating days in compliance to SOx AEL Limit –May 2021

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm ³)
North	31	0	0	0	0	1483.8
South	31	0	0	0	0	1232.9
SUM	62	0	0	0	0	

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021

Emissions Reporting

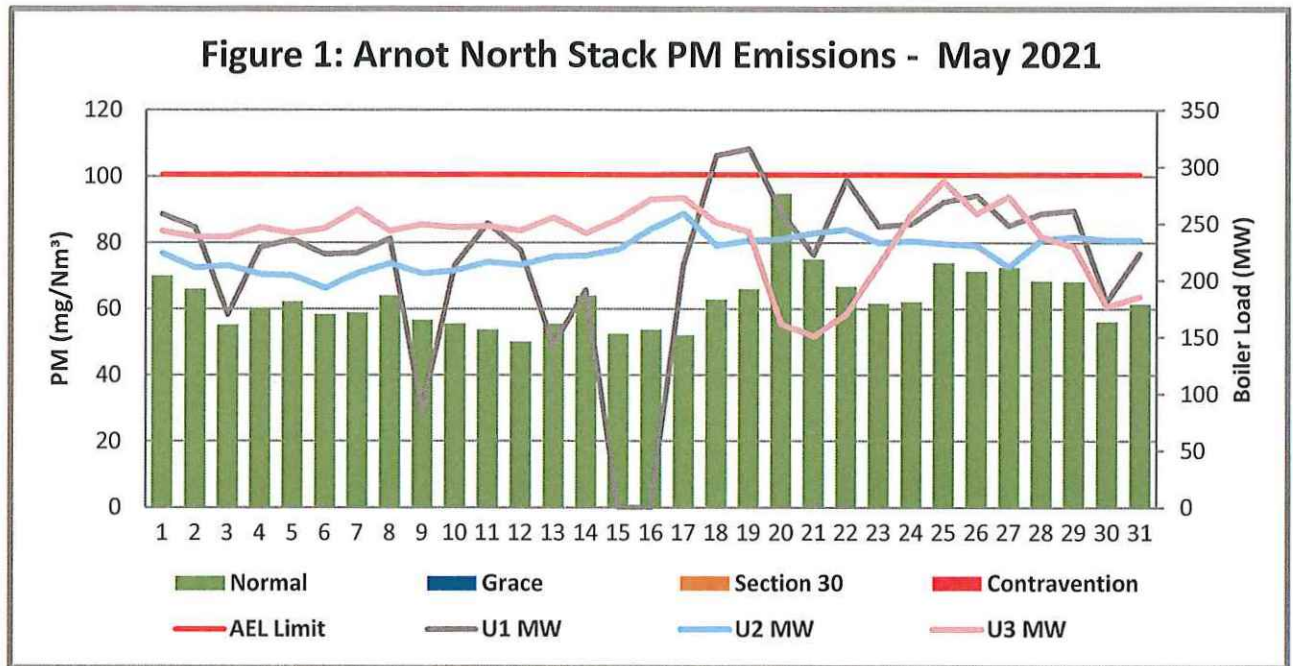


Figure 1: PM emissions (daily averages) for the month of May 2021 against emission limit for the North Stack

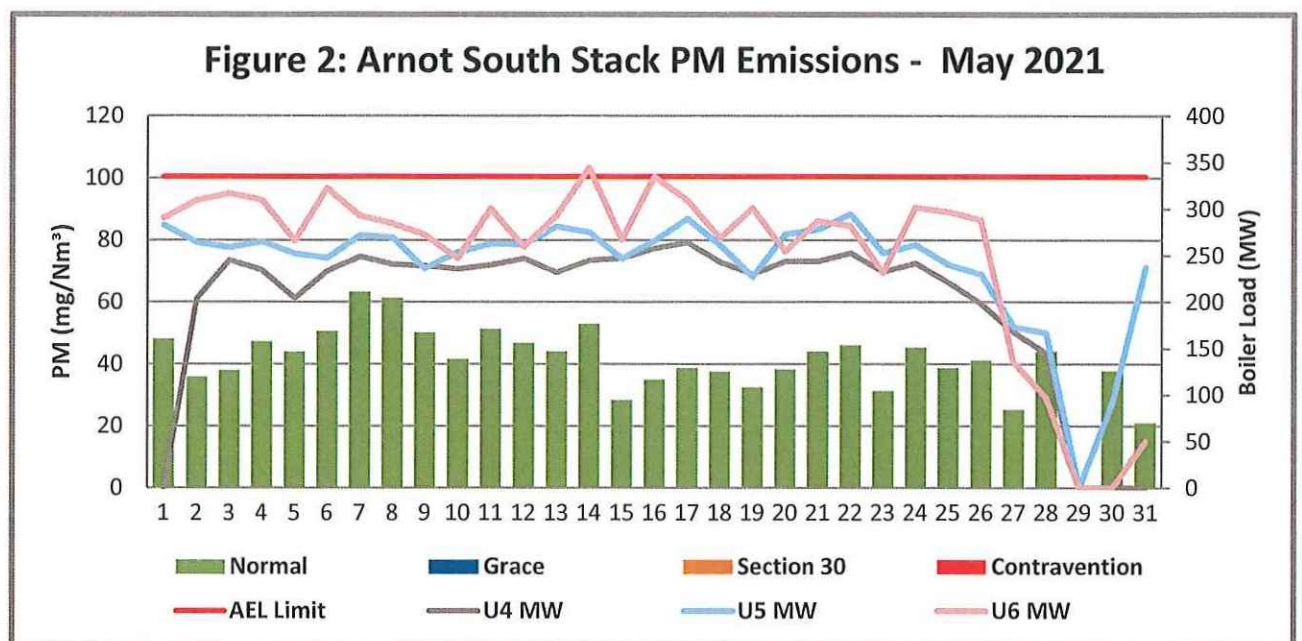


Figure 2: PM emissions (daily averages) for the month of May 2021 against emission limit for the South Stack

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021


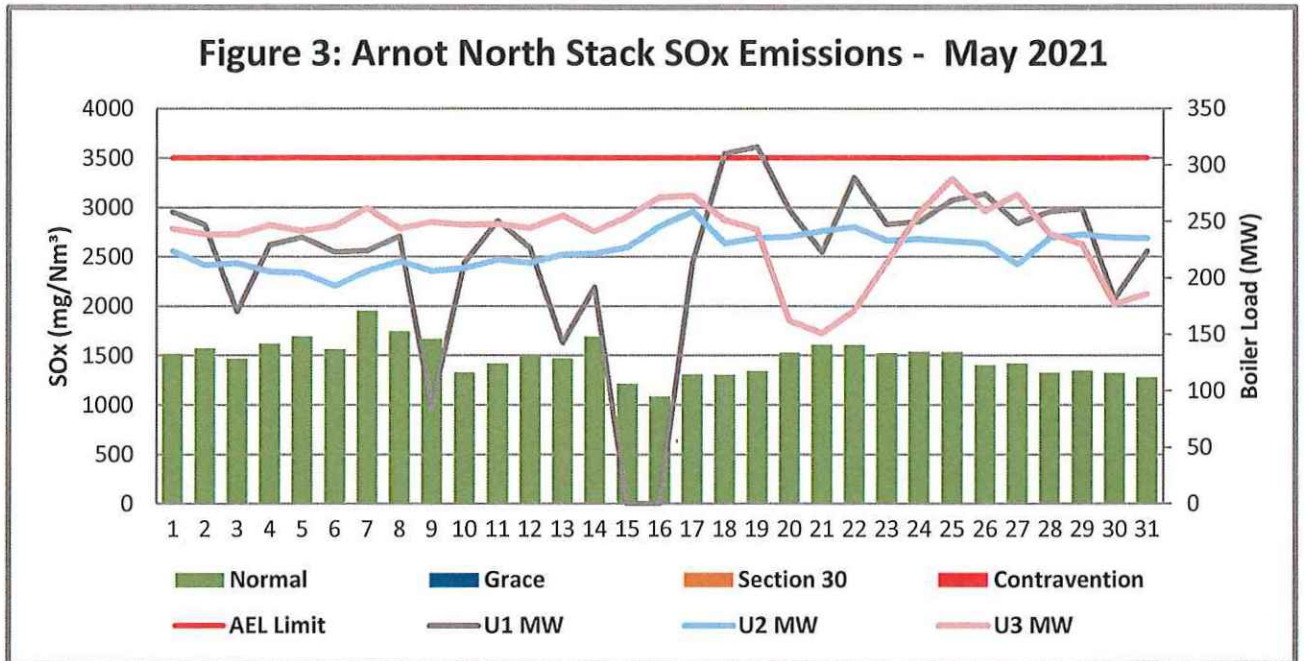


Figure 3: SO₂ emissions (daily averages) for the month of May 2021 against emission limit for the North Stack

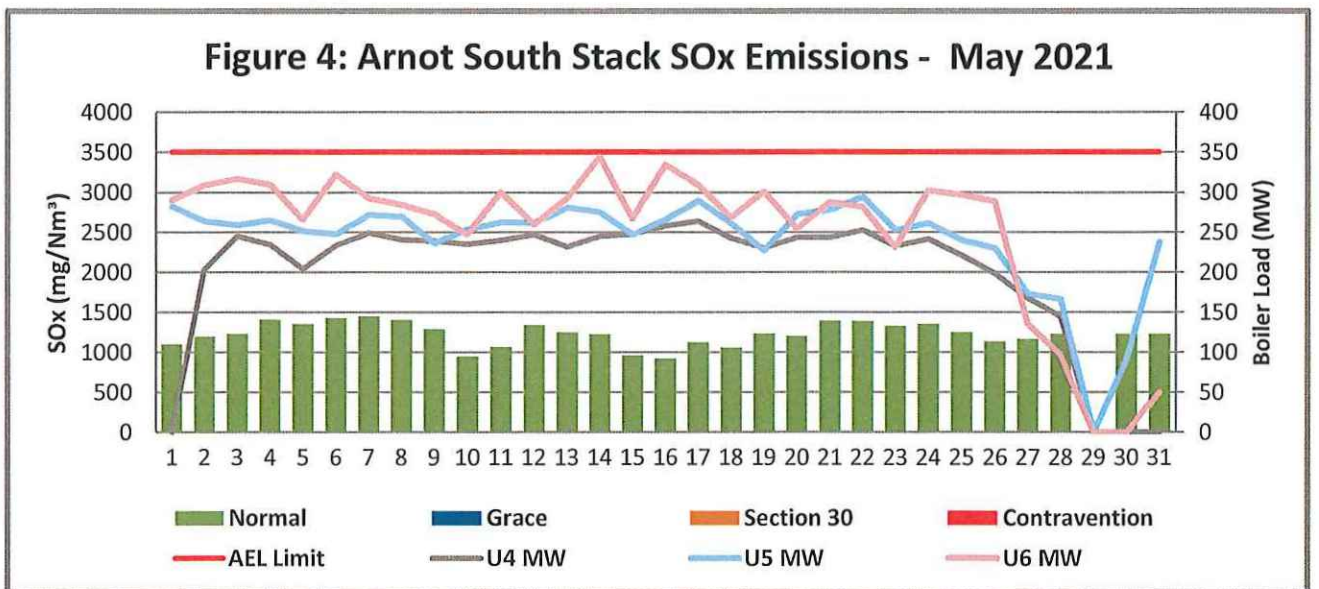

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021

Figure 4: SO₂ emissions (daily averages) for the month of May 2021 against emission limit for the South Stack

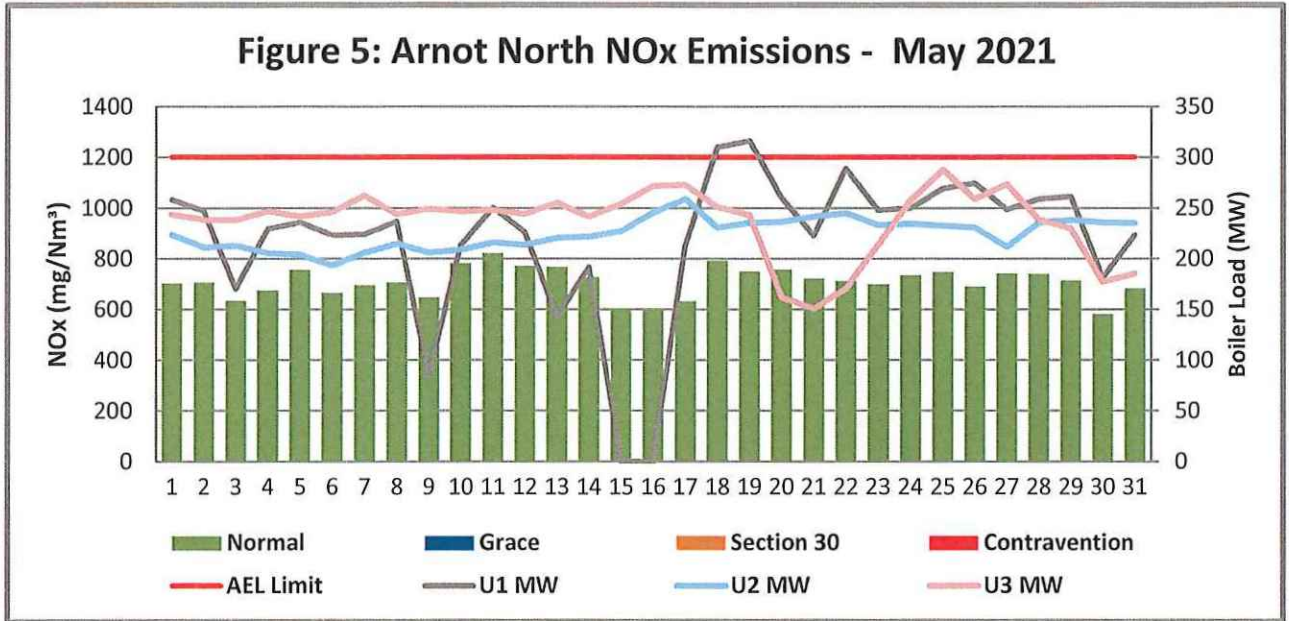


Figure 5: NO₂ emissions (daily averages) for the month of May 2021 against emission limit for the North Stack

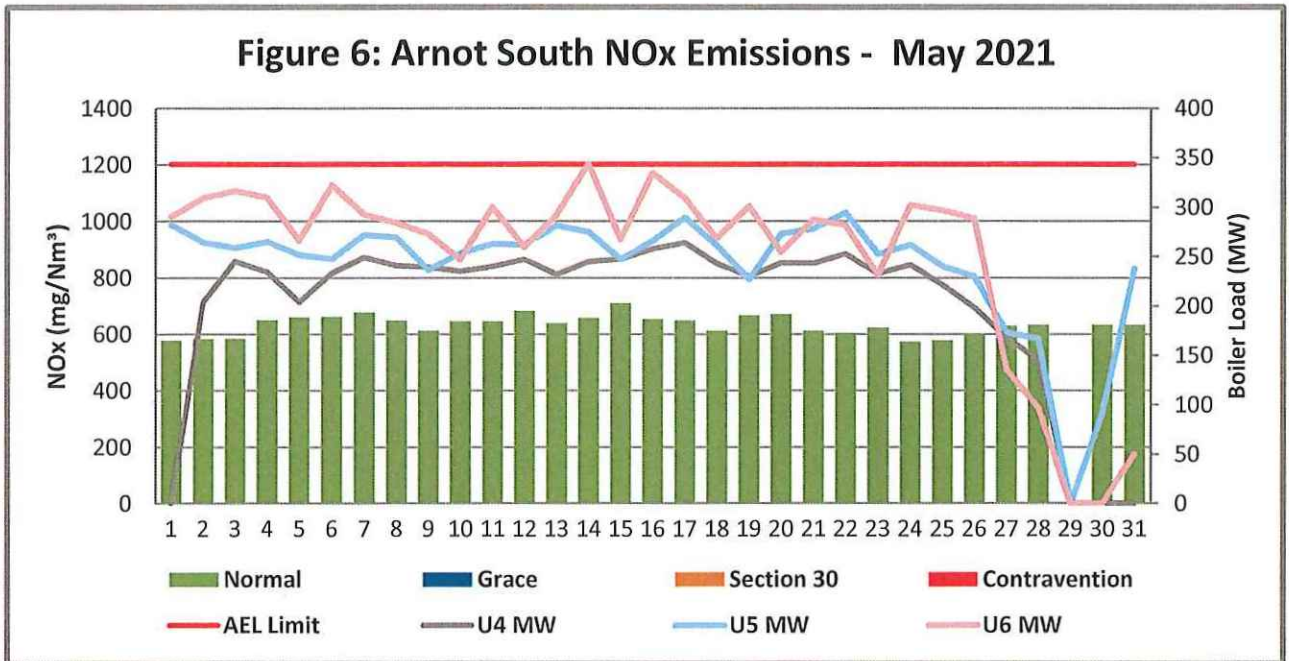


Figure 6: NO₂ emissions (daily averages) for the month of May 2021 against emission limit for the South Stack

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021

Table 7 Monthly tonnages for the month of May 2021

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons (North & South Stack)	238.9	6 388.2	3 177.3

Table 8. Monthly tonnages for the month of April 2021

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons (North & South Stack)	229.1	7 236.9	3 720.3

Table 9: Monthly tonnages for the month of March 2021

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons (North & South Stack)	167.4	5 782.3	3 502.7

Please note that tons for March (table 9), April (table 8) above have changed after back fitting new correction factors

Table 10 Monitor Availability

Unit	PM (%)	SO ₂ (%)	NO ₂ (%)
North Stack	100	99.2	99.5
South Stack	99.3	87.8	87.8

Table 11 Each unit and respective days operating under normal operation, days in grace period, and section 30 days respectively

Unit	Days operating under normal operation	Days operating in grace period	Days operating under S 30
1	31	0	0
2	31	0	0
3	31	0	0
4	31	0	0
5	31	0	0
6	31	0	0

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2021

Light up information

Continuous reporting is being done even during start-ups, emissions were not affected

Complaints Register

Table 12 Complaints for the month of May 2021


Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
None					

General

The rest of the information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Hoping the above will meet your satisfaction

Compiled by

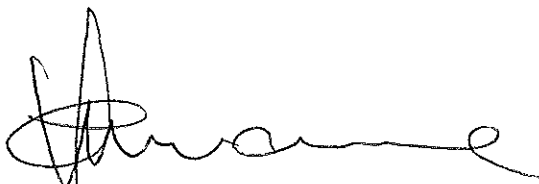

Lawrence Machebe

ENVIRONMENTAL OFFICER: ARNOT

Verified by




Nomathemba Mpulo

SENIOR TECHNOLOGIST: ARNOT

**ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY
2021**


Supported by



Rofhiwa Tshikovha

SENIOR ENVIRONMENTAL ADVISOR: ARNOT

Yours sincerely



P.P

Tsoro Samuel Mashao

ACTING GENERAL MANAGER: ARNOT