

Air Quality Officer
DEDET
Private bag X11215
NELSPRUIT
1200

Date:
2022.06. 20

Enquiries:
Mariam Joseph
Tel +27 13 297 9828
Fax + 27 86 661 7663

Dear Mr. Mahlangu

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2022

This serves as the monthly report required in terms of Section 6 in Arnot Power Station's Atmospheric Emission License. The emissions are for the month of May 2022, Verified emissions of particulates; SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table1: Quantity of Raw Materials and Products used/produced for the Month of May 2022

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of May 2022
	Coal	Tons/month	1 050 330	438 071.5
	Fuel Oil	Tons/month	10 000	4123.9
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of May 2022
	Energy	GWh	1 785 600	820120
	Ash	Tons/month	421 000	110 263

Abatement Technology

Generation Division
Arnot Power Station
N4 Nelspruit Road
Private Bag X2 Rietkuil 1097 SA
Tel +27 13 297 9111 Fax +27 13 297 9142 www.eskom.co.za

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2022

Table 2: Abatement Equipment Control Technology for month of May 2022

Associated Unit/Stack	Technology Type	Actual Efficiency (%) for the month of May 2022
North Stack	Fabric Filter Bags	100%
South Stack	Fabric Filter Bags	99.9%

Table 2.1 Abatement Equipment Utilisation (%) for the month of May 2022

Associated Unit/Stack	Technology Type	Utilisation May 2022
North	<i>Fabric Filter Plant (FFP)</i>	100%
South	<i>Fabric Filter Plant (FFP)</i>	100%

Energy Source Characteristics

Table 3: Energy Source Material Characteristics for the month of May 2022

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.5 to < 1 (%)	0,63
Ash Content	17 to < 40 (%)	25.17

Table 4 Operating days in compliance to PM AEL Limit –May 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average PM (mg/Nm ³)
North	31	0	0	0	0	11.4
South	31	0	0	0	0	28.7
SUM	32	0	0	0	0	

Table 5 Operating days in compliance to NOx AEL Limit – May 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm ³)
North	31	0	0	0	0	675.0
South	31	0	0	0	0	0
SUM	32	0	0	0	0	

Table 6: Operating days in compliance to SOx AEL Limit –May 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm ³)
North	31	0	0	0	0	1364.8
South	31	0	0	0	0	0
SUM	32	0	0	0	0	

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2022

Emissions Reporting

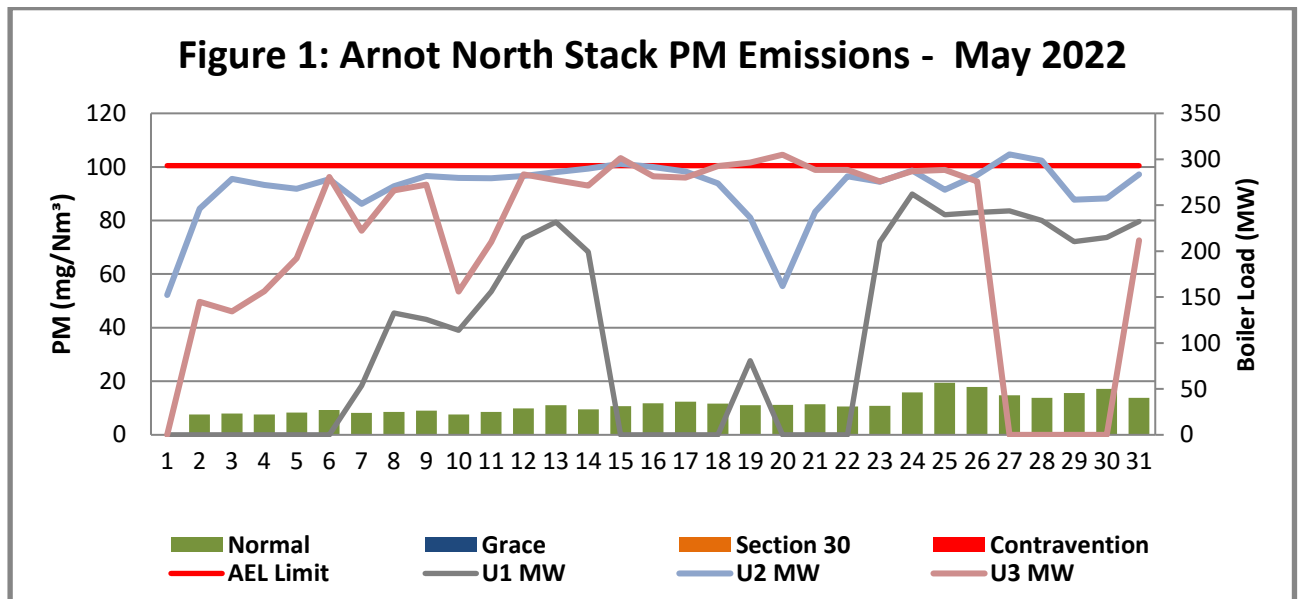


Figure 1: PM emissions (daily averages) for the month of May 2022 against emission limit for the North Stack

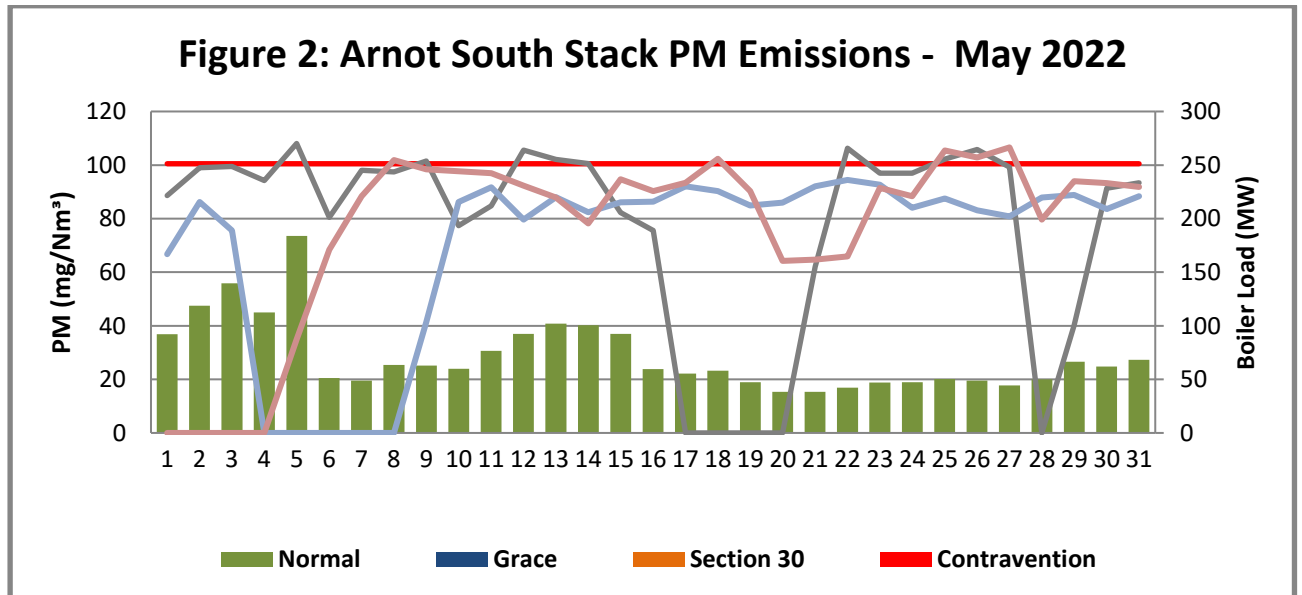


Figure 2: PM emissions (daily averages) for the month of May 2022 against emission limit for the South Sta

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2022

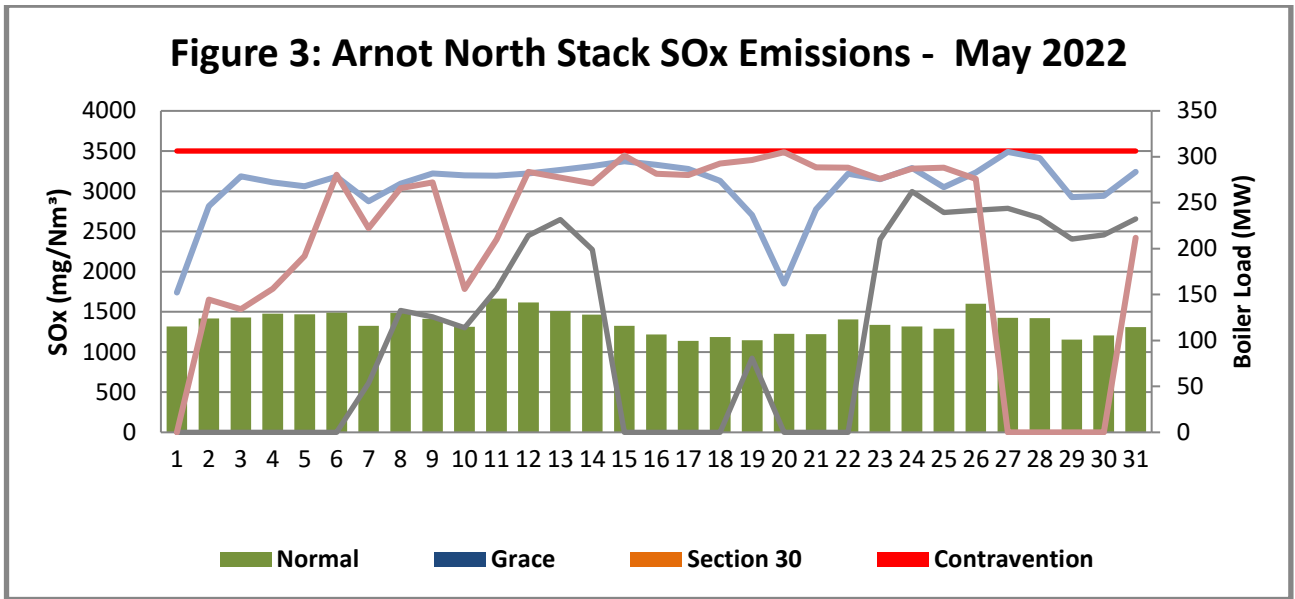


Figure 3: SO₂ emissions (daily averages) for the month of May 2022 against emission limit for the North Stack

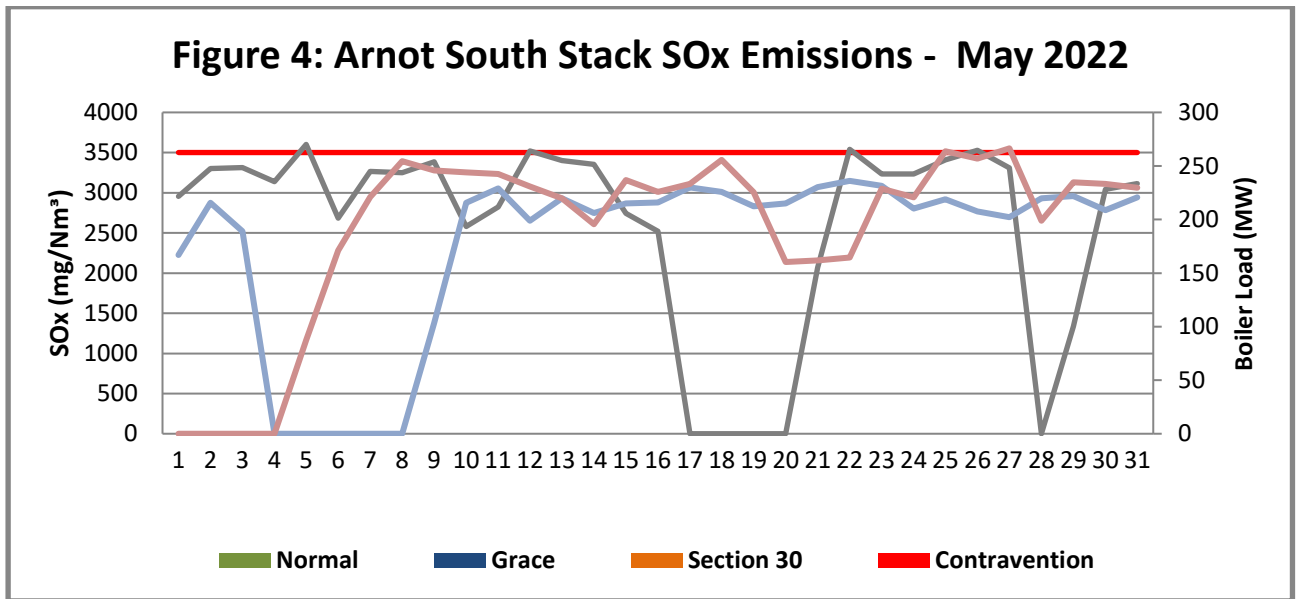


Figure 4: SO₂ emissions (daily averages) for the month of May -2022 against emission limit for the South Stack

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2022

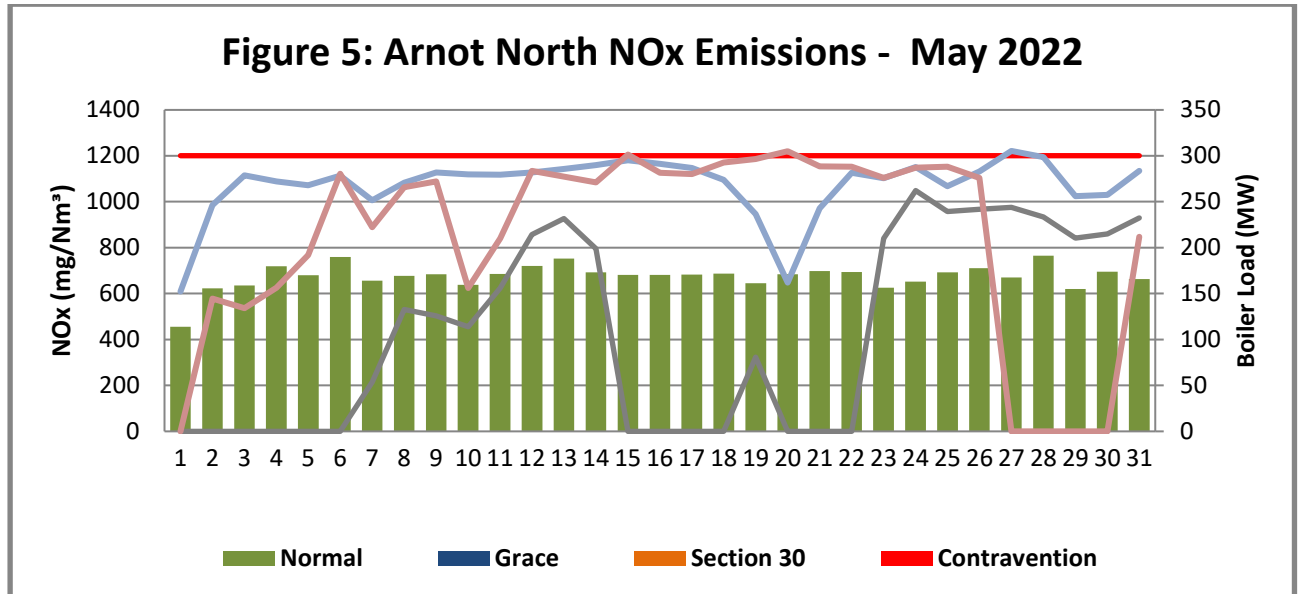


Figure 5: NO₂ emissions (daily averages) for the month of May 2022 against emission limit for the North Stack

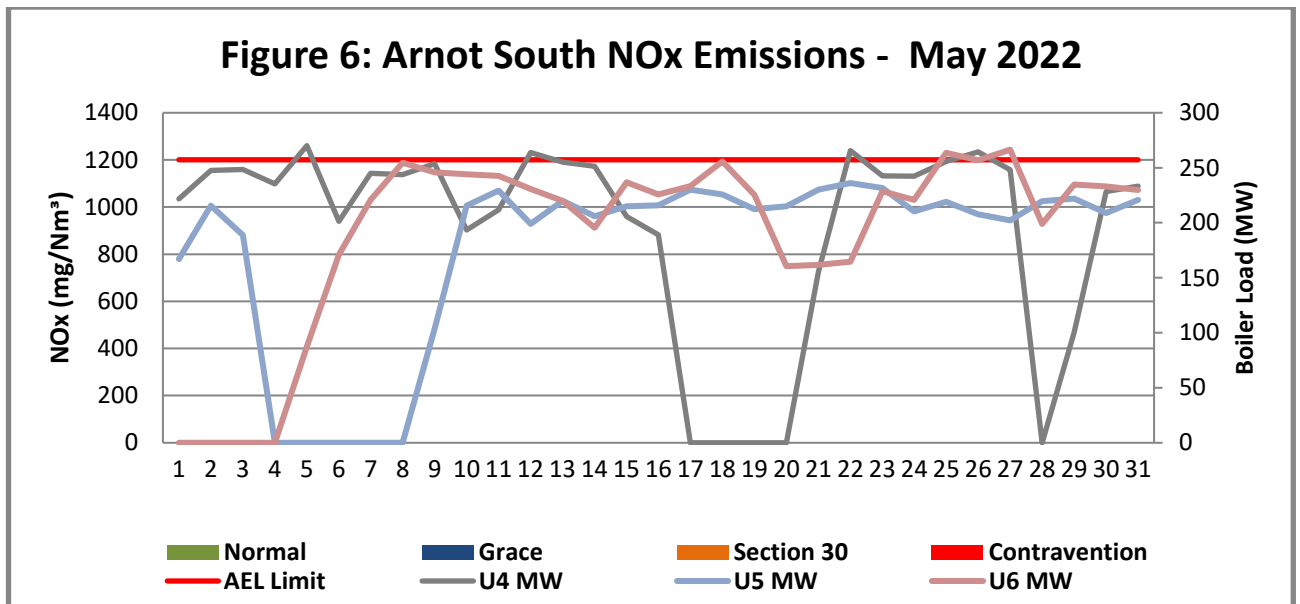


Figure 6: NO₂ emissions (daily averages) for the month of May 2022 against emission limit for the South Stack

Table 4: Monthly tonnages for the month of May 2022

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons (North & South Stack)	57.9	3046.6	1511.5

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2022

Table 5: Monitor Availability

Unit	PM (%)	SO ₂ (%)	NO ₂ (%)
North Stack	100.0	99.5	99.7
South Stack	99.9	100	100

Table 6: Each unit and respective days operating under normal operation, days in grace period, and section 30 days respectively

Unit	Days operating under normal operation	Days operating in grace period	Days operating under S 30
1	31	0	0
2	31	0	0
3	31	0	0
4	31	0	0
5	31	0	0
6	31	0	0

Light up information

Continuous reporting is being done even during start-ups emissions were not affected.

Complaints Register

Table 7. Complaints for the month of May 2022

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
None	0	0	0	0	0

General

The rest of the information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

New O₂ analyzer was installed and still need QAL2 test to be done. Once this is done, the new correction factors shall be back fitted from expiry date of 12 April 2021 and new figures shall be included on the coming monthly report.

**ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY
2022**

Arnot Power station is experiencing unreliability of monitor which affect the South Stack (NOx gaseous emissions) Investigation is currently taking place.

Hoping the above will meet your satisfaction.

Compiled by



Lawrence Machebe

ENVIRONMENTAL OFFICER: ARNOT

Date:2022.06.20

Verified by



Jan-Louis Human

SYSTEM ENGINEER: ARNOT

Date:

24-06-2022

Supported by:



Rofhiwa Tshikovha

SENIOR ENVIRONMENTAL ADVISOR: ARNOT

Date: 2022.06.20

Yours sincerely



Marcus Nematodzi

GENERAL MANAGER: ARNOT POWER STATION

Date: