

Air Quality Officer DEDET Private bag X11215 NELSPRUIT 1200 Date: 2022.07.28

Enquiries: Mariam Joseph

Tel +27 13 297 9828 Fax + 27 86 661 7663

Dear Mr. Mahlangu

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JUNE 2022

This serves as the monthly report required in terms of Section 6 in Arnot Power Station's Atmospheric Emission License. The emissions are for the month of June 2022, verified emissions of particulates; SO_2 and NO_x (as NO_2) are also included.

Raw Materials and Products

Table1: Quantity of Raw Materials and Products used/produced for the Month of June 2022

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of June 2022
	Coal	Tons/month	1 050 330	400 788.66
	Fuel Oil	Tons/month	10 000	2030.50
	Product/ By- Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of May 2022
Production Rates	Energy	GWh	1 785 600	811 840
	Ash	Tons/month	421 000	98 714.25

Abatement Technology

Table 2.1 (a) Abatement Equipment Control Technology for month of June 2022

Associated Unit/Stack	Technology Type	Actual Efficiency (%) for the month of May 2022
North Stack	Fabric Filter Bags	99.9%
South Stack	Fabric Filter Bags	99.9%

Table 2.1 (b) Abatement Equipment Utilisation (%) for the month of June 2022

Associated Unit/Stack	Technology Type	Utilisation June 2022
North	Fabric Filter Plant (FFP)	100 %
South	Fabric Filter Plant (FFP)	100 %

Table 2.1 (c) Monitor Reliability (%)

Associated Unit/Stack	PM	SO ₂	NO
Stack 1	100.0	99.9	99.9
Stack 2	100.0	99.7	99.9

Energy Source Characteristics

Table 3: Energy Source Material Characteristics for the month of June 2022

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.5 to < 1 (%)	0.630
Ash Content	17 to < 40 (%)	24.63

Table 4 Operating days in compliance to PM AEL Limit –June 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average PM (mg/Nm³)
North	30	0	0	0	0	15.3
South	30	0	0	0	0	26.5
SUM	60	0	0	0	0	

Table 5 Operating days in compliance to NOx AEL Limit – June 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm³)
North	30	0	0	0	0	584.7
South	30	0	0	0	0	0
SUM	60	0	0	0	0	

Table 6: Operating days in compliance to SOx AEL Limit –June 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm³)
North	30	0	0	0	0	1166.5
South	30	0	0	0	0	0
SUM	60	0	0	0	0	

Emissions Reporting

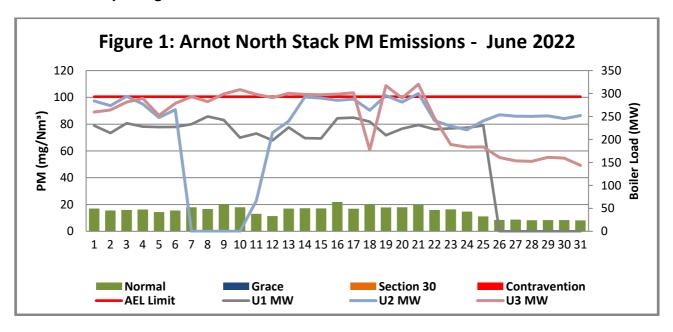


Figure 1: PM emissions (daily averages) for the month of June 2022 against emission limit for the North Stack

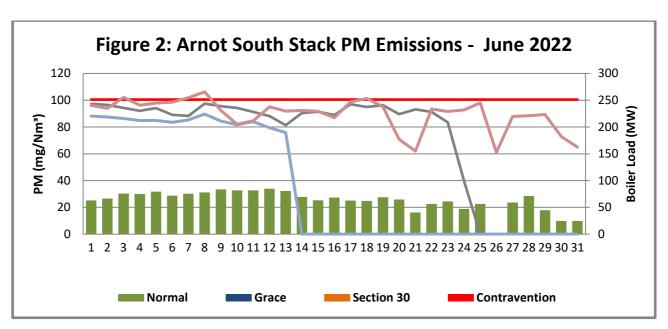


Figure 2: PM emissions (daily averages) for the month of June 2022 against emission limit for the South Stack

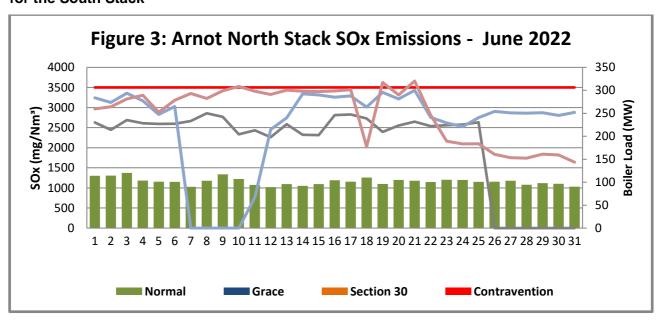


Figure 3: SO₂ emissions (daily averages) for the month of June 2022 against emission limit for the North Stack

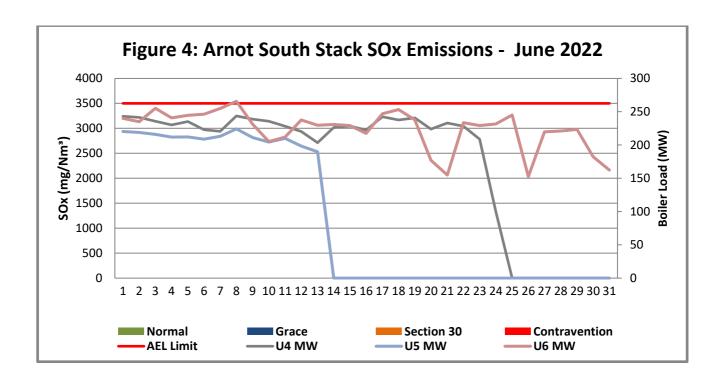


Figure 4: SO₂ emissions (daily averages) for the month of June 2022 against emission limit for the South Stack

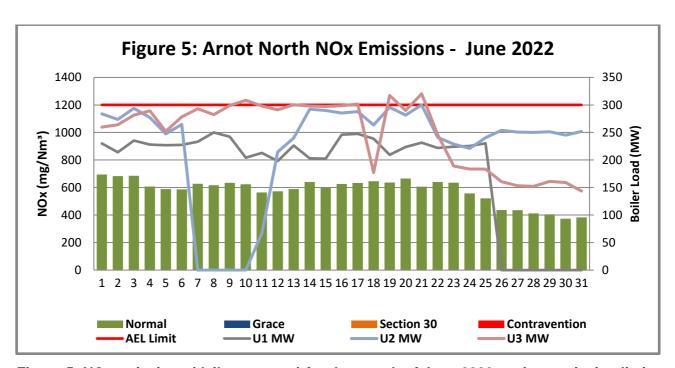


Figure 5: NO₂ emissions (daily averages) for the month of June 2022 against emission limit for the North Stack

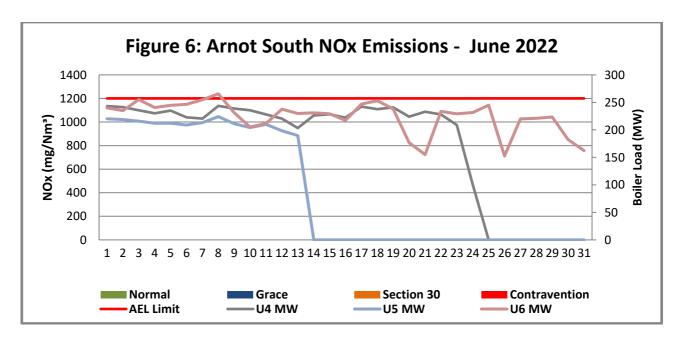


Figure 6: NO₂ emissions (daily averages) for the month of June 2022 against emission limit for the South Stack

Table 4: Monthly tonnages for the month of June 2022

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons (North & South Stack)	67.0	2768.5	1419.1

Table 5: Each unit and respective days operating under normal operation, days in grace period, and section 30 days respectively

Unit	Days operating under normal operation	Days operating in grace period	Days operating under \$ 30
1	30	0	0
2	30	0	0
3	30	0	0
4	30	0	0
5	30	0	0
6	30	0	0

Light up information

Continuous reporting is being done even during start-ups emissions were not affected.

Complaints Register

Table 6. Complaints for the month of June 2022

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
None	0	0	0	0	0

General

The rest of the information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Note:

- (a) Arnot Power station is experiencing unreliability of monitor which affect the South Stack (NOx gaseous emissions) Investigation is currently taking place.
- (b) Correlation test on the North stack is completed once the new correlation curve is implemented. The station will back-fit data and report any changes to the Licensing Office

Hoping the above will meet your satisfaction.

Compiled by	
Lawrence Machebe ENVIRONMENTAL OFFICER: ARNOT	2022.07.28
Verified by	Date:
Jan-Louis Human SYSTEM ENGINEER: ARNOT	02-08-2022
Supported by:	Date: 2022.07.28
HOW Kouhas.	
Rofhiwa Tshikovha SENIOR ENVIRONMENTAL ADVISOR: ARNOT	
Yours sincerely Wemadod.	

Date: 2 August 2022

Marcus Nemadodzi
GENERAL MANAGER: ARNOT POWER STATION