

Air Quality Officer DEDET Private bag X11215 NELSPRUIT 1200 Date: 2023.02.22

Inquiries: Mariam Joseph Tel +27 13 297 9828 Fax + 27 86 661 7663

Dear Mr. Mahlangu

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2023

This serves as the monthly report required in terms of Section 6 in Arnot Power Station's Atmospheric Emission License. The emissions are for January 2023, verified emissions of particulates; SO_2 and NO_x (as NO_2) are also included.

Raw Materials and Products

Table1: Quantity of Raw Materials and Products used/produced for the Month of January	2023
---	------

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of January 2023
	Coal	Tons/month	1 050 330	325 050.76
	Fuel Oil	Tons/month	10 000	3143.43
	Product/ By- Product Name	Unit	Maximum Production Capacity Permitted	Production Rate in Month of January
Production Rates			(Quantity)	2023
Production Rates	Energy	GWh		2023 620 021
Production Rates	Energy Ash	GWh Tons/month	(Quantity)	

Generation Division Arnot Power Station N4 Nelspruit Road Private Bag X2 Rietkuil 1097 SA Tel +27 13 297 9111 Fax +27 13 297 9142 www.eskom.co.za

Eskom Holdings SOC Ltd Reg No 2002/015527/30

Abatement Technology

Table 2.1 (a) Abatement Equipment Control Technology for month of January 2023

Associated Unit/Stack	Technology Type	Actual Efficiency (%) for the month of January 2023
North Stack	Fabric Filter Bags	99.9%
South Stack	Fabric Filter Bags	99.9%

Table 2.1 (b) Abatement Equipment Utilisation (%) for the month of January 2023

Associated Unit/Stack	Technology Type	Utilisation January 2023
North	Fabric Filter Plant (FFP)	100 %
South	Fabric Filter Plant (FFP)	100 %

Table 2.1 (c) Monitor Reliability (%)

Associated Unit/Stack	РМ	SO2	NO	
Stack 1	100%	54.7%	51.9%	
Stack 2	100%	99.7%	99.6%	

Reasons for Monitor Reliability performing below 80%: North Gaseous Monitor was struck by lightning which affected the performance reading.

Energy Source Characteristics

 Table 3: Energy Source Material Characteristics for the month of January 2023

Characteristic	Stipulated Range (Unit)	Monthly Average Content	
Sulphur Content	0.5 to < 1 (%)	0.64	
Ash Content	17 to < 40 (%)	24.96	

Table 4 Operating days in compliance to PM AEL Limit – January 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average PM (mg/Nm³)
North	31	0	0	0	0	20.8
South	31	0	0	0	0	50.2
SUM	62	0	0	0	0	

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm³)
North	31	0	0	0	0	483.9
South	31	0	0	0	0	569.3
SUM	62	0	0	0	0	

Table 5 Operating days in compliance to NOx AEL Limit – January 2023

Table 6: Operating days in compliance to Sox AEL Limit –November 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm³)
North	31	0	0	0	0	1155.2
South	31	0	0	0	0	1099.1
SUM	62	0	0	0	0	

Emissions Reporting

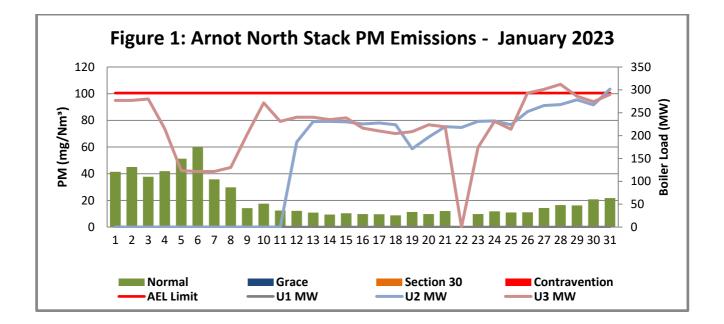


Figure 1: PM emissions (daily averages) for the month of January 2023 against the emission limit for the North Stack

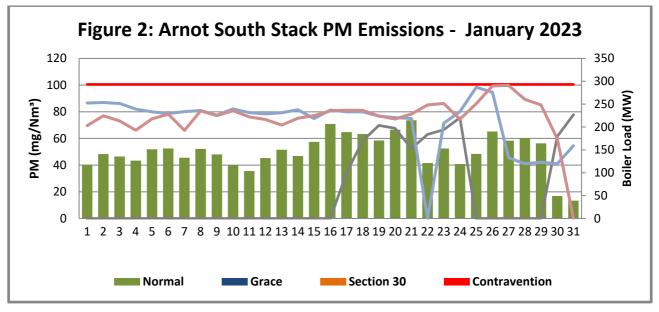


Figure 2: PM emissions (daily averages) for the month of January 2023 against emission limit for the South Stack

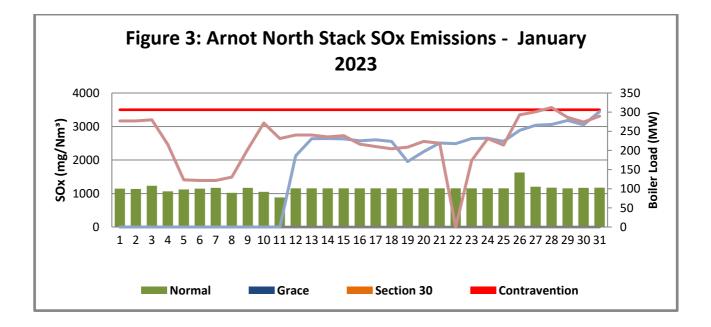


Figure 3: SO_2 emissions (daily averages) for the month of January 2023 against emission limit for the North Stack

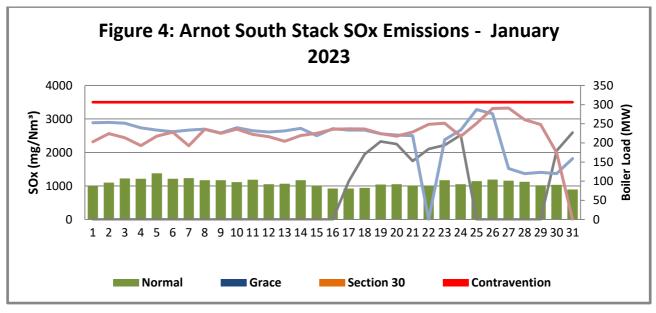


Figure 4: SO_2 emissions (daily averages) for the month of January 2023 against emission limit for the South Stack

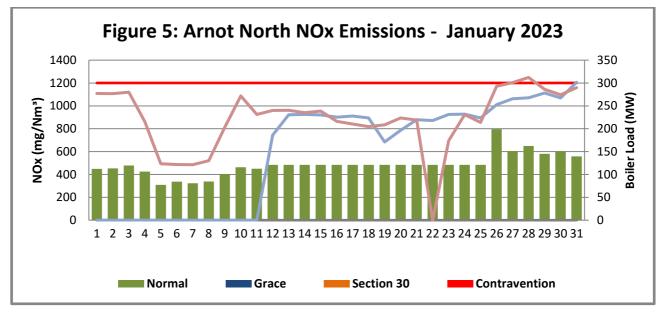


Figure 5: NO_2 emissions (daily averages) for the month of January 2023 against emission limit for the North Stack

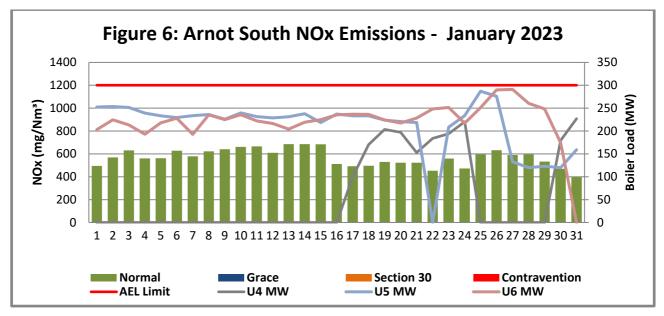


Figure 6: NO₂ emissions (daily averages) for the month of January 2023 against emission limit for the South Stack

Table 4: Monthly tonnages for the month of January 2023

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons			
(North &	04 5	2212.0	4500 5
South	81.5	3212.9	1509.5
Stack)			

Table 5: Each unit and respective days operating under normal operation, days in grace period, and section 30 days respectively

Unit	Days operating under normal operation	Days operating in grace period	Days operating under S 30
1	31	0	0
2	31	0	0
3	31	0	0
4	31	0	0
5	31	0	0
6	31	0	0

Light up information

Continuous reporting is being done even during start-ups emissions were not affected.

Complaints Register

Table 6. Complaints for the month of January 2023

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
None	0	0	0	0	0

General

The rest of the information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

Note: Parallel test are expired, and the station is currently conducting the new test. Data will be back fitted and reported at the licensing office.

Hoping the above will meet your satisfaction.

Compiled by

Amanne

2023.02.22

Lawrence Machebe ENVIRONMENTAL OFFICER: ARNOT

Verified by

Date: 27/2/2023

WMoll

Jan-Louis Human SYSTEM ENGINEER: ARNOT

pp

Supported by:

Date: 2023.02.22

HOW Kouha

Rofhiwa Tshikovha SENIOR ENVIRONMENTAL ADVISOR: ARNOT

Yours sincerely

emadod

Marcus Nemadodzi

Date: 2023-02-28

GENERAL MANAGER: ARNOT POWER STATION