

Ms Mpho Nembilwi
 Nkangala District Municipality
 PO BOX 437
 MIDDLEBURG
 1050

Date:
 01 December 2022

Enquiries:
 Livhuwani Tshilate
 017 615 2317

Ref: 17/4/AEL/MP312/11/09

Dear Ms Nembilwi

KRIEL POWER STATION'S MONTHLY STACK EMISSIONS REPORT FOR THE MONTH OF OCTOBER ER 2022

This serves as the monthly report required in terms of Section 7.4 in Kriel Power Station's Atmospheric Emission License 17/4/AEL/MP312/11/09. The emissions are for the month of October 2022. Verified emissions of particulates matter, SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table 1: Quantity of Raw Materials and Products used/produced for the month of October 2022

Raw Materials and Products used	Raw Material Type	Units	Maximum Permitted Consumption / Rate (Quantity)	Consumption / Rate in Month of October 2022
	Coal	Tons/month	1 227 600	558 870.00
	Fuel Oil	Tons/month	5 000	2339.0
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of October 2022
	Ash	Tons/month	not specified	447.7
	RE PM	kg/MWh	not specified	0.46

1/...

Abatement Technology

Table 2: Abatement Equipment Control Technology for October 2022.

Associated Unit/Stack	Technology Type	Actual Efficiency (%)	Utilisation
		October 2022	October 2022
Unit 1	ESP	99.84%	77.3%
Unit 2	ESP	99.83%	68.3%
Unit 3	ESP	Outage	Outage
Unit 4	ESP	99.55%	94.0%
Unit 5	ESP	99.60%	100%
Unit 6	ESP	99.62%	97.5%

Energy Source Characteristics

Table 3: Energy Source Material Characteristics for the month of October 2022





Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.6-1.2 (%)	0.69
Ash Content	21-36 (%)	25.26

Monthly Monitor Reliability

Associated Unit/Stack	PM (%)	SO _x (%)	NO _x (%)
North	99.45	70.94	76.34
South	91.47	100.00	99.47

Emissions Reporting

Table 6.5: Graph Legend Description

Condition	Colour	Description
Normal		Emissions below Emission Limit Value (ELV)
Grace		Emissions above the ELV during grace period
Section 30		Emissions above ELV during a NEMA S30 incident
Contravention		Emissions above ELV but outside grace or S30 incident conditions

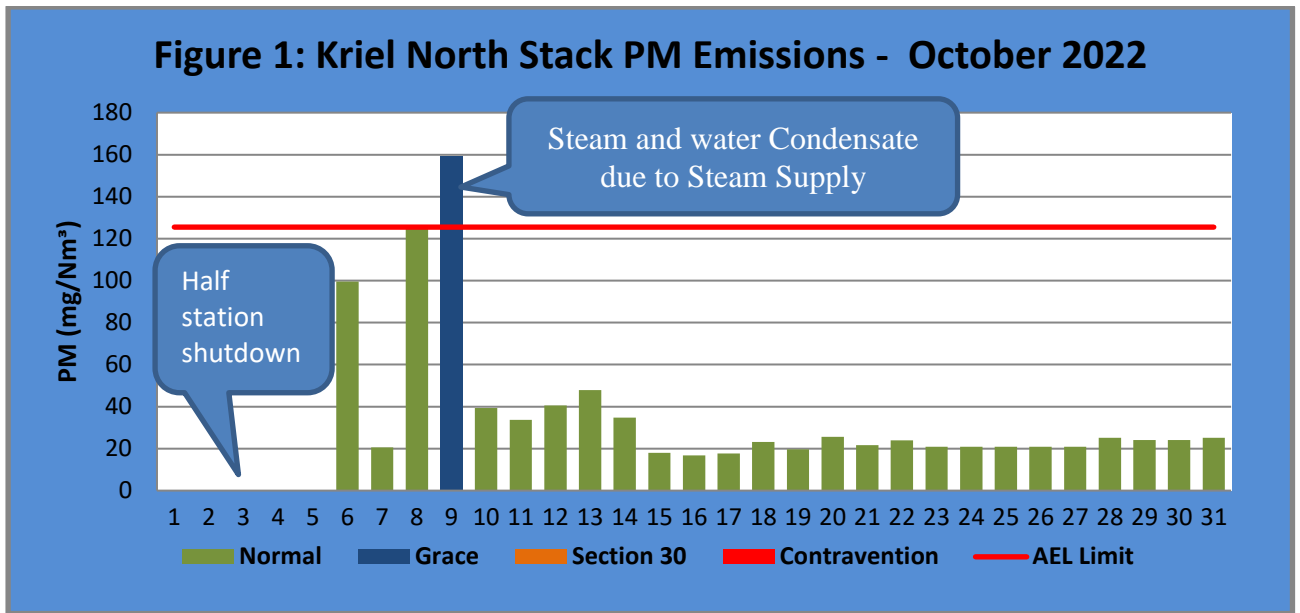


Figure 1: PM emissions for the month of October 2022 against emission limit for the North Stack. Monthly average was 37.3 mg/Nm³

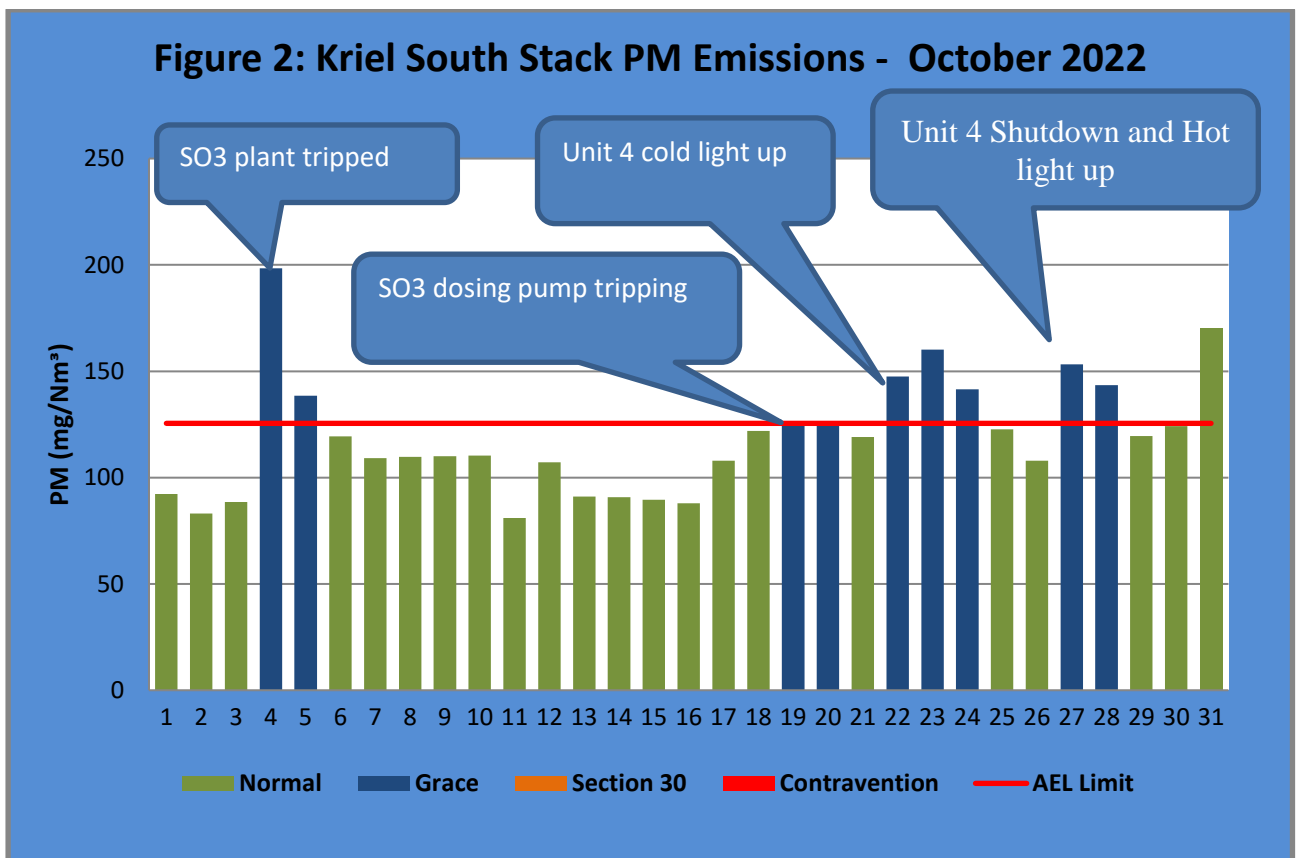


Figure 2: PM emissions for the month of October 2022 against emission limit for the South Stack. Monthly average was 119.3 mg/Nm³

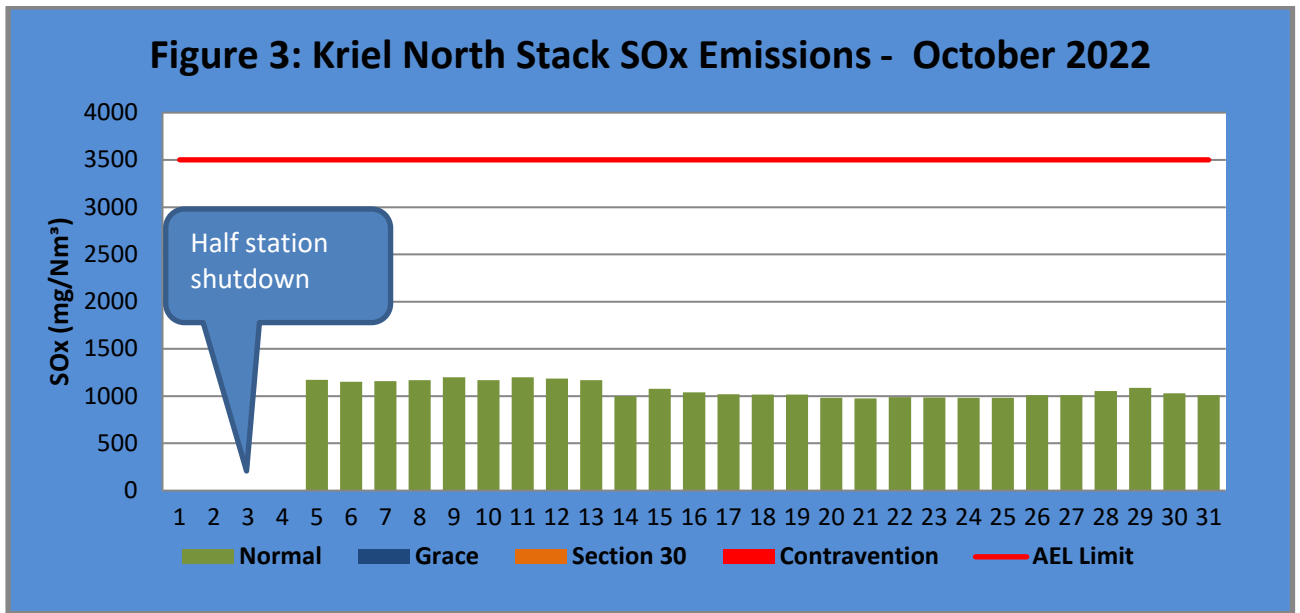


Figure 3. SO₂ emissions for the month of October 2022 against emission limit for the North Stack. The SO_x Limit is 3500mg/Nm³.

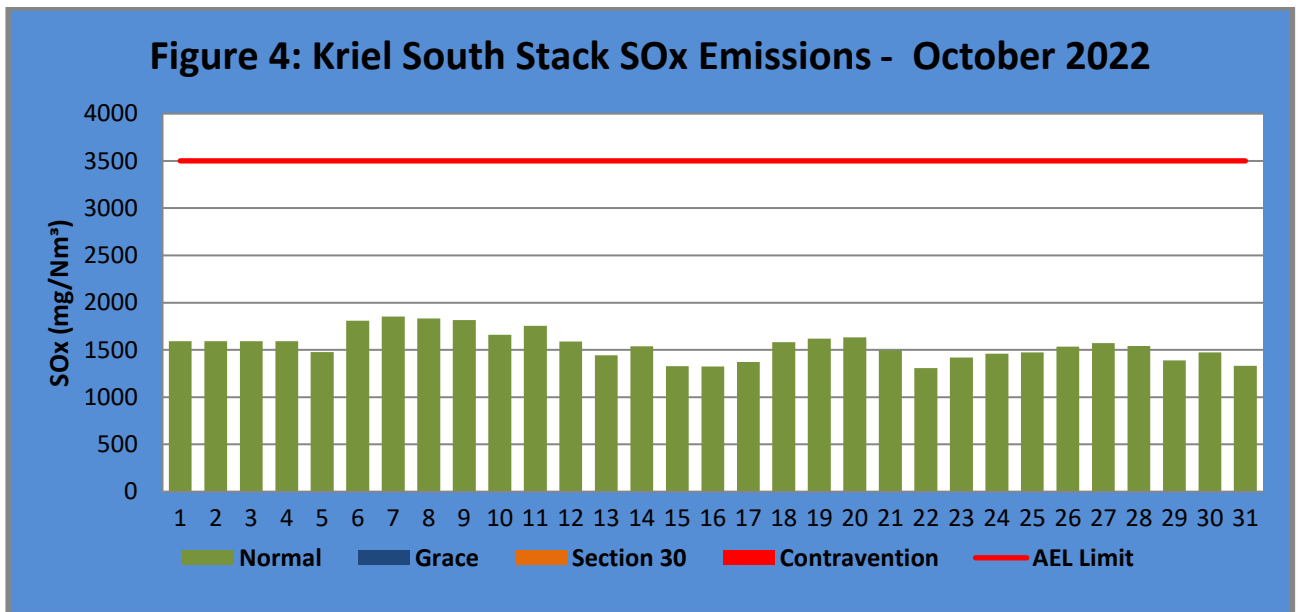


Figure 4. SO₂ emissions for the month of October 2022 against emission limit for the South Stack. The SO_x Limit is 3500mg/Nm³.

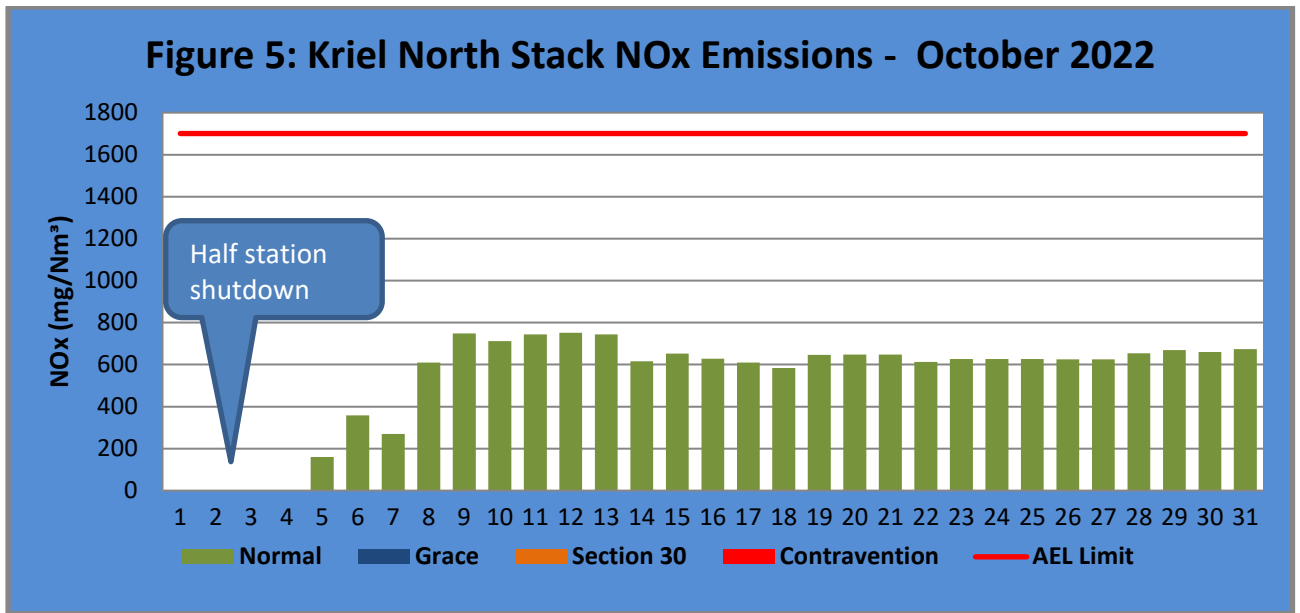


Figure 5. NO_x emissions for the month of October 2022 against emission limit for the North Stack. The NO_x Limit is 1600mg/Nm³.

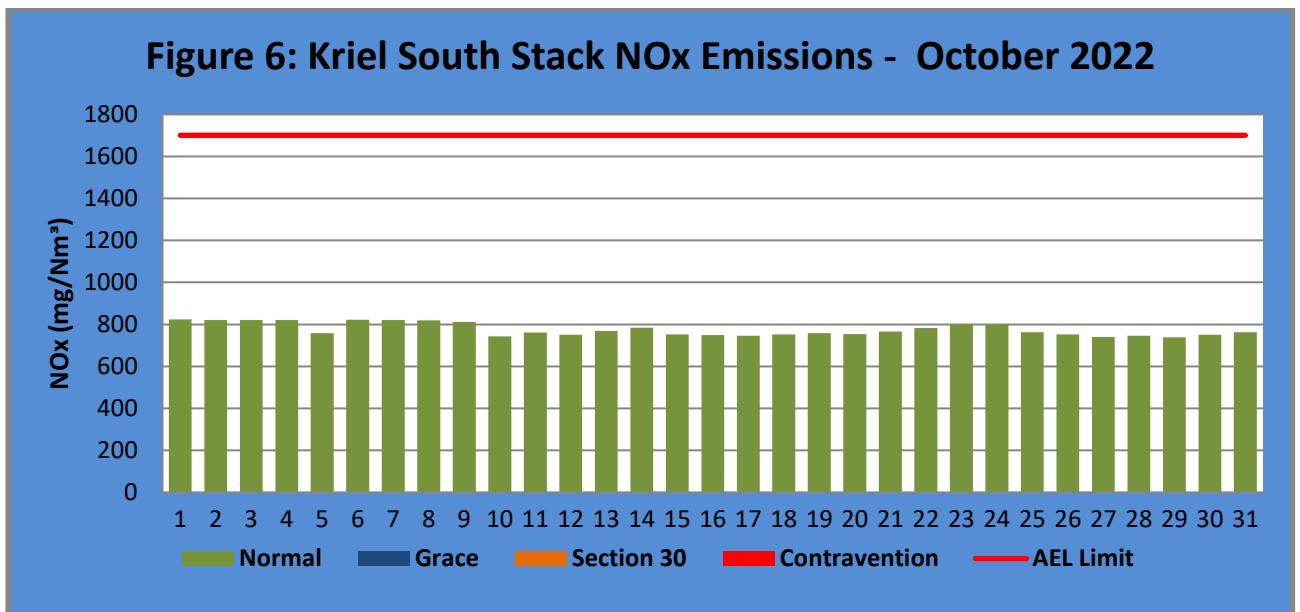


Figure 6. NO_x emissions for the month of October 2022 against emission limit for the South Stack. The NO_x Limit is 1600mg/Nm³.

Table 4: Monthly tonnages for the month October 2022

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
SUM	447.7	6 822.2	3 610.1

Table 5: Each unit and respective days operating under normal operation and section 30 days respectively

Table 5.1: Operating days in compliance to PM AEL Limit – October 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Monthly Limit Exceedance	Average PM (mg/Nm ³)
North	25	2	0	0	0	37.3
South	22	9	0	0	0	119.3

Table 5.2: Operating days in compliance to SOx AEL Limit - October 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm ³)
North	27	0	0	0	0	1 068.1
South	31	0	0	0	0	1 548.1

Table 5.3: Operating days in compliance to NOx AEL Limit – October 2022

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm ³)
North	27	0	0	0	0	612.4
South	31	0	0	0	0	775.4

Light up information

Table 6: PM Start-up information for the month of October 2022

North Stack	Event 1		Event 2		Event 3		Event 4	
Unit No.	Unit 1		Unit 1		Unit 1		Unit 1	
Breaker Open (BO)	<i>BO previously</i>	<i>BO previously</i>	2:25 AM	2022/10/23	4:10 PM	2022/10/24	10:30 AM	2022/10/02
Draught Group (DG) Shut Down (SD)	<i>n/a</i>	<i>n/a</i>	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	3:55 PM	2022/10/03
BO to DG SD (duration)	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM	01:05:25	DD:HH:MM
Fires in time	4:45 PM	2022/10/06	2:25 AM	2022/10/23	4:10 PM	2022/10/24		
Synch. to Grid (or BC)	5:25 AM	2022/10/07	1:55 PM	2022/10/23	11:45 PM	2022/10/24		
Fires in to BC (duration)	00:12:40	DD:HH:MM	00:11:30	DD:HH:MM	00:07:35	DD:HH:MM		DD:HH:MM
Emissions below limit from BC (end date)	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>		
Emissions below limit from BC (duration)	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM		DD:HH:MM

North Stack	Event 5		Event 6	
Unit No.	Unit 2		Unit 2	
Breaker Open (BO)	<i>BO previously</i>	<i>BO previously</i>	11:55 PM	2022/10/21
Draught Group (DG) Shut Down (SD)	<i>n/a</i>	<i>n/a</i>	11:56 PM	2022/10/21
BO to DG SD (duration)	<i>n/a</i>	DD:HH:MM	00:00:01	DD:HH:MM
Fires in time	6:05 PM	2022/10/04	3:10 AM	2022/10/22
Synch. to Grid (or BC)	9:05 AM	2022/10/05	10:25 AM	2022/10/27
Fires in to BC (duration)	00:15:00	DD:HH:MM	05:07:15	DD:HH:MM
Emissions below limit from BC (end date)	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>
Emissions below limit from BC (duration)	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM

South Stack	Event 1		Event 2		Even 3		Event 4	
Unit No.	Unit 4		Unit 4		Unit 4		Unit 4	
Breaker Open (BO)	2:15 PM	2022/10/07	8:50 PM	2022/10/10	2:00 AM	2022/10/16	1:15 AM	2022/10/20
Draught Group (DG) Shut Down (SD)	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	9:25 PM	2022/10/10	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>
BO to DG SD (duration)	<i>n/a</i>	DD:HH:MM	00:00:35	DD:HH:MM	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM
Fires in time	2:15 PM	2022/10/07	9:05 AM	2022/10/11	2:00 AM	2022/10/16	1:15 AM	2022/10/20
Synch. to Grid (or BC)	1:45 AM	2022/10/08	3:45 PM	2022/10/11	6:25 AM	2022/10/16	5:05 AM	2022/10/20
Fires in to BC (duration)	00:11:30	DD:HH:MM	00:06:40	DD:HH:MM	00:04:25	DD:HH:MM	00:03:50	DD:HH:MM
Emissions below limit from BC (end date)	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>
Emissions below limit from BC (duration)	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM

South Stack	Event 5		Event 2		Even 3	
Unit No.	Unit 4		Unit 4		Unit 4	
Breaker Open (BO)	1:40 PM	2022/10/27	2:50 AM	2022/10/08	5:45 PM	2022/10/02
Draught Group (DG) Shut Down (SD)	<i>DG did not trip or SD</i>	<i>DG did not trip or SD</i>	5:15 AM	2022/10/08	3:45 PM	2022/10/04
BO to DG SD (duration)	<i>n/a</i>	DD:HH:MM	00:02:25	DD:HH:MM	01:22:00	DD:HH:MM
Fires in time	1:40 PM	2022/10/27	3:55 PM	2022/10/08		
Synch. to Grid (or BC)	7:10 PM	2022/10/27	9:10 PM	2022/10/08		
Fires in to BC (duration)	00:05:30	DD:HH:MM	00:05:15	DD:HH:MM		DD:HH:MM
Emissions below limit from BC (end date)	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>		
Emissions below limit from BC (duration)	<i>n/a</i>	DD:HH:MM	<i>n/a</i>	DD:HH:MM		DD:HH:MM

Complaints Register

Table 9: Complaints for the month of October 2022.

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
There was no complaint related to air quality received during the month of October 2022.					

General

The particulate matter (PM10) emissions on the North Common Stack were within the **monthly limit**; North stack recorded the monthly PM10 average emissions figure of **37.3 mg/Nm³** while South Common Stack exceeded the **monthly limit** and recorded PM10 monthly average figure of **119.3 mg/Nm³**. The gaseous (NO_x & SO_x) emissions on the north and south common stacks were also within the **daily limit** during the month of October 2022; refer to graphs above.

NB: The rest of the information demonstrating compliance with the emissions license conditions is supplied in the annual emission reports sent to your office.

Kriel Power Station's List of NEMA Section 30 Incidents for 2022/2023 Financial Year

Month	Description of Section 30 Incidents - including the reference number	Root Cause (s)	Status of S30 Incident with DEFF (open or closed)	Remarks
April-2022	None			
November - 2022	None			
November - 2022	None			
November - 2022	None			
Aug - 2022	None			
Sep - 2022	None			
Oct - 2022	None			
Nov - 2022				
Dec - 2022				
Jan - 2023				
Feb - 2023				
Mar - 2023				