

Mr Dan Hlanyane
 Senior Manager Municipal Health & Environmental Services
 Gert Sibande District Municipality
 PO BOX 3016
 ERMELO
 2350

Date:09 June 2023

Enquiries: Johan Swanepoel
 Tel +27 17 799 2047

MAJUBA POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2023

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of May 2023. Verified emissions of particulates are included. SO₂ and NO_x (as NO₂) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Environmental, Forestry and Fisheries in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting.

Raw Materials and Products

Table 1. Quantity of Raw Materials and Products used/produced for the month of May 2023

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of May 2023
	Coal	Tons/month	1 800 000	936 978.65
	Fuel Oil	Tons/month	6 000	12 913
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity - MW)	Production Rate in Month of May 2023
	Energy	GWh	4 110	1 584.90
	Ash	Tons/month	Not stated in the license	280 156.62

Abatement Technology

Table 2. Abatement Equipment Control Technology for the month of May 2023

Associated Unit	Technology Type	Actual Utilisation (%) for the month of May 2023	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.90
Unit 2	Fabric Filter Plant	100	99.92
Unit 3	Fabric Filter Plant	100	99.92
Unit 4	Fabric Filter Plant	100	99.82
Unit 5	Fabric Filter Plant	100	99.89
Unit 6	Fabric Filter Plant	100	99.77

*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal.

Generation Division (Operating Unit Coal 2)
 Majuba Power Station
 Between Amersfoort and Volksrust
 Private Bag x9001 Volksrust 2470 SA
 Tel +27 17 799 2100 Fax +27 17 799 3615 www.eskom.co.za

Energy Source Characteristics

Table 3. Energy Source Material Characteristics for the month of May 2023

Characteristic	Stipulated Limit (Unit)	Monthly Average Content
Sulphur Content	0.94%	0.60
Ash Content	30%	29.90

Emissions Reporting

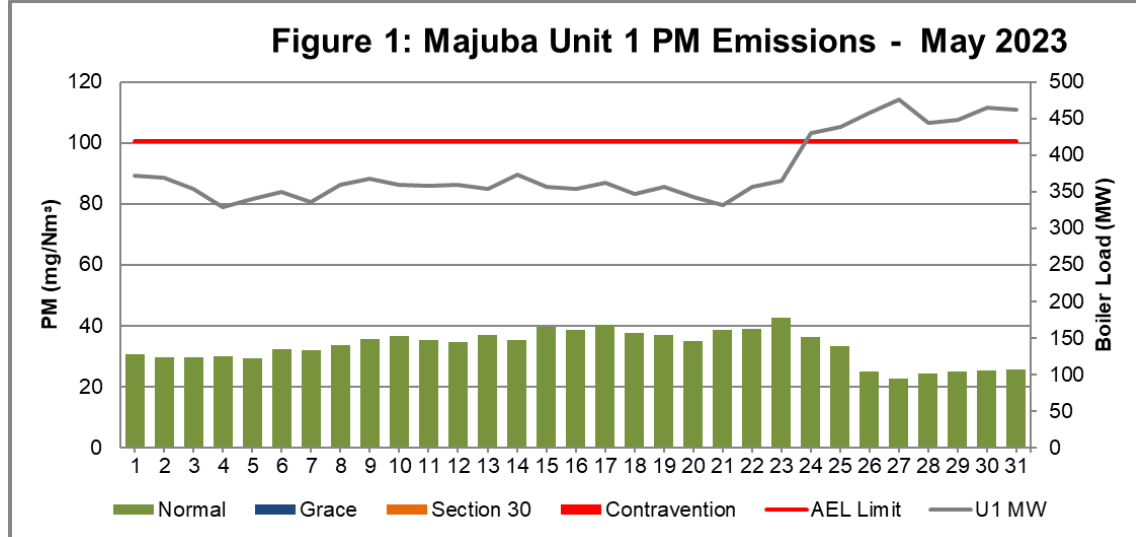


Figure 1. Particulate Matter emissions (daily averages) for the month of May 2023 against emission limit for Unit 1.

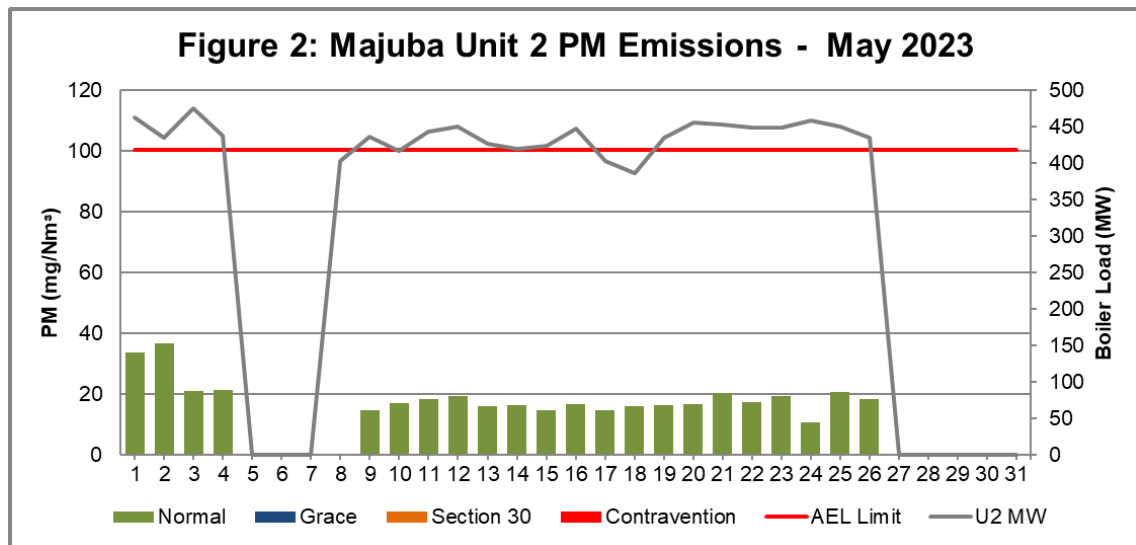


Figure 2. Particulate Matter emissions (daily averages) for the month of May 2023 against emission limit for Unit 2.

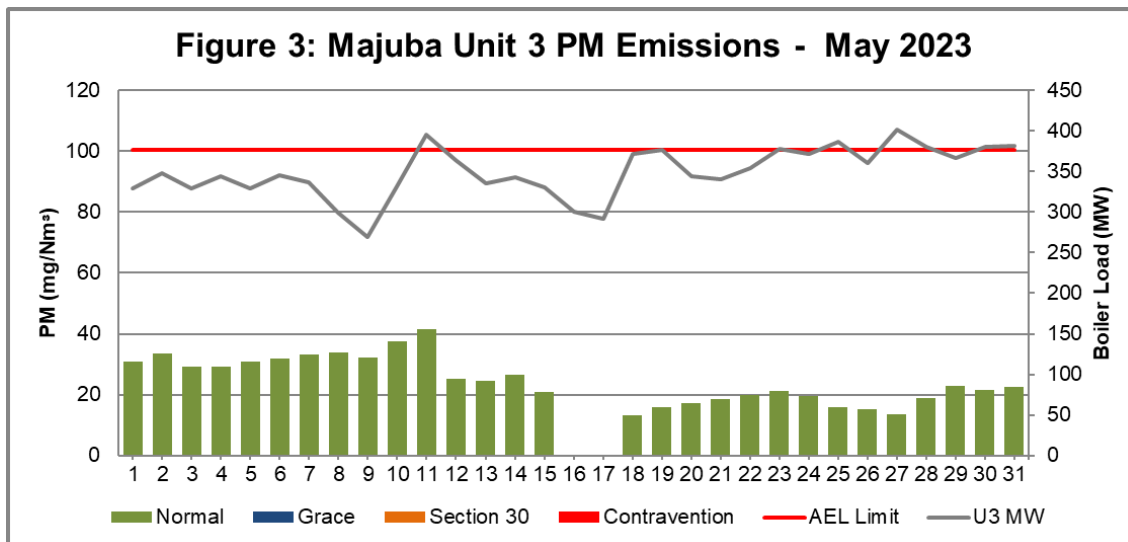


Figure 3. Particulate Matter emissions (daily averages) for the month of May 2023 against emission limit for Unit 3.

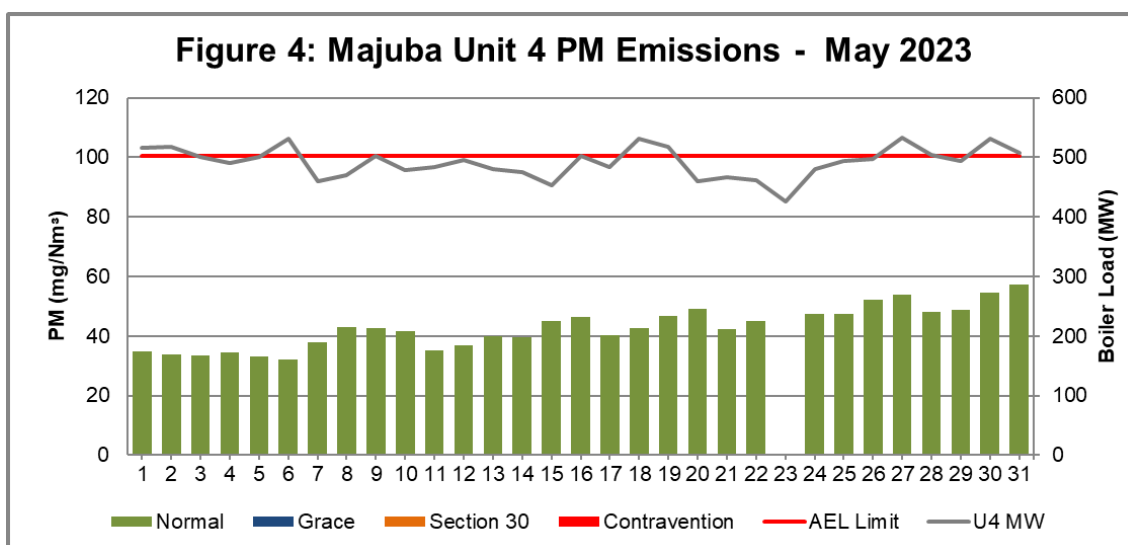


Figure 4. Particulate Matter emissions (daily averages) for the month of May 2023 against emission limit for Unit 4.

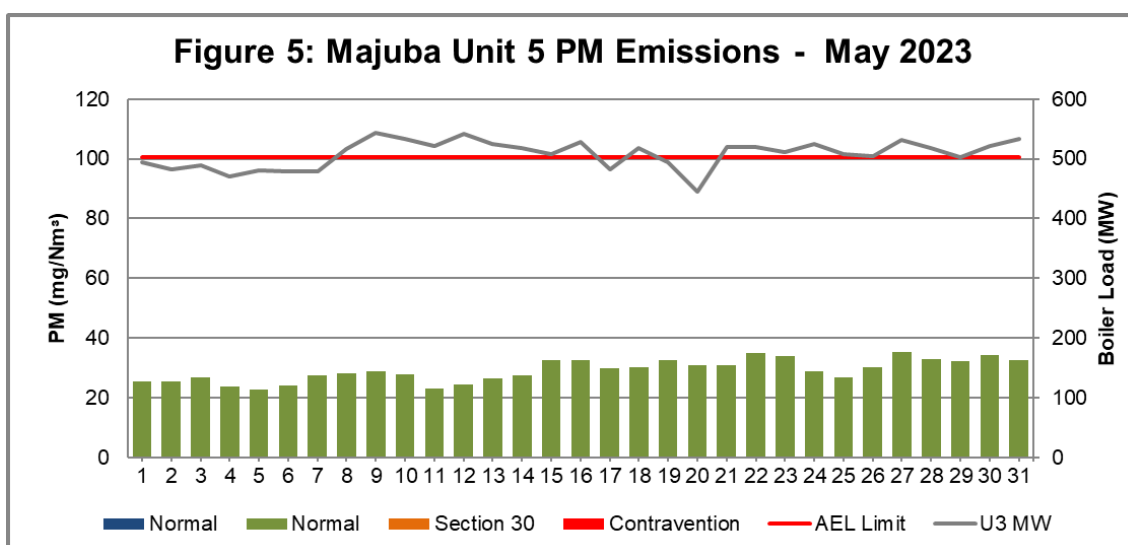


Figure 5. Particulate Matter emissions (daily averages) for the month of May 2023 against emission limit for Unit 5.

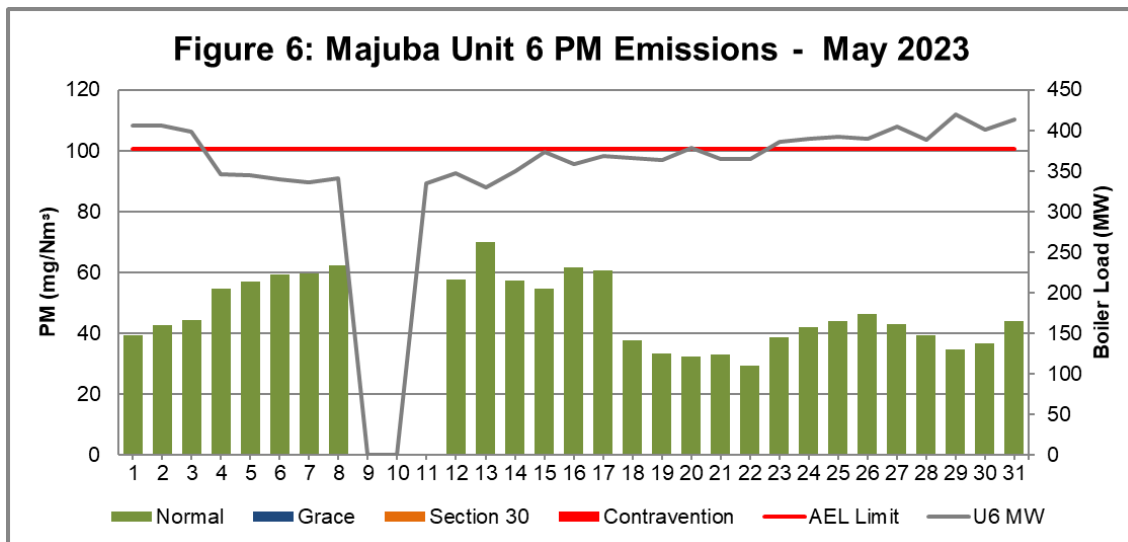


Figure 6. Particulate Matter emissions (daily averages) for the month of May 2023 against emission limit for Unit 6.

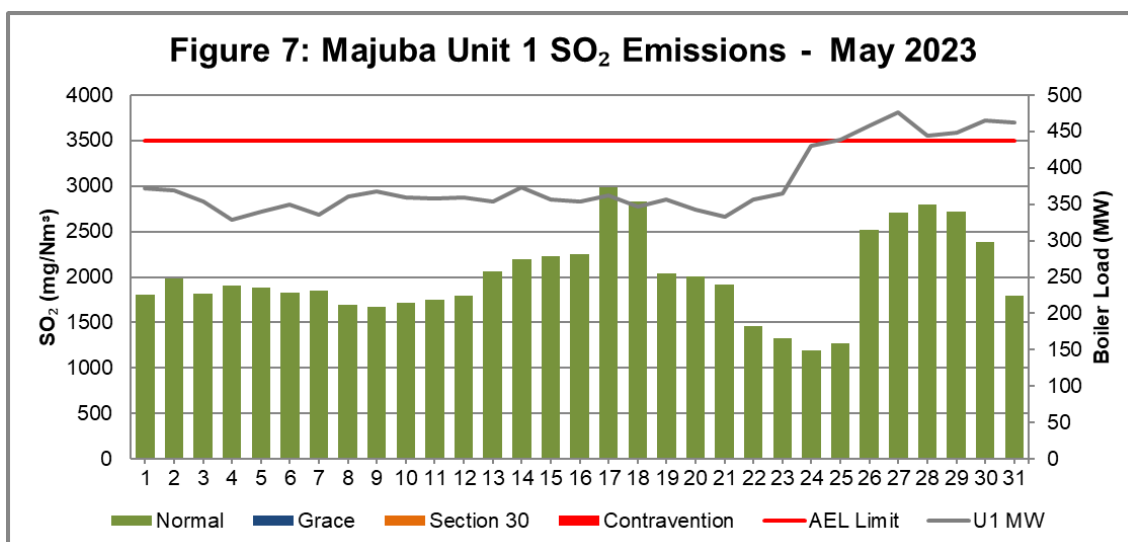


Figure 7. Sox emissions (daily averages) for the month of May 2023 against emission limit for Unit 1.

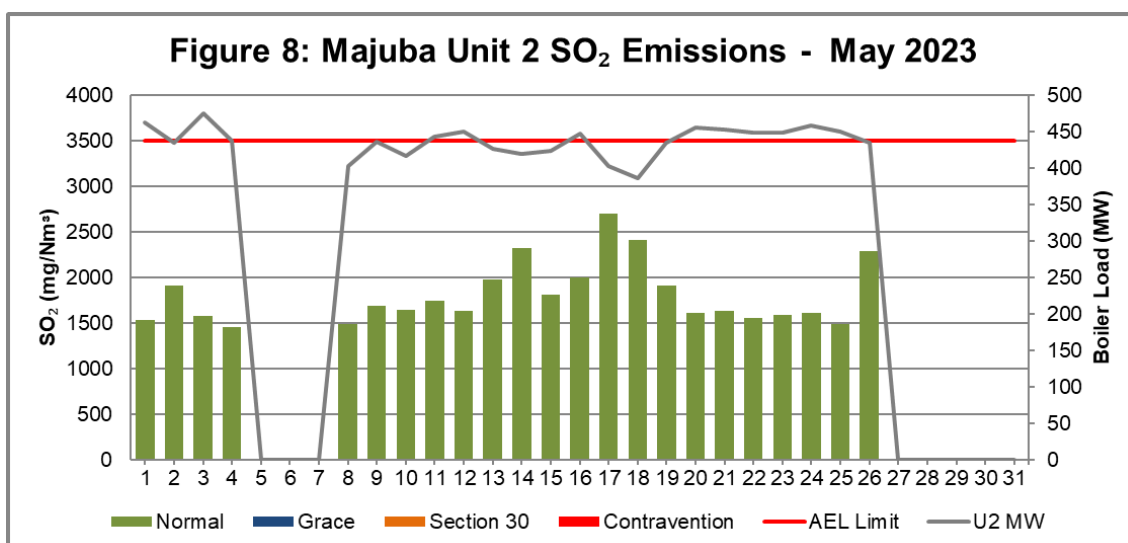


Figure 8. Sox emissions (daily averages) for the month of May 2023 against emission limit for Unit 2.

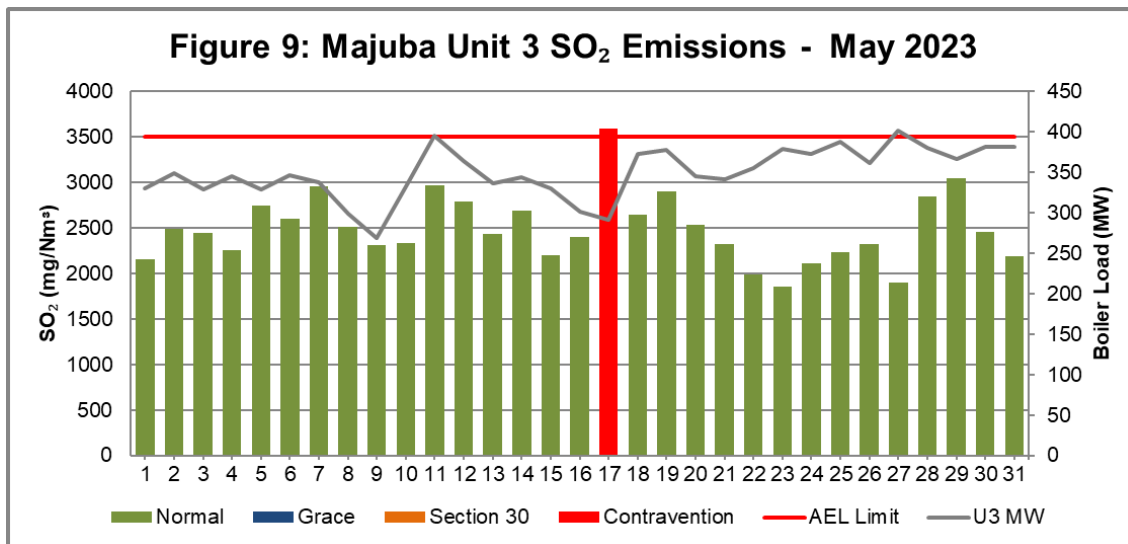


Figure 9. Sox emissions (daily averages) for the month of May 2023 against emission limit for Unit 3.

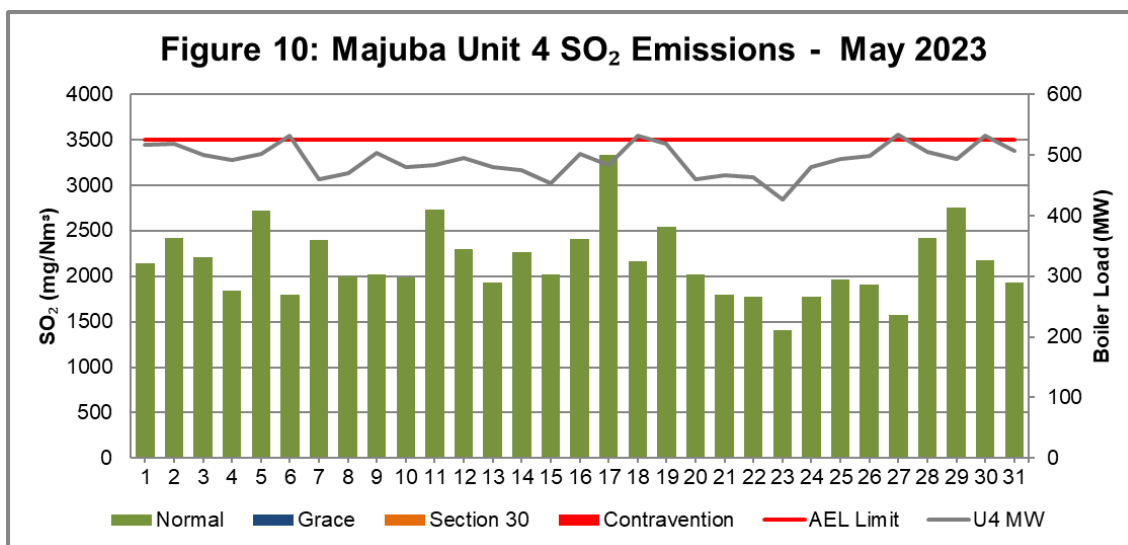


Figure 10. Sox emissions (daily averages) for the month of May 2023 against emission limit for Unit 4.

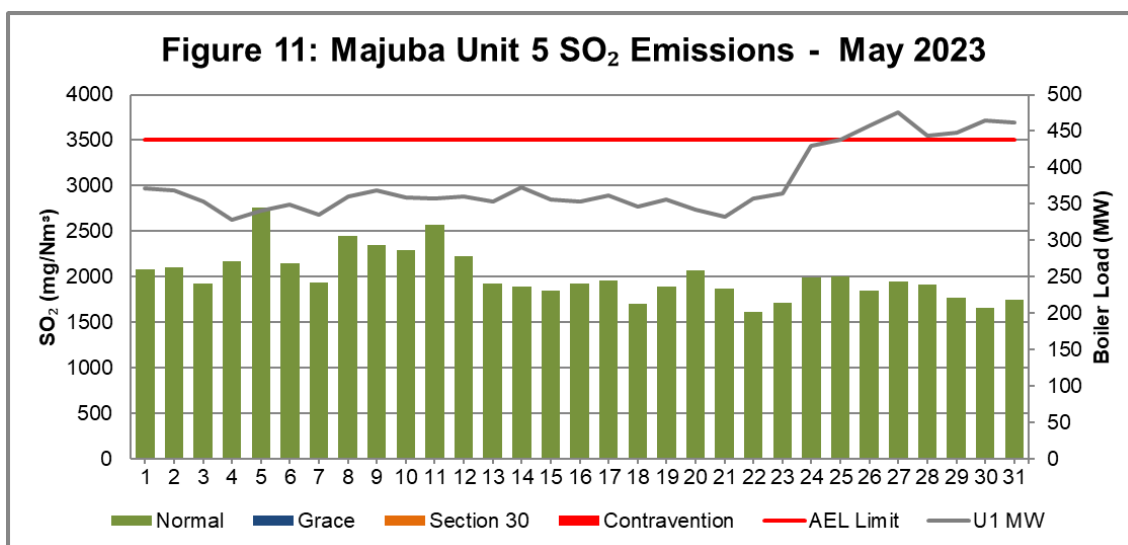


Figure 11. Sox emissions (daily averages) for the month of May 2023 against emission limit for Unit 5

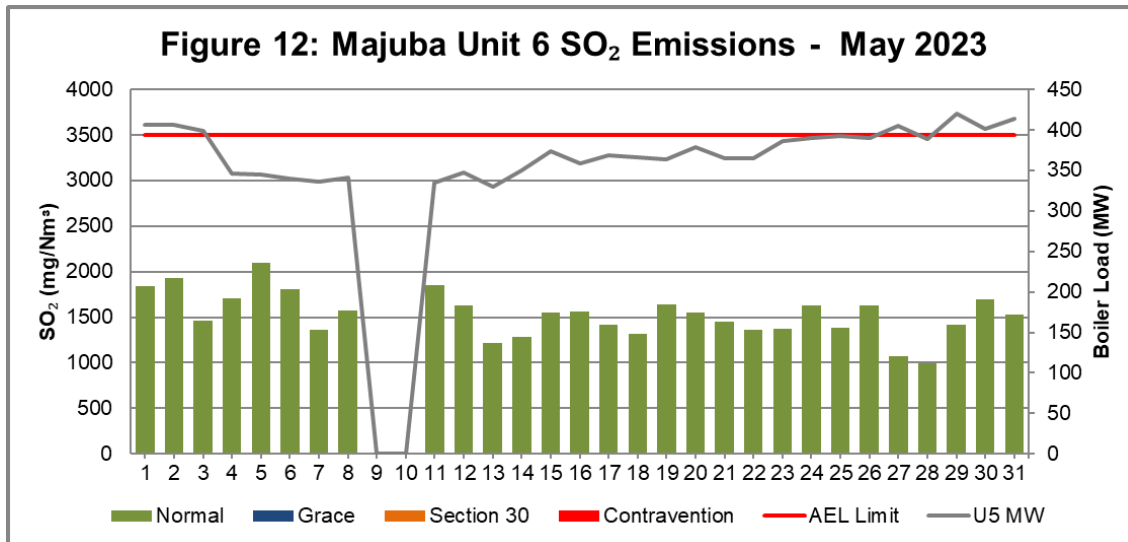


Figure 12. Sox emissions (daily averages) for the month of May 2023 against emission limit for Unit 6.

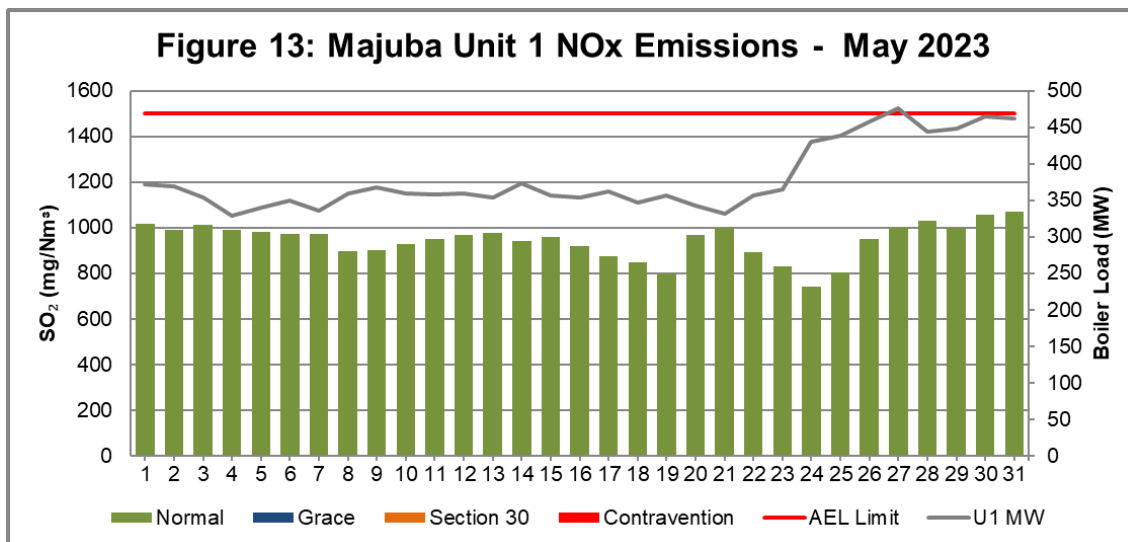


Figure 13. Nox emissions (daily averages) for the month of May 2023 against emission limit for Unit 1.

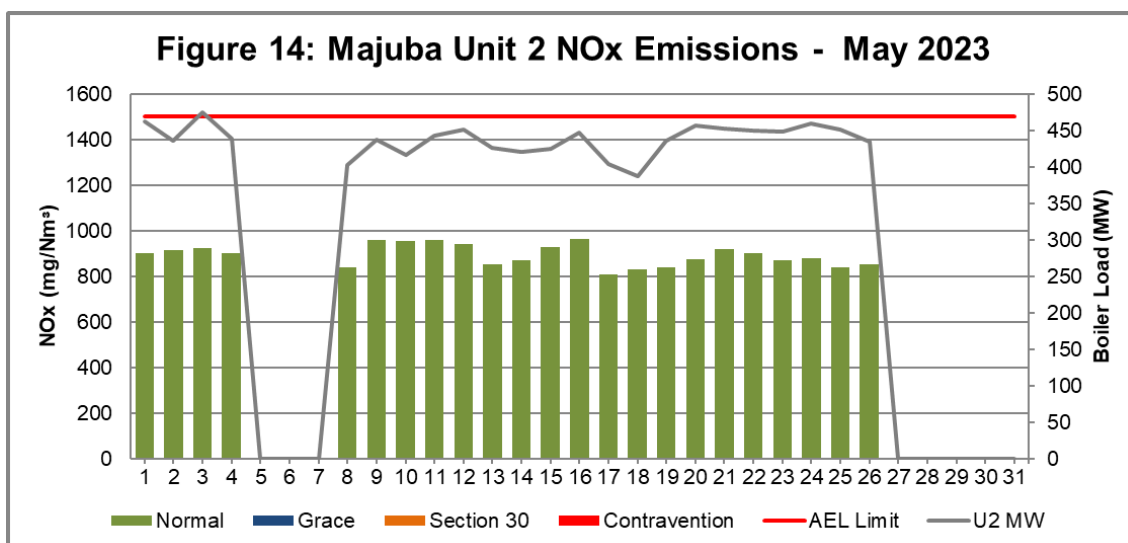


Figure 14. Nox emissions (daily averages) for the month of May 2023 against emission limit for Unit 2.

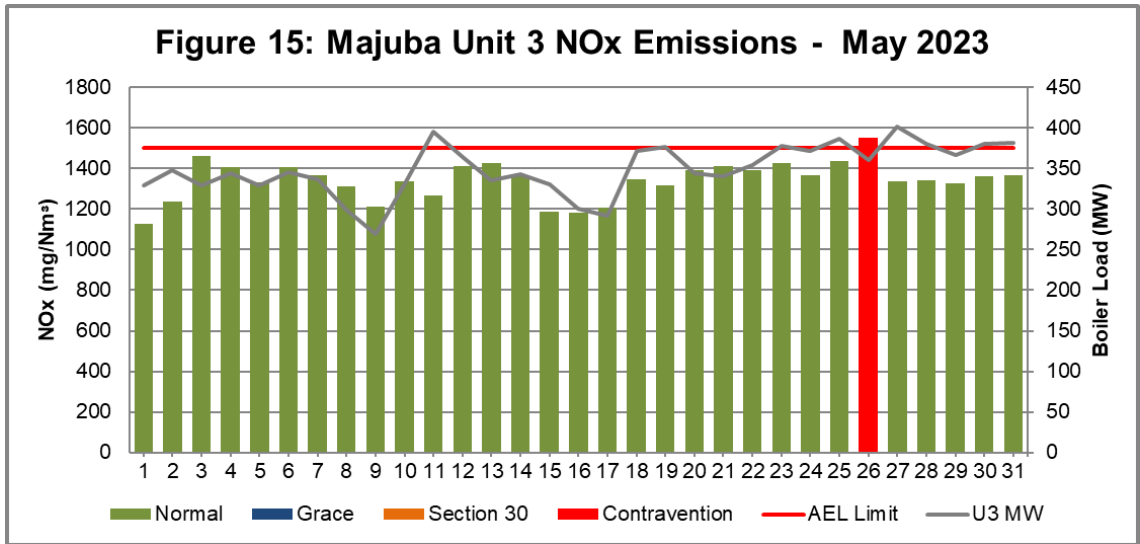


Figure 15. Nox emissions (daily averages) for the month of May 2023 against emission limit for Unit 3.

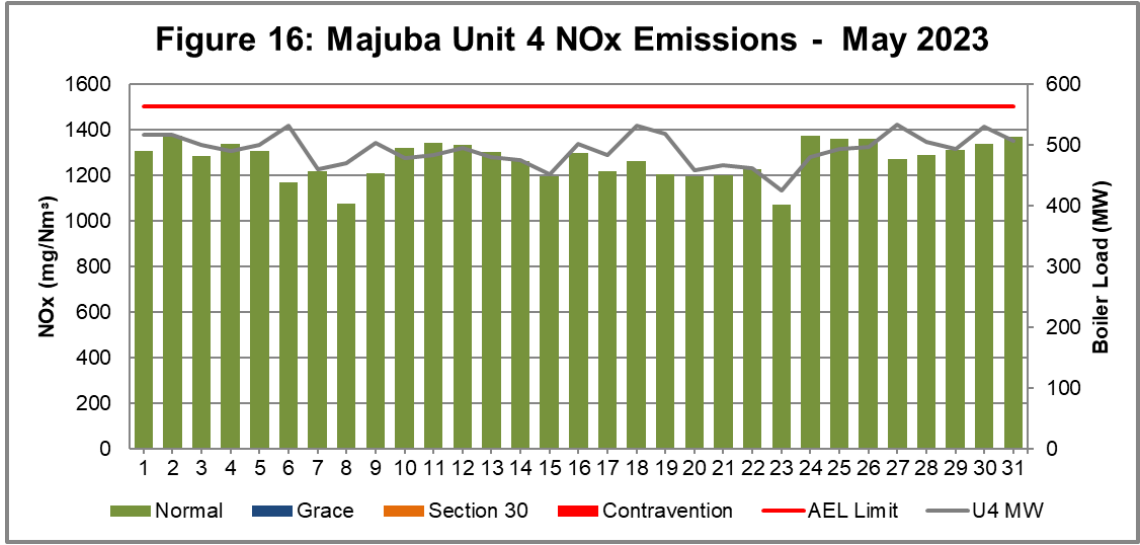


Figure 16. Nox emissions (daily averages) for the month of May 2023 against emission limit for Unit 4

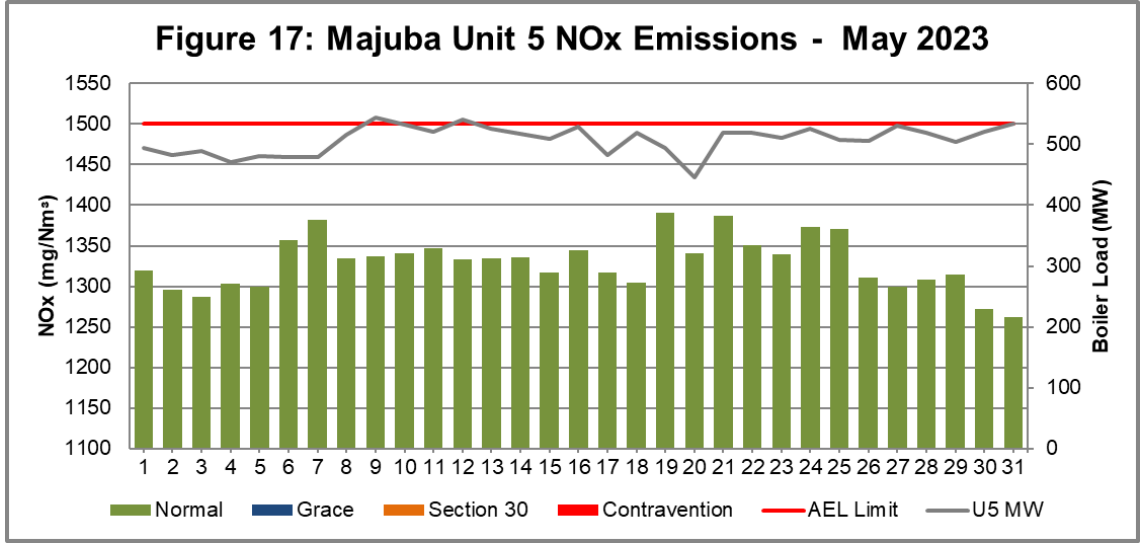


Figure 17. Nox emissions (daily averages) for the month of May 2023 against emission limit for Unit 5

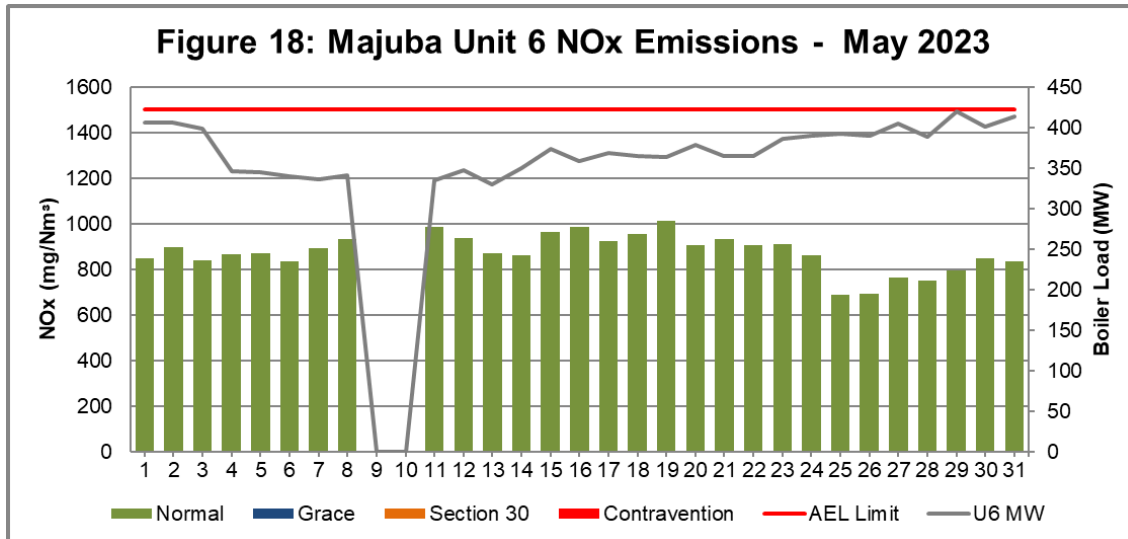


Figure 18. Nox emissions (daily averages) for the month May 2023 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of May 2023

Unit	PM (tons)	SO ₂ (tons)	NOx (tons)
Unit 1	39.3	2 553	1 185
Unit 2	27.7	2 747	1 357
Unit 3	30.2	3 611	1 969
Unit 4	86.1	4 637	2 733
Unit 5	56.3	4 278	2 834
Unit 6	82.4	2 870	1 640

Table 5: Average monthly concentrations (mg/Nm³) for the month of May 2023

Unit	PM (Mg/Nm ³)	SO ₂ (Mg/Nm ³)	NOx (Mg/Nm ³)
1	33.1	2 012.7	942.7
2	19.1	1 809.5	892.2
3	25.2	2 489.6	1 342.4
4	42.9	2 151.8	1 270.7
5	29.4	2 009.6	1 329.3
6	47.1	1 527.9	875.2

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits (SO₂, NO_x, and PM)

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	31	0	0	0	0
Unit 2	22	0	0	0	0
Unit 3	29	0	0	2	2
Unit 4	30	0	0	0	0
Unit 5	31	0	0	0	0
Unit 6	28	0	0	0	0

Table 7: MONITOR RELIABILITY (%)

Associated Unit/Stack	PM	SO ₂	NO	O ₂
Unit 1	100.0	100.0	100.0	100.0
Unit 2	100.0	100.0	100.0	100.0
Unit 3	99.3	100.0	100.0	97.8
Unit 4	100.0	100.0	100.0	100.0
Unit 5	100.0	100.0	100.0	100.0
Unit 6	100.0	85.8	99.4	100.0

T

Table 8: CO₂ and O₂ deviations of the Month of May 2023

*Blank spaces indicate that the unit was offline during that period

CO₂ and O₂ Relationship

	CO ₂ (Actual Dry %)						Final O ₂ CEMS Data (%)						SUM CO ₂ + O ₂ CEMS Data (%)					
	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
2023/05/01	8.1	9.2	8.3	9.6	10.3	8.5	12.1	10.5	12.7	11.5	10.2	10.0	20.2	19.7	21.0	21.1	20.5	18.5
2023/05/02	8.1	9.1	8.4	9.7	10.3	8.5	12.0	10.7	12.8	11.3	10.2	10.1	20.1	19.7	21.2	21.0	20.5	18.6
2023/05/03	7.9	9.2	8.1	9.6	10.6	8.5	12.3	10.6	13.3	11.5	9.9	10.0	20.1	19.7	21.4	21.1	20.4	18.4
2023/05/04	7.8	9.0	8.1	9.4	10.4	8.4	12.3	10.7	13.4	11.8	10.1	10.6	20.1	19.7	21.5	21.2	20.5	19.0
2023/05/05	7.4		8.1	9.2	10.1	8.4	12.8		13.1	11.7	10.4	10.9	20.1		21.1	21.0	20.5	19.3
2023/05/06	7.8		8.5	9.8	10.0	8.4	12.4		12.5	11.0	10.7	10.9	20.1		21.0	20.8	20.6	19.3
2023/05/07	7.6		8.3	8.8	9.8	8.3	12.4		12.8	12.4	10.9	10.7	20.1		21.0	21.1	20.7	18.9
2023/05/08	8.0	8.1	7.9	8.7	10.2	8.3	11.9	11.1	13.1	12.3	10.4	10.5	20.0	19.2	21.0	21.0	20.5	18.9
2023/05/09	7.9	8.5	7.3	8.9	10.5		12.0	11.7	13.7	12.3	10.0		19.9	20.2	21.0	21.2	20.5	
2023/05/10	7.7	8.5	7.8	8.5	10.4		12.2	11.3	13.3	12.5	10.2		19.9	19.8	21.1	21.0	20.6	
2023/05/11	7.6	8.8	8.9	8.6	9.9	8.6	12.3	11.0	12.0	12.5	10.7	11.7	19.9	19.7	20.9	21.1	20.6	20.3
2023/05/12	7.6	8.9	8.7	8.9	10.3	8.5	12.3	10.7	12.3	12.1	10.2	11.3	19.9	19.6	21.0	21.0	20.5	19.8
2023/05/13	7.7	8.6	8.1	9.0	10.3	8.4	12.3	11.0	13.0	11.9	10.3	11.2	20.1	19.6	21.1	20.9	20.6	19.6
2023/05/14	7.9	8.3	8.2	9.0	10.3	8.4	12.1	11.3	12.8	12.0	10.4	11.2	20.1	19.6	21.0	20.9	20.6	19.5
2023/05/15	7.7	8.4	8.0	8.6	10.2	8.4	12.7	11.2	12.4	12.4	10.5	10.8	20.4	19.7	20.4	21.0	20.7	19.1
2023/05/16	7.7	8.7	7.8	9.0	10.1	8.4	12.7	11.2	12.7	12.1	10.6	11.1	20.4	19.9	20.4	21.0	20.7	19.5
2023/05/17	7.7	8.0	7.5	8.7	9.9	8.4	12.5	11.8	13.5	12.3	10.7	10.9	20.2	19.9	21.0	21.0	20.6	19.4
2023/05/18	7.5	7.8	8.3	9.5	10.2	8.4	12.5	11.9	12.8	11.3	10.2	10.9	20.0	19.7	21.1	20.8	20.4	19.3
2023/05/19	7.4	8.5	8.3	9.3	9.6	8.4	12.8	11.0	12.9	11.6	11.0	10.9	20.1	19.5	21.1	20.9	20.5	19.3
2023/05/20	7.4	8.9	7.9	8.7	9.1	8.4	13.0	10.6	13.2	12.0	11.4	10.5	20.4	19.5	21.0	20.7	20.6	18.9
2023/05/21	7.2	9.0	8.2	8.9	9.8	8.4	13.0	11.0	12.9	11.8	10.7	10.7	20.2	20.0	21.1	20.7	20.5	19.1
2023/05/22	7.3	8.7	8.0	8.7	10.0	8.4	12.5	11.1	13.2	12.3	10.5	10.8	19.8	19.8	21.1	21.0	20.4	19.2
2023/05/23	7.4	8.9	8.4	8.1	10.0	8.4	12.1	11.1	12.6	11.1	10.5	10.4	19.5	20.0	21.0	19.2	20.5	18.9
2023/05/24	7.4	8.8	8.5	8.9	10.3	8.5	11.1	11.1	12.4	12.1	10.7	10.4	18.5	19.8	20.9	21.0	21.0	18.9
2023/05/25	7.5	8.9	8.7	9.2	9.8	8.5	11.0	10.6	12.2	11.8	10.9	10.1	18.6	19.5	20.9	21.0	20.7	18.7
2023/05/26	7.5	8.3	8.4	9.4	10.2	8.5	10.7	11.1	12.3	11.5	10.2	10.1	18.2	19.4	20.6	20.9	20.4	18.6
2023/05/27	7.4		9.0	9.9	10.7	8.4	10.6		11.7	10.8	9.8	9.6	18.1		20.7	20.7	20.5	18.0
2023/05/28	7.5		8.6	9.3	10.6	8.4	11.0		12.3	11.6	9.9	9.9	18.5		21.0	20.9	20.5	18.3
2023/05/29	7.5		8.3	9.0	10.4	8.6	10.7		12.8	11.9	10.2	9.9	18.1		21.1	21.0	20.6	18.5
2023/05/30	7.5		8.4	9.5	11.0	8.4	10.8		12.7	11.3	9.4	10.3	18.3		21.1	20.9	20.4	18.7
2023/05/31	7.5		8.5	9.3	11.1	8.4	10.9		12.6	11.5	9.3	10.2	18.4		21.1	20.9	20.3	18.7
	7.6	8.6	8.2	9.1	10.2	8.4	12.0	11.1	12.8	11.8	10.4	10.6	19.6	19.7	21.0	20.9	20.5	19.0

Calculation: CO₂% + O₂% = 19.5-21.5%

Emergency Generation

Table 9: Emergency Generation for the month of May 2023

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

Comments on the performance and availability of each unit

UNIT 1

The unit base loaded for all of the days during the month. Nineteen fabric filter bags were replaced during the month.

UNIT 2

The unit base loaded for most of the days during the month and off for eight days. Thirty-four fabric filter bags were replaced during the month.

UNIT 3

The unit base loaded for all of the days during the month. One hundred eight-seven fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for all of the days during the month. Sixteen fabric filter bags were replaced during the month.

UNIT 5

The unit base loaded for all of the days during the month. Twenty-three fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for most of the days during the month and off for eight days. Nine fabric filter bags were replaced during the month.

Complaints Register

Table 10: Complaints for the month of May 2023


Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modelling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received during the month of May 2023.				

General

Fuel oil consumption for the month of May 2023 exceeded the AEL limit of 6000 tons and the station is currently implementing an action plan to address the high fuel oil consumption associated with mills capability support. Unit 3 exceeded the SO2 limit on the 17th of May 2023 and NOx on the 26th of May 2023. The preliminary investigation indicates that these are linked to the March exceedances. The investigation report has not been finalized because of parallel tests that need to be carried out as part of the investigation. It will be submitted as soon as it is finalized.

Yours sincerely

Report compiled by:



Faith Kagoda
ENVIRONMENTAL MANAGER: (MAJUBA)

Date 09/06/2023

Report verified by:



Lindani Madonsela
BOILER ENGINEERING MANAGER: (MAJUBA)

Date 12 June 2023

Report approved by:



Johan Swanepoel
ENGINEERING MANAGER: (MAJUBA)

12/06/2023
Date