

Ms Nompulelo Simelane
 Nkangala District Municipality
 PO BOX 437
Middelburg
 1050

Date:
 26 September 2023

Enquiries:
 Livhuwani Tshilate
 017 615 2317

Ref: 17/4/AEL/MP312/11/09

Dear Ms. Simelane

KRIEL POWER STATION'S MONTHLY STACK EMISSIONS REPORT FOR THE MONTH OF AUGUST 2023

This serves as the monthly report required in terms of Section 7.4 in Kriel Power Station's Atmospheric Emission License 17/4/AEL/MP312/11/09. The emissions are for the month of August 2023. Verified emissions of particulates matter, SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table 1: Quantity of Raw Materials and Products used/produced for the month of August 2023

Raw Materials and Products used	Raw Material Type	Units	Maximum Permitted Consumption / Rate (Quantity)	Consumption / Rate in Month of August 2023
	Coal	Tons/month	1 227 600	673 566.20
	Fuel Oil	Tons/month	5 000	2989.227
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of August 2023
	Ash	Tons/month	not specified	864.67
	RE PM	kg/MWh	not specified	0.71

1/...

Abatement Technology

Table 2: Abatement Equipment Control Technology for August 2023.

Associated Unit/Stack	Technology Type	Actual Efficiency (%)	Utilisation
		August 2023	August 2023
Unit 1	ESP	98.68%	0.59%
Unit 2	ESP	Unit offline	Unit offline
Unit 3	ESP	99.32%	99.91%
Unit 4	ESP	99.59%	100.0%
Unit 5	ESP	99.47%	100.0%
Unit 6	ESP	99.54%	100.0%

Energy Source Characteristics

Table 3: Energy Source Material Characteristics for the month of August 2023





Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.6-1.2 (%)	0.760
Ash Content	27-32 (%)	26.400

Monthly Monitor Reliability

Associated Unit/Stack	PM (%)	SO _x (%)	NO _x (%)
North	90.30	91.21	100.00
South	99.58	4.74	100.00

Emissions Reporting

Table 6.5: Graph Legend Description

Condition	Colour	Description
Normal		Emissions below Emission Limit Value (ELV)
Grace		Emissions above the ELV during grace period
Section 30		Emissions above ELV during a NEMA S30 incident
Contravention		Emissions above ELV but outside grace or S30 incident conditions

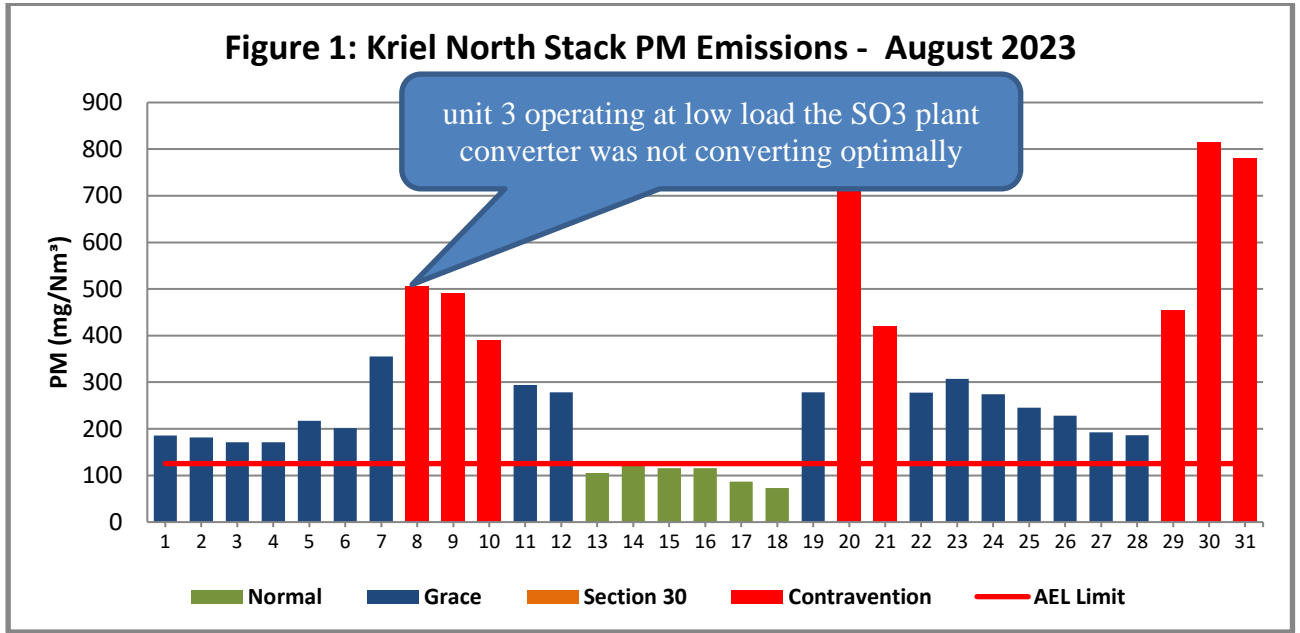


Figure 1: PM emissions for the month of August 2023 against emission limit for the North Stack. Monthly average was 299.1 mg/Nm³

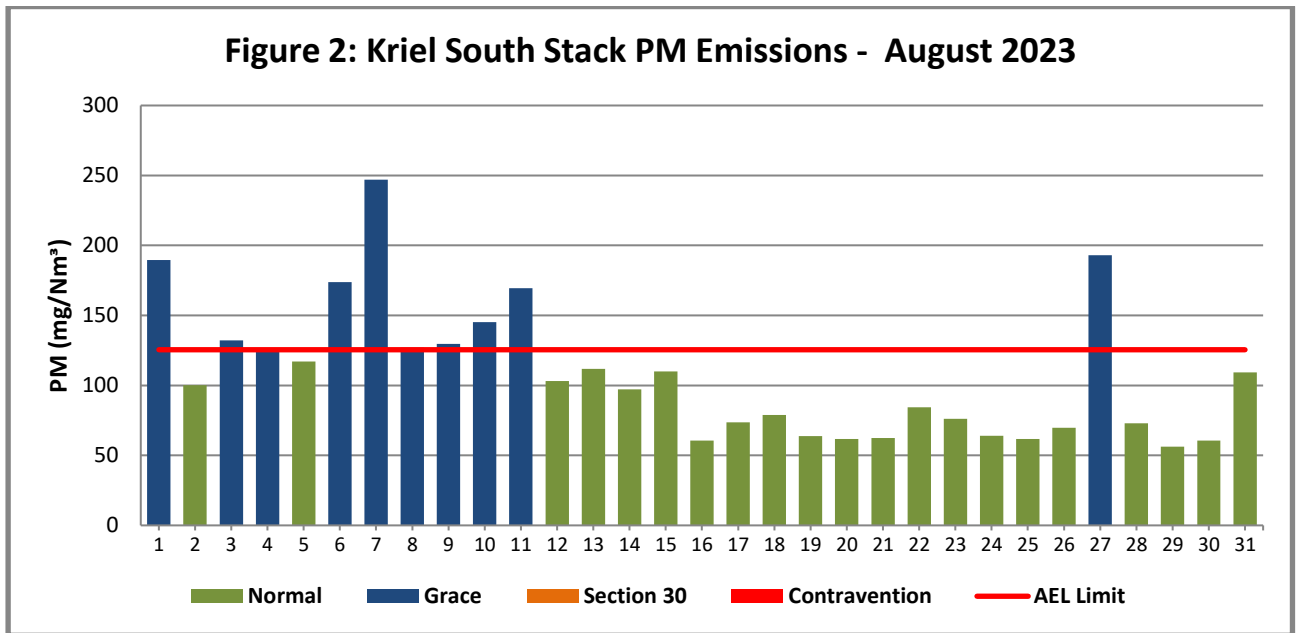


Figure 2: PM emissions for the month of August 2023 against emission limit for the South Stack. Monthly average was 107.4 mg/Nm³

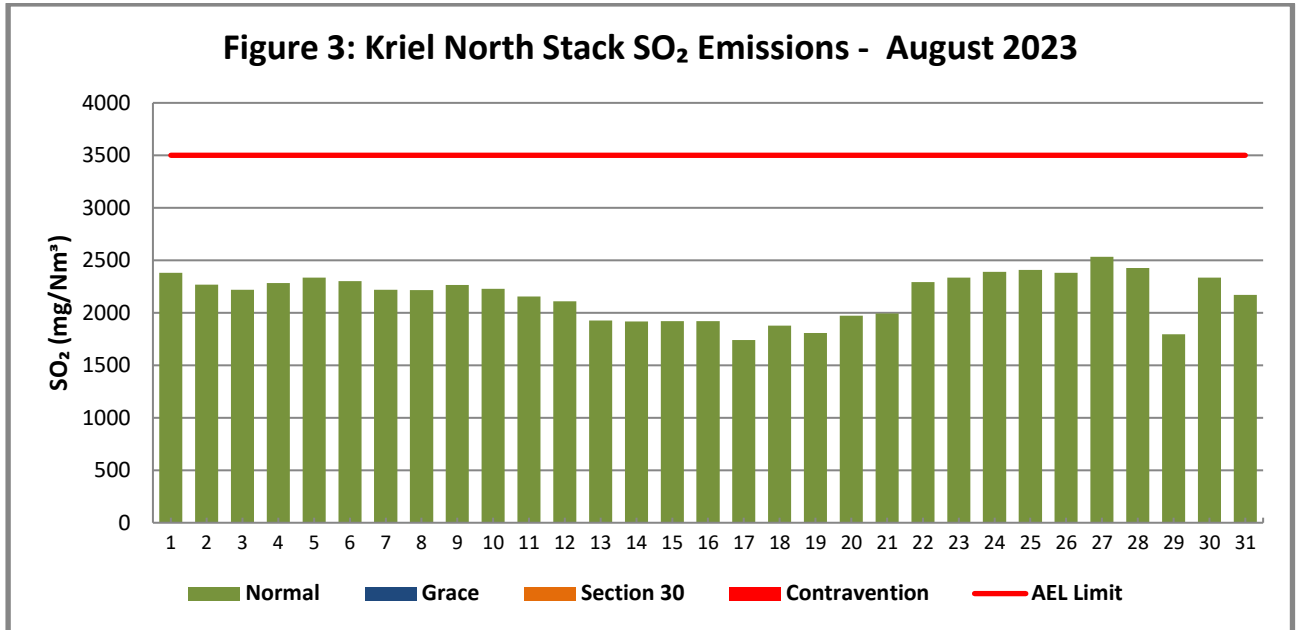


Figure 3. SO₂ emissions for the month of August 2023 against emission limit for the North Stack. The SO_x Limit is 3500mg/Nm³.

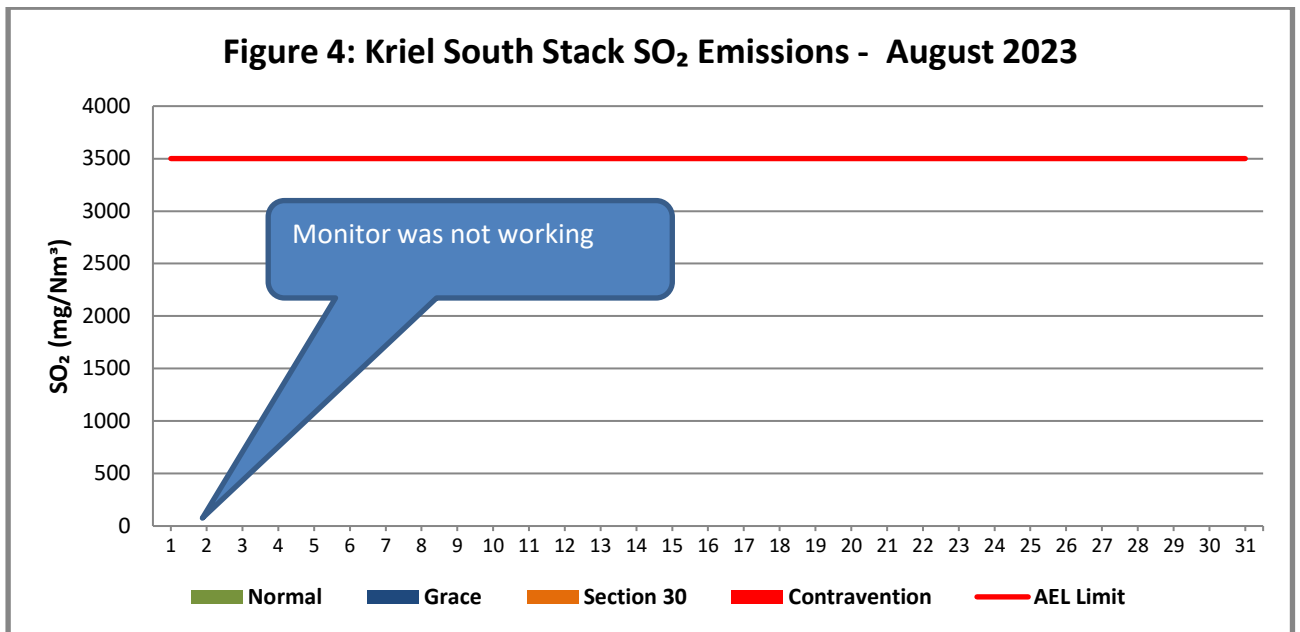


Figure 4. SO₂ emissions for the month of August 2023 against emission limit for the South Stack. The SO_x Limit is 3500mg/Nm³.

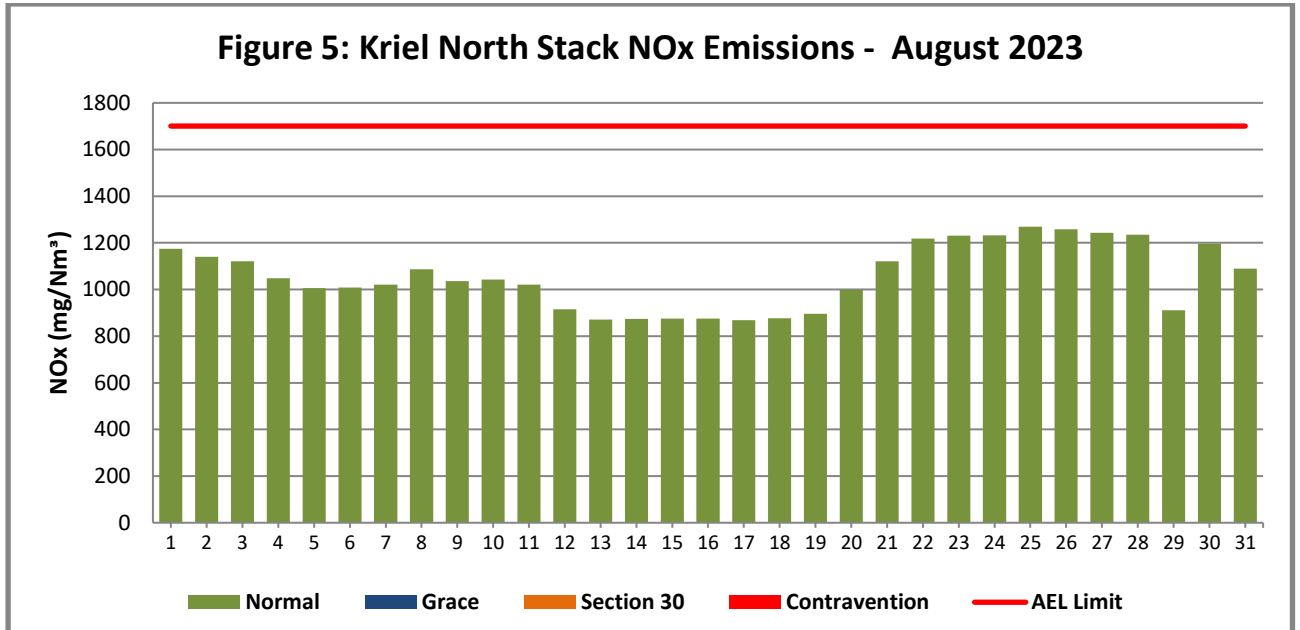


Figure 5. NO₂ emissions for the month of August 2023 against emission limit for the North Stack. The NO_x Limit is 1600mg/Nm³.

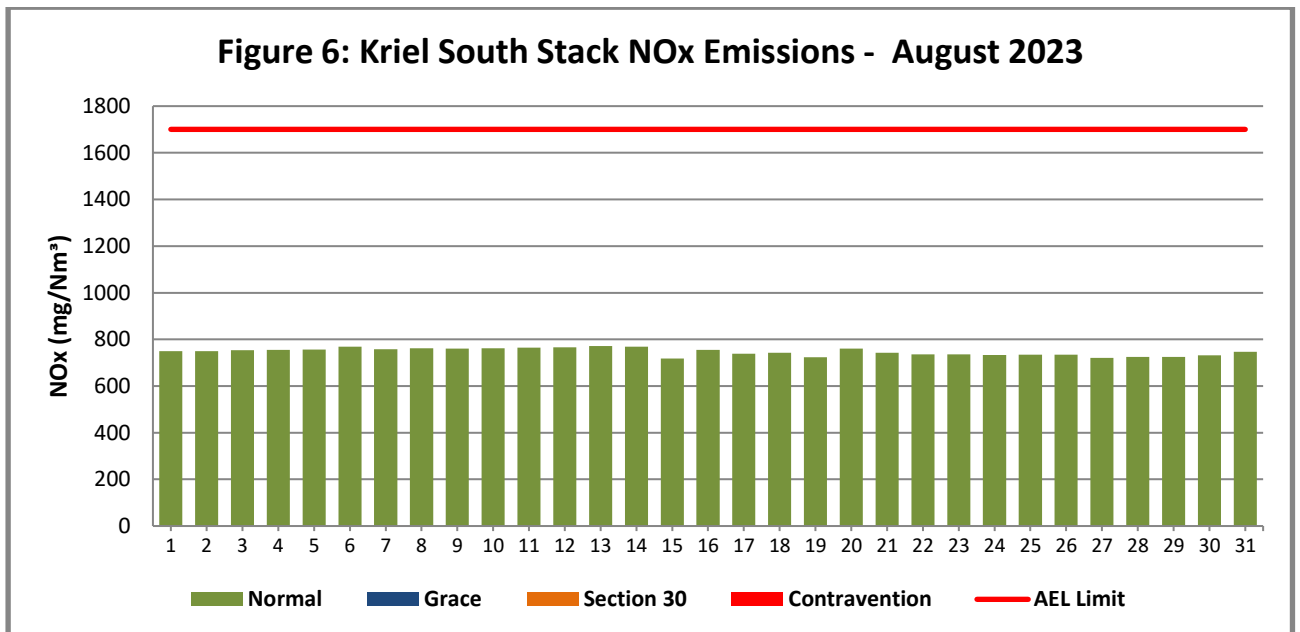


Figure 6. NO₂ emissions for the month of August 2023 against emission limit for the South Stack. The NO_x Limit is 1600mg/Nm³.

Table 4: Monthly tonnages for the month August 2023

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
SUM	864.7	3791.3	4572.0

Table 5: Each unit and respective days operating under normal operation and section 30 days respectively

Table 5.1: Operating days in non-compliance to PM AEL Limit – August 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Monthly Limit Exceedance	Average PM (mg/Nm ³)
North	06	15	0	08	31	299.1
South	21	10	0	0	10	107.4

Table 5.2: Operating days in compliance to SOx AEL Limit - August 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm ³)
North	31	0	0	0	0	2 168.8
South	0	0	0	0	0	0

Table 5.3: Operating days in compliance to NOx AEL Limit – August 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm ³)
North	31	0	0	0	0	1 056.6
South	31	0	0	0	0	747.0

Light up information

Table 6: PM Start-up information for the month of August 2023

North Stack	Event 1		Event 2		Event 3		Event 4	
Unit No.	no event		Unit 3		Unit 1		no event	
Breaker Open (BO)			6:15 pm	2023/08/05	12:25 pm	2023/08/11	10:05 pm	2023/08/14
Draught Group (DG) Shut Down (SD)			7:25 pm	2023/08/05	2:10 am	2023/08/12	6:45 am	2023/08/17
BO to DG SD (duration)		DD: HH:MM	00:01:10	DD: HH:MM	00:13:45	DD: HH:MM	02:08:40	DD: HH:MM
Fires in time			11:50 pm	2023/08/05	1:45 pm	2023/08/18		
Synch. to Grid (or BC)			9:10 am	2023/08/06	8:05 pm	2023/08/18		
Fires into BC (duration)		DD: HH:MM	00:09:20	DD: HH:MM	00:06:20	DD: HH:MM		DD: HH:MM
Emissions below limit from BC (end date)			not > limit	not > limit	not > limit	not > limit		
Emissions below limit from BC (duration)		DD: HH:MM	n/a	DD: HH:MM	n/a	DD: HH:MM		DD: HH:MM

North Stack ...Cont.	Event 1		Event 2		Event 3		Event 4	
Unit No.	no event		no event		no event		no event	
Breaker Open (BO)	3:15 am	2023/08/31	2:30 pm	2023/08/20				
Draught Group (DG) Shut Down (SD)	4:15 pm	2023/08/31	6:40 am	2023/08/21				
BO to DG SD (duration)	00:13:00	DD: HH:MM	00:16:10	DD: HH:MM		DD: HH:MM		DD: HH:MM
Fires in time								
Synch. to Grid (or BC)								
Fires into BC (duration)		DD: HH:MM		DD: HH:MM		DD: HH:MM		DD: HH:MM
Emissions below limit from BC (end date)								
Emissions below limit from BC (duration)		DD: HH:MM		DD: HH:MM		DD: HH:MM		DD: HH:MM

South Stack	Event 1		Event 2		Event 3		Event 4	
Unit No.	no event		Unit 4		Unit 5		Unit 6	
Breaker Open (BO)			6:20 pm	2023/08/08	3:35 am	2023/08/04	5:00 am	2023/08/04
Draught Group (DG) Shut Down (SD)			DG did not trip or SD	DG did not trip or SD	4:05 pm	2023/08/04	5:25 am	2023/08/04
BO to DG SD (duration)		DD: HH:MM	n/a	DD: HH:MM	00:12:30	DD: HH:MM	00:00:25	DD: HH:MM
Fires in time			6:20 pm	2023/08/08	7:40 pm	2023/08/07	11:40 am	2023/08/04
Synch. to Grid (or BC)			8:00 pm	2023/08/08	3:05 am	2023/08/09	8:40 pm	2023/08/04
Fires into BC (duration)		DD: HH:MM	00:01:40	DD: HH:MM	01:07:25	DD: HH:MM	00:09:00	DD: HH:MM
Emissions below limit from BC (end date)			not > limit	not > limit	not > limit	not > limit	not > limit	not > limit
Emissions below limit from BC (duration)		DD: HH:MM	n/a	DD: HH:MM	n/a	DD: HH:MM	n/a	DD: HH:MM

South Stack ...Cont.	Event 1		Event 2		Event 3		Event 4	
Unit No.	no event		Unit 5		Unit 6		Unit 6	
Breaker Open (BO)	9:55 pm	2023/08/21	10:10 pm	2023/08/16	11:45 am	2023/08/13	6:05 pm	2023/08/28
Draught Group (DG) Shut Down (SD)	10:55 pm	2023/08/21	10:55 pm	2023/08/16	12:35 pm	2023/08/13	7:10 pm	2023/08/28
BO to DG SD (duration)	00:01:00	DD: HH:MM	00:00:45	DD: HH:MM	00:00:50	DD: HH:MM	00:01:05	DD: HH:MM
Fires in time			3:00 am	2023/08/17	5:00 pm	2023/08/13	6:55 am	2023/08/29
Synch. to Grid (or BC)			6:45 pm	2023/08/17	3:40 am	2023/08/14	2:20 pm	2023/08/29

Fires into BC (duration)		DD: HH:MM 00:15:45	DD: HH:MM 00:10:40	DD: HH:MM 00:07:25	DD: HH:MM
Emissions below limit from BC (end date)		<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>	<i>not > limit</i>
Emissions below limit from BC (duration)		DD: HH:MM <i>n/a</i>	DD: HH:MM <i>n/a</i>	DD: HH:MM <i>n/a</i>	DD: HH:MM

Complaints Register

Table 9: Complaints for the month of August 2023.

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
There was no complaint related to air quality received during the month of August 2023.					

General

The particulate matter (PM10) emissions on the North Common Stack exceeded the **monthly limit**; on average emissions figure of **299.1 mg/Nm3** while South Common Stack also exceeded the **monthly limit** on the recorded PM10 monthly average figure of **107.4 mg/Nm3**. The gaseous (NOx & SOx) emissions on the North and South common Stacks were within the **daily limit** during the month of August 2023; refer to graphs above.

NB: The rest of the information demonstrating compliance with the emissions license conditions is supplied in the annual emission reports sent to your office.

Kriel Power Station’s List of NEMA Section 30 Incidents for 2023/2024 Financial Year

Month	Description of Section 30 Incidents - including the reference number	Root Cause (s)	Status of S30 Incident with DEFF (open or closed)	Remarks
April-2023	South Stack High Emissions	Unit 4 A EFP plant breakdown causing half load conditions which calls for operating the unit with fuel oil support to badly impacting the stack emissions	Open	
May - 2023	North Stack High Emissions	Unit 4 A EFP plant breakdown causing half load conditions which calls for operating the unit with fuel oil support to badly impacting the stack emissions	Open	
May - 2023	South Stack High Emissions	Unit 4 A EFP plant breakdown causing half load conditions which calls for operating the unit	Open	

		with fuel oil support to badly impacting the stack emissions		
June – 2023	North Stack High Emissions	Units operating at half load conditions which affects the sulphur dosing and causes the plant to operate with fuel oil support because of high turbine back pressure, low final feedwater temperature, high works power loss from high usage of electric feed pump and dust handling plant because of dust transportation resulting in high stack emissions	Open	
June - 2023	South Stack High Emissions	Units operating at half load conditions which affects the sulphur dosing and causes the plant to operate with fuel oil support because of high turbine back pressure, low final feedwater temperature, high works power loss from high usage of electric feed pump and dust handling plant because of dust transportation resulting in high stack emissions	Open	
July - 2023	North Stack High Emissions	The north stack emissions daily average has significantly reduced as results of shutting of unit 2 outage for the planned GO outage. However, due to the isolation of cooling tower number 2 for the cooling tower fills replacement project, unit 3 is		

		operating at low loads to condenser vacuum high. The half load conditions mean supporting the unit with oil burners to support combustion and sulphur trioxide (SO3) not in service. The south stack PM emission daily average has significantly reduced since synchronisation of units from half station shutdown.		
Aug - 2023	North Stack High Emissions	The north stack emissions exceedance was due to RH1 and RH2 poor field performance (high spark rates) which resulted in ESP reduced collection efficiency. The reduced field performance on the first field was as results of high hoppers, which resulted from an ash backlog on the dust handling plant.		
Sep - 2023				
Oct - 2023				
Nov - 2023				
Dec - 2023				
Jan - 2024				
Feb - 2024				
Mar - 2024				