

Ms Nompulelo Simelane
 Nkangala District Municipality
 PO BOX 437
Middelburg
 1050

Date:
 19 January 2024

Enquiries:
 Livhuwani Tshilate
 017 615 2317

Ref: 17/4/AEL/MP312/11/09

Dear Ms. Simelane

KRIEL POWER STATION'S MONTHLY STACK EMISSIONS REPORT FOR THE MONTH OF OCTOBER 2023

This serves as the monthly report required in terms of Section 7.4 in Kriel Power Station's Atmospheric Emission License 17/4/AEL/MP312/11/09. The emissions are for the month of October 2023. Verified emissions of particulates matter, SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table 1: Quantity of Raw Materials and Products used/produced for the month of October 2023

Raw Materials and Products used	Raw Material Type	Units	Maximum Permitted Consumption / Rate (Quantity)	Consumption / Rate in Month of October 2023
	Coal	Tons/month	1 227 600	673 566.200
	Fuel Oil	Tons/month	5 000	2 583.828
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of October 2023
	Ash	Tons/month	not specified	177 821.477
	RE PM	kg/MWh	not specified	0.751

1/...

Abatement Technology

Table 2: Abatement Equipment Control Technology for October 2023.

Associated Unit/Stack	Technology Type	Actual Efficiency (%)	Utilisation
		October 2023	October 2023
Unit 1	ESP	98.57%	0.4%
Unit 2	ESP	Outage	Outage
Unit 3	ESP	99.04%	80.4%
Unit 4	ESP	Outage	Outage
Unit 5	ESP	98.59%	100.0%
Unit 6	ESP	Outage	Outage

Energy Source Characteristics

Table 3: Energy Source Material Characteristics for the month of October 2023

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.6-1.2 (%)	0.760
Ash Content	27-32 (%)	26.400

Monthly Monitor Reliability

Associated Unit/Stack	PM (%)	SO _x (%)	NO _x (%)
North	98.20	93.29	100.00
South	67.56	100.00	100.00

Emissions Reporting

Table 6.5: Graph Legend Description

Condition	Colour	Description
Normal	Green	Emissions below Emission Limit Value (ELV)
Grace	Blue	Emissions above the ELV during grace period
Section 30	Orange	Emissions above ELV during a NEMA S30 incident
Contravention	Red	Emissions above ELV but outside grace or S30 incident conditions

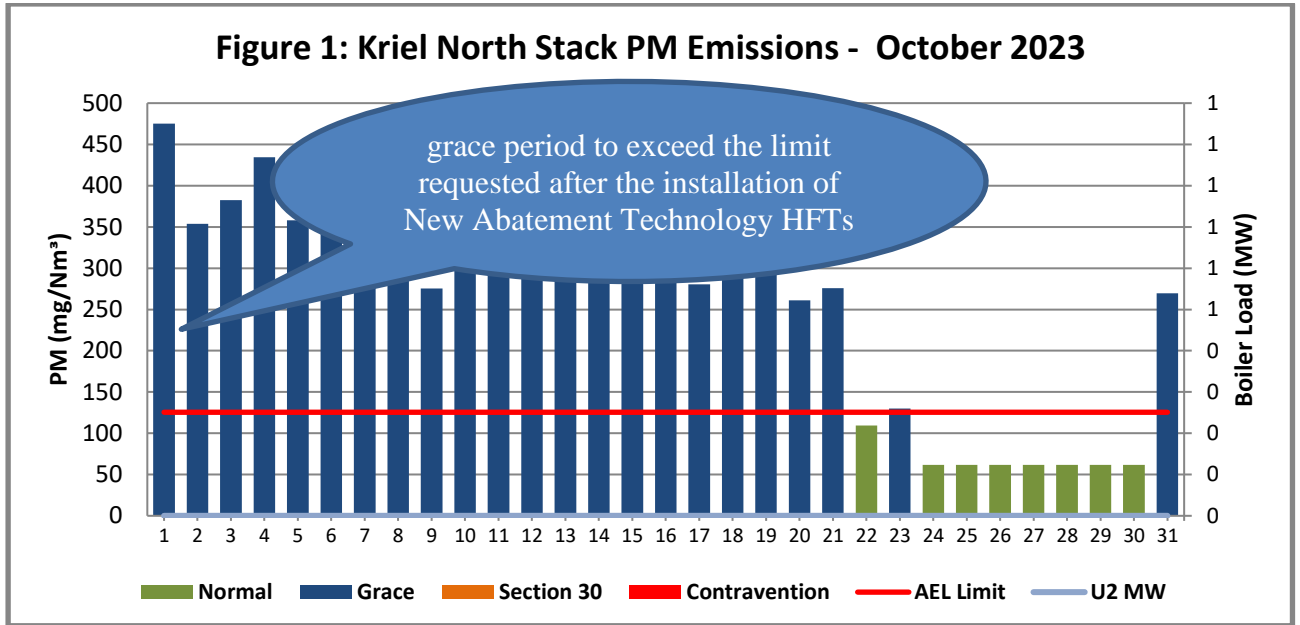


Figure 1: PM emissions for the month of October 2023 against emission limit for the North Stack. Monthly average was 269.5 mg/Nm³.

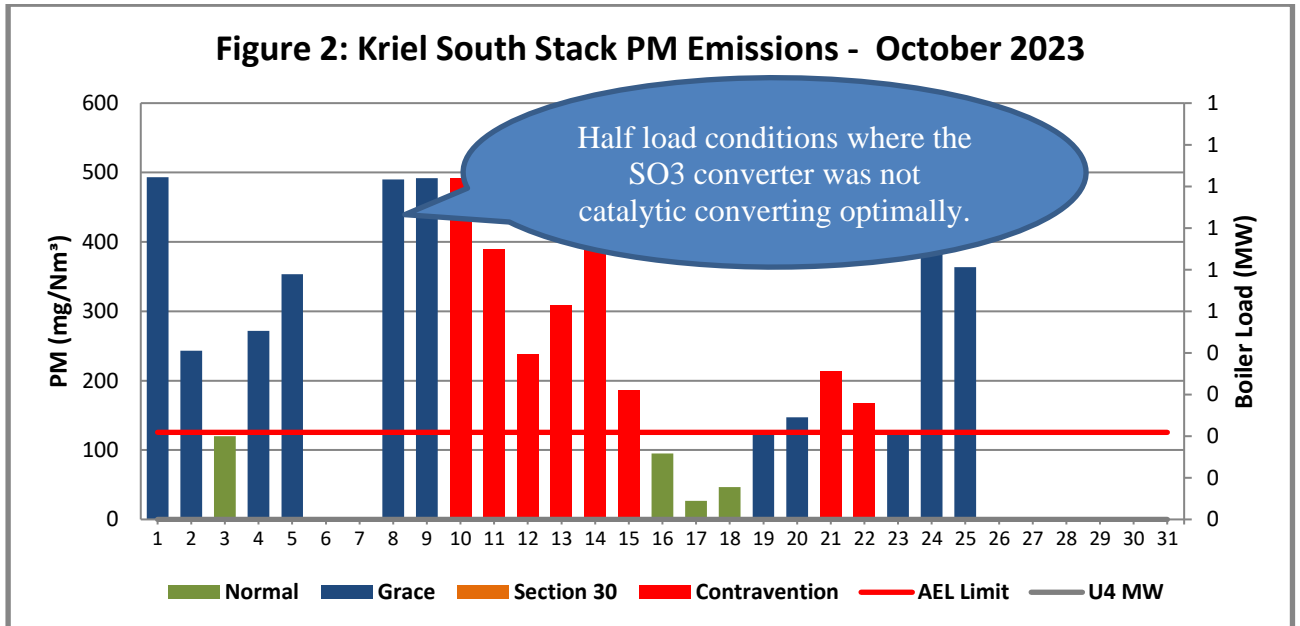


Figure 2: PM emissions for the month of October 2023 against emission limit for the South Stack. Monthly average was 275.1 mg/Nm³.

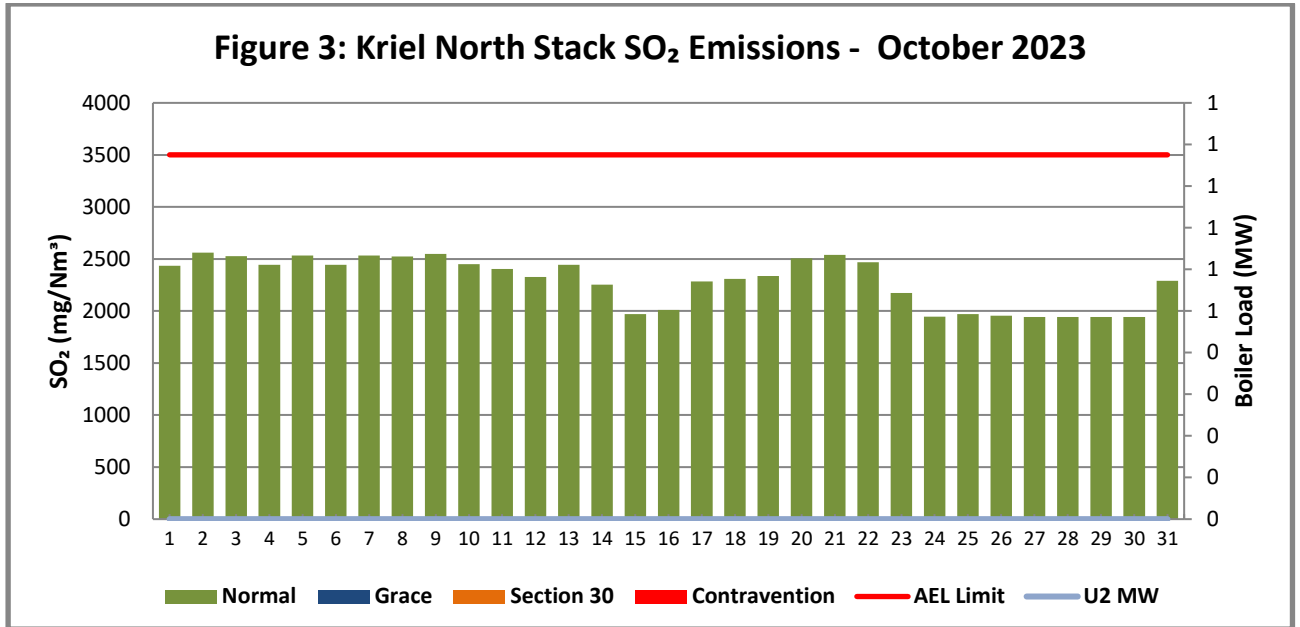


Figure 3. SO₂ emissions for the month of October 2023 against emission limit for the North Stack. The SO_x Limit is 3500mg/Nm³.

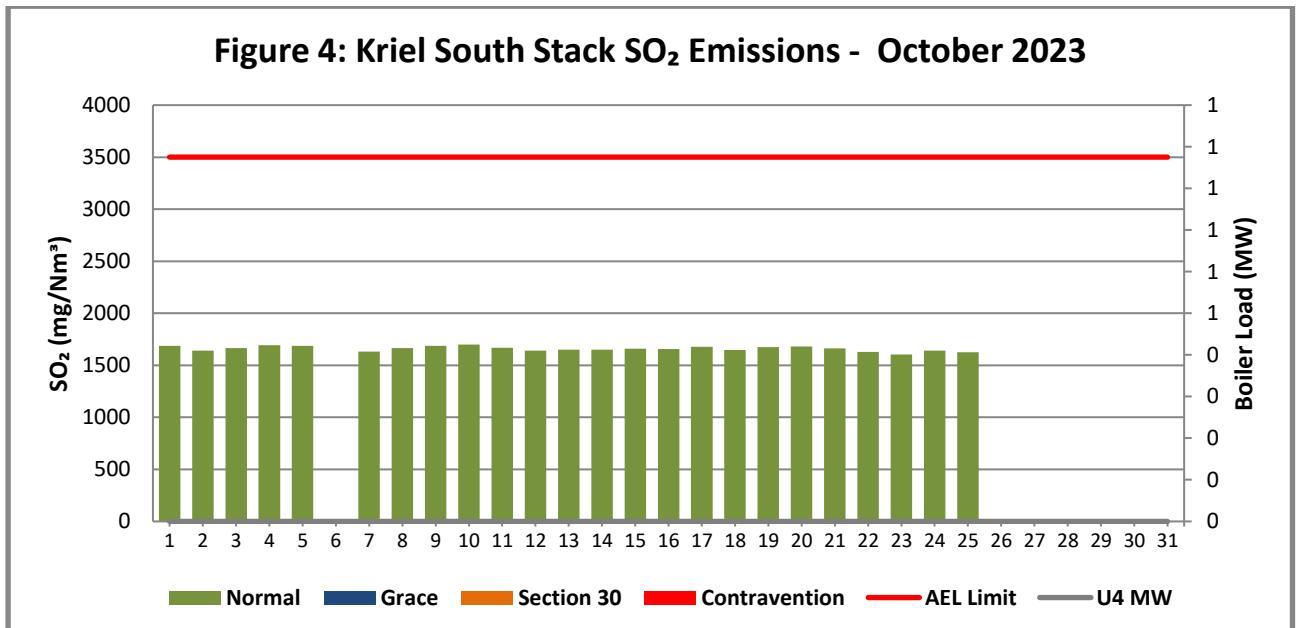


Figure 4. SO₂ emissions for the month of October 2023 against emission limit for the South Stack. The SO_x Limit is 3500mg/Nm³.

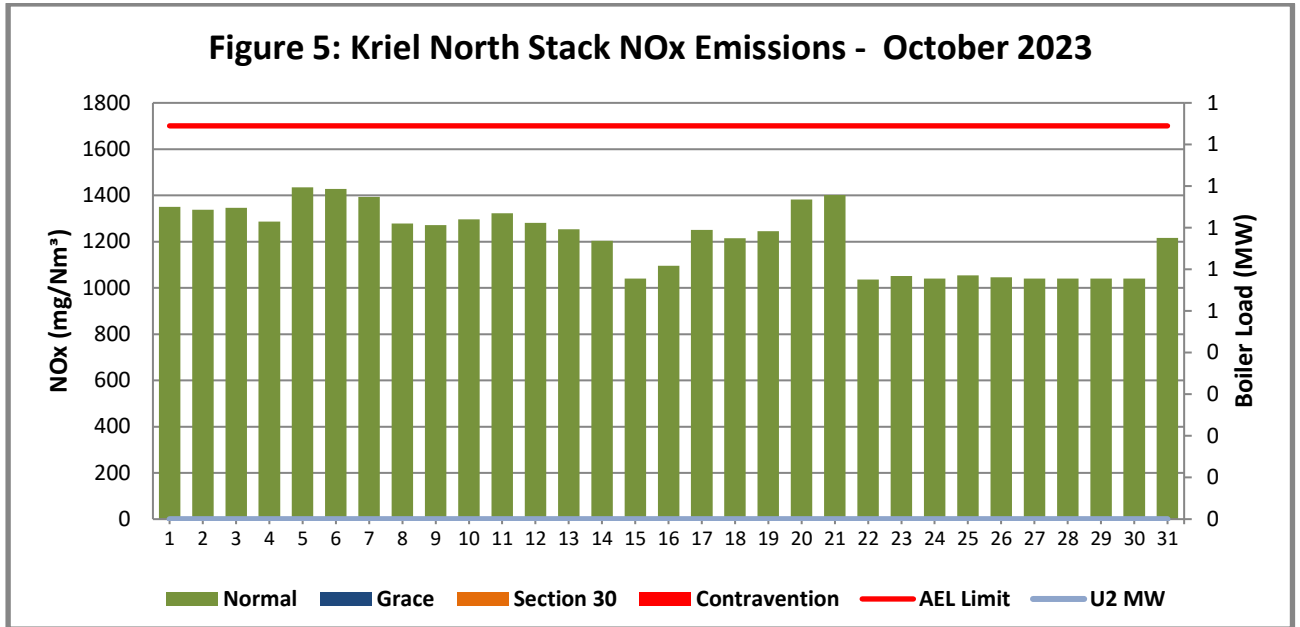


Figure 5. NO₂ emissions for the month of October 2023 against emission limit for the North Stack. The NO_x Limit is 1600mg/Nm³.

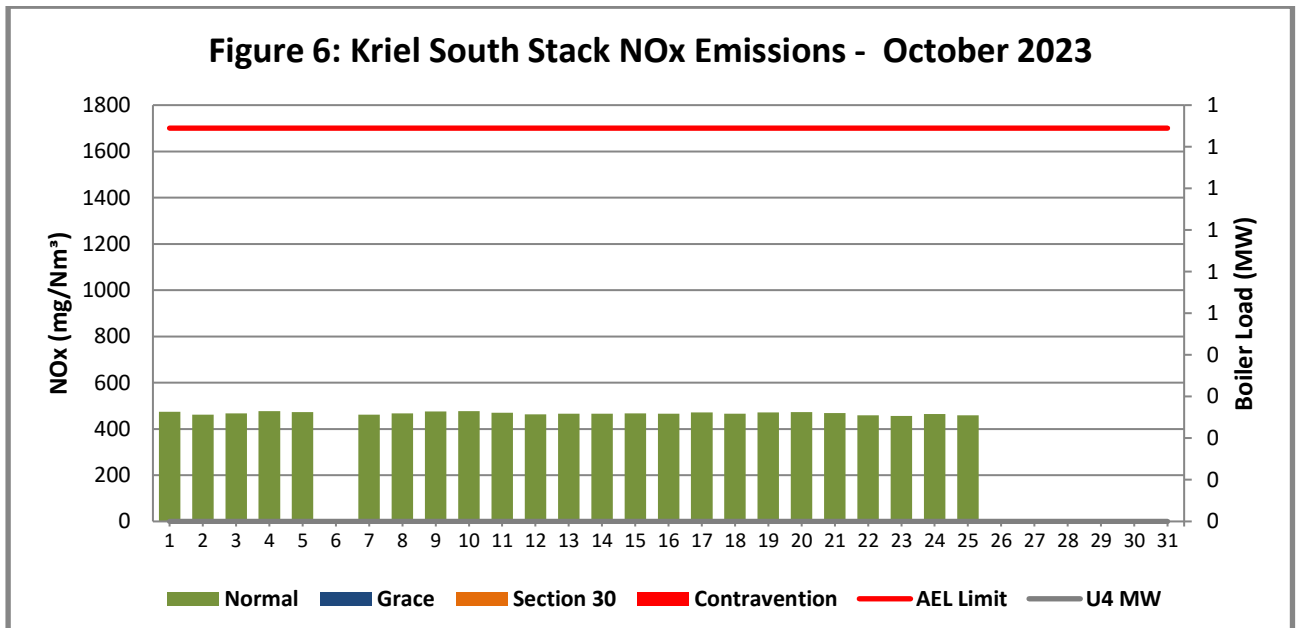


Figure 6. NO₂ emissions for the month of October 2023 against emission limit for the South Stack. The NO_x Limit is 1600mg/Nm³.

Table 4: Monthly tonnages for the month October 2023

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
SUM	913.0	6 778.1	3 120.3

Table 5: Each unit and respective days operating under normal operation and section 30 days respectively.

Table 5.1: Operating days in non-compliance to PM AEL Limit – October 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Monthly Limit Exceedance	Average PM (mg/Nm ³)
North	08	23	0	0	23	269.5
South	04	11	0	08	19	275.1

Table 5.2: Operating days in compliance to SOx AEL Limit - October 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm ³)
North	31	0	0	0	0	2 289.1
South	24	0	0	0	0	1 659.4

Table 5.3: Operating days in compliance to NOx AEL Limit – October 2023

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm ³)
North	31	0	0	0	0	1 216.7
South	24	0	0	0	0	467.5

Light up information

Table 6: PM Start-up information for the month of October 2023

North Stack	Event 1		Event 2		Event 3		Event 4	
Unit No.	Unit 3		Unit 3		Unit 3		Unit 3	
Breaker Open (BO)	8:45 am	2023/10/21	12:20 pm	2023/10/16	4:10 pm	2023/10/27	9:45 am	2023/10/13
Draught Group (DG) Shut Down (SD)	10:35 pm	2023/10/21	1:15 pm	2023/10/16	9:35 am	2023/10/28	11:50 am	2023/10/13
BO to DG SD (duration)	00:13:50	DD:HH:MM	00:00:55	DD:HH:MM	00:17:25	DD:HH:MM	00:02:05	DD:HH:MM
Fires in time	3:55 pm	2023/10/18	2:20 pm	2023/10/25	2:20 am	2023/10/29		
Synch. to Grid (or BC)	10:40 pm	2023/10/18	6:35 pm	2023/10/25	6:40 am	2023/10/29		
Fires in to BC (duration)	00:06:45	DD:HH:MM	00:04:15	DD:HH:MM	00:04:20	DD:HH:MM		DD:HH:MM
Emissions below limit from BC (end date)	not > limit	not > limit	not > limit	not > limit	not > limit	not > limit		
Emissions below limit from BC (duration)	n/a	DD:HH:MM	n/a	DD:HH:MM	n/a	DD:HH:MM		DD:HH:MM

North Stack ...Cont.	Event 1		Event 2		Event 3		Event 4	
Unit No.	Unit 3		Unit 3		Unit 3		Unit 3	
Breaker Open (BO)	12:30 pm	2023/10/13	6:00 pm	2023/10/17	11:20 am	2023/10/25	1:30 am	2023/10/29
Draught Group (DG) Shut Down (SD)	1:35 am	2023/10/14	8:50 am	2023/10/18	12:00 pm	2023/10/25	1:50 am	2023/10/29
BO to DG SD (duration)	00:13:05	DD:HH:MM	00:14:50	DD:HH:MM	00:00:40	DD:HH:MM	00:00:20	DD:HH:MM
Fires in time								
Synch. to Grid (or BC)								
Fires in to BC (duration)		DD:HH:MM		DD:HH:MM		DD:HH:MM		DD:HH:MM
Emissions below limit from BC (end date)								
Emissions below limit from BC (duration)		DD:HH:MM		DD:HH:MM		DD:HH:MM		DD:HH:MM

South Stack	Event 1		Event 2		Event 3		Event 4	
Unit No.	Unit 5		Unit 5		Unit 5		Unit 6	
Breaker Open (BO)	8:55 pm	2023/10/05	1:15 am	2023/10/25	3:30 pm	2023/10/25	6:05 am	2023/10/01
Draught Group (DG) Shut Down (SD)	11:20 pm	2023/10/05	2:00 pm	2023/10/25	4:30 pm	2023/10/25	9:30 am	2023/10/02
BO to DG SD (duration)	00:02:25	DD:HH:MM	00:12:45	DD:HH:MM	00:01:00	DD:HH:MM	01:03:25	DD:HH:MM
Fires in time	2:55 pm	2023/10/06						
Synch. to Grid (or BC)	1:05 am	2023/10/07						
Fires in to BC (duration)	00:10:10	DD:HH:MM		DD:HH:MM		DD:HH:MM		DD:HH:MM
Emissions below limit from BC (end date)	not > limit	not > limit						
Emissions below limit from BC (duration)	n/a	DD:HH:MM		DD:HH:MM		DD:HH:MM		DD:HH:MM

South Stack ...Cont.	Event 1		Event 2		Event 3		Event 4	
Unit No.	Unit 6		Unit 6		Unit 6		Unit 6	
Breaker Open (BO)	3:15 pm	2023/10/12	9:15 pm	2023/10/14	1:30 pm	2023/10/15	3:15 am	2023/10/16
Draught Group (DG) Shut Down (SD)	7:15 pm	2023/10/13	2:05 am	2023/10/15	6:35 pm	2023/10/15	7:50 am	2023/10/16
BO to DG SD (duration)	01:04:00	DD:HH:MM	00:04:50	DD:HH:MM	00:05:05	DD:HH:MM	00:04:35	DD:HH:MM
Fires in time								
Synch. to Grid (or BC)								
Fires in to BC (duration)		DD:HH:MM		DD:HH:MM		DD:HH:MM		DD:HH:MM
Emissions below limit from BC (end date)								
Emissions below limit from BC (duration)		DD:HH:MM		DD:HH:MM		DD:HH:MM		DD:HH:MM

Complaints Register

Table 9: Complaints for the month of October 2023.

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
There was no complaint related to air quality received during the month of October 2023.					

General

The particulate matter (PM10) emissions on the North Common Stack exceeded the **monthly limit**; on average emissions figure of **269.5 mg/Nm³** while South Common Stack also exceeded the **monthly limit** on the recorded PM10 monthly average figure of **275.1 mg/Nm³**. The gaseous (NOx & SOx) emissions on the North and South common Stacks were within the **daily limit** during the month of October 2023; refer to graphs above.

NB: The rest of the information demonstrating compliance with the emissions license conditions is supplied in the annual emission reports sent to your office.

Kriel Power Station's List of NEMA Section 30 Incidents for 2023/2024 Financial Year

Month	Description of Section 30 Incidents - including the reference number	Root Cause (s)	Status of S30 Incident with DEFF (open or closed)	Remarks
-------	--	----------------	---	---------

<p>April-2023</p>	<p>South Stack High Emissions</p>	<p>Unit 4 A EFP plant breakdown causing half load conditions, which calls for operating the unit with fuel oil support to badly impacting the stack emissions</p>	<p>Open</p>	
<p>May - 2023</p>	<p>North Stack High Emissions</p>	<p>Unit 4 A EFP plant breakdown causing half load conditions which calls for operating the unit with fuel oil support to badly impacting the stack emissions</p>	<p>Open</p>	
<p>May - 2023</p>	<p>South Stack High Emissions</p>	<p>Unit 4 A EFP plant breakdown causing half load conditions which calls for operating the unit with fuel oil support to badly impacting the stack emissions</p>	<p>Open</p>	
<p>June – 2023</p>	<p>North Stack High Emissions</p>	<p>Units operating at half load conditions which affects the sulphur dosing and causes the plant to operate with fuel oil support because of high turbine back pressure, low final feedwater temperature, high works power loss</p>	<p>Open</p>	

		from high usage of electric feed pump and dust handling plant because of dust transportation resulting in high stack emissions		
June - 2023	South Stack High Emissions	Units operating at half load conditions which affects the sulphur dosing and causes the plant to operate with fuel oil support because of high turbine back pressure, low final feedwater temperature, high works power loss from high usage of electric feed pump and dust handling plant because of dust transportation resulting in high stack emissions	Open	
July - 2023	North Stack High Emissions	The north stack emissions daily average has significantly reduced as results of shutting of unit 2 outage for the planned GO outage. However, due to the isolation of cooling tower number 2 for the cooling tower fills replacement project, unit 3 is operating at low loads to condenser vacuum high. The half load conditions mean supporting the unit		

		with oil burners to support combustion and sulphur trioxide (SO ₃) not in service. The south stack PM emission daily average has significantly reduced since synchronisation of units from half station shutdown.		
Aug - 2023	North Stack High Emissions	The north stack emissions exceedance was due to RH1 and RH2 poor field performance (high spark rates) which resulted in ESP reduced collection efficiency. The reduced field performance on the first field was as results of high hoppers, which resulted from an ash backlog on the dust handling plant.		
Sep - 2023	North Stack High Emissions	The North Stack emissions exceedance was due the increase of hopper alarms to 24 on Unit 1 due to blow tanks which were not available. Blow tank 1 2 discharge seal was damaged and blow tank 1 2 was leaking on the vent. Consequently, the electrostatic		

		precipitators (ESP) performance decreased because of accumulation inside the fields.		
Oct - 2023	North Stack high Emissions	Requested grace period to exceed the limit after the installation of New Abatement Technology HFTs. The station will undertake new Correlation curve and back fit accordingly and report accurately.		
Oct - 2023	South Stack High Emissions	The ESP fields performance continued to deteriorate, with the collection efficiency below 40%. It was noted that there was significant drop in fields performance on the RHS only. The RHS poor fields performance was as results of the failure of the DE rapping system. During commissioning of the 5B transformer which was replaced on the 29th of September 2023, the phasing was not verified, and motor directions checks were not conducted thereafter. This then resulted in motor rotating in the wrong directions and		

		consequently the failure of torque insulators which rendered most DE rappers not available. It should be noted there were other causes that contributed to the high emissions, this includes the saturation of the ID fans and poor dust handling plant availability as results of failure of the overland conveyors and blow tanks.		
Nov - 2023				
Dec - 2023				
Jan - 2024				
Feb - 2024				
Mar - 2024				