

Ms Tebogo Mogakabe

PO BOX 1748

ERMELO

2350

Manager: Municipal Environmental Services

Gert Sibande District Municipality

Date: 09 June 2025

Enquiries: Johan Swanepoel Tel +27 17 799 2047

MAJUBA POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2025

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of May 2025. Verified emissions of particulates are included. SO₂ and NOx (as NO₂) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Forestry, Fisheries and the Environmental in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting.

Raw Materials and Products

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of May 2025			
	Coal	Tons/month	1 800 000	1 147 998			
	Fuel Oil	Tons/month	6 000	3 860			
Production Rates	Product/ By-		Maximum Production Rate	Production Rate in			
Production Rates	Product Name	Unit	Permitted (Quantity)	Month of May 2025			
Production Rates	-	Unit *GWh	Permitted				

Table 1. Quantity of Raw Materials and Products used/produced for the month of May 2025

*Majuba AEL stipulates a maximum production capacity of 4110 MW. This equates to a production rate of 3058 GWh per month when converted, as indicated above. This is to align to the monthly production rates reported.

Abatement Technology Table 2. Abatement Equipment Control Technology for the month of May 2025

Associated Unit	Technology Type	Actual Utilisation (%) for the month of July 2024	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.90
Unit 2	Fabric Filter Plant	100	99.89
Unit 3	Fabric Filter Plant	100	99.95
Unit 4	Fabric Filter Plant	100	99.92
Unit 5	Fabric Filter Plant	100	99.93
Unit 6	Fabric Filter Plant	100	99.91

*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal

Characteristic	Stipulated Limit (Unit)	Monthly Average Content			
Sulphur Content	0.94%	0.67			
Ash Content	30%	29.65			

Emissions Reporting

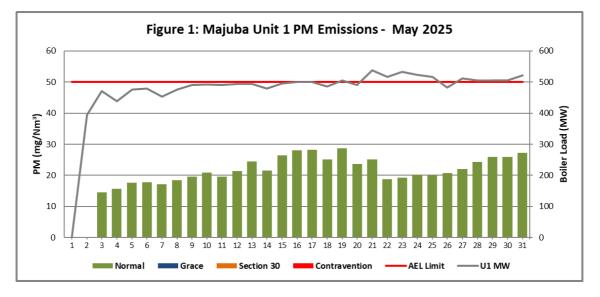


Figure 1. Particulate Matter emissions (daily averages) for the month of May 2025 against emission limit for Unit 1.

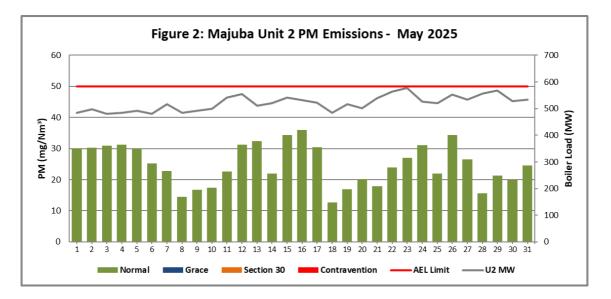


Figure 2. Particulate Matter emissions (daily averages) for the month of May 2025 against emission limit for Unit 2.

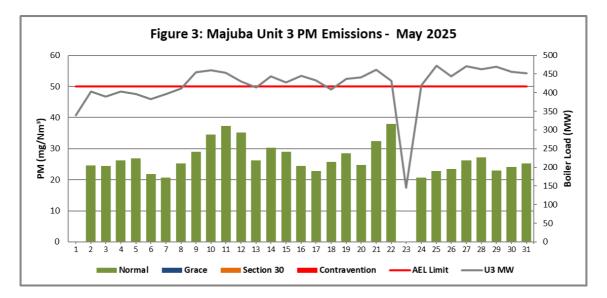


Figure 3. Particulate Matter emissions (daily averages) for the month of May 2025 against emission limit for Unit 3.

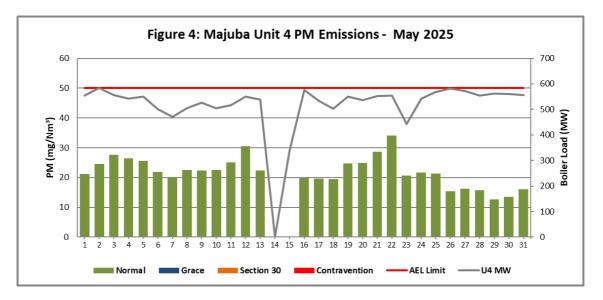


Figure 4. Particulate Matter emissions (daily averages) for the month of May 2025 against emission limit for Unit 4.

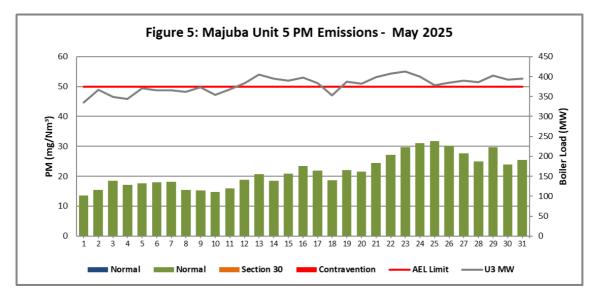


Figure 5. Particulate Matter emissions (daily averages) for the month of May 2025 against emission limit for Unit 5.

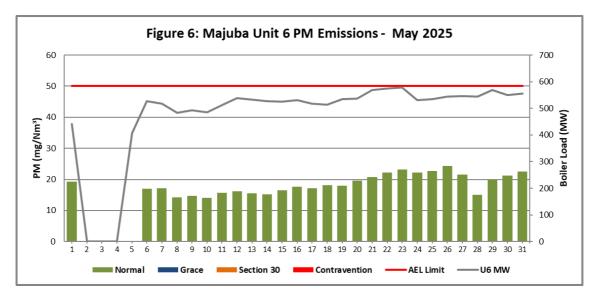


Figure 6. Particulate Matter emissions (daily averages) for the month of May 2025 against emission limit for Unit 6.

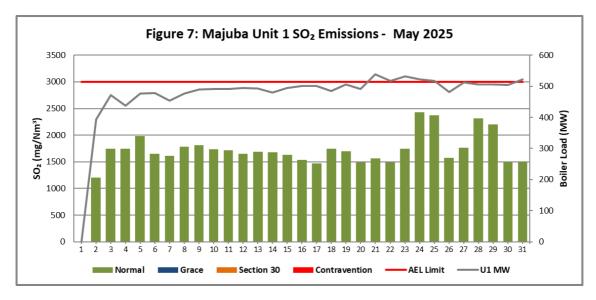


Figure 7. SO_2 emissions (daily averages) for the month of May 2025 against emission limit for Unit 1.

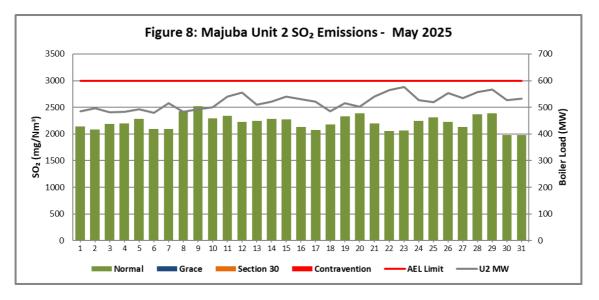


Figure 8. SO_2 emissions (daily averages) for the month of May 2025 against emission limit for Unit 2.

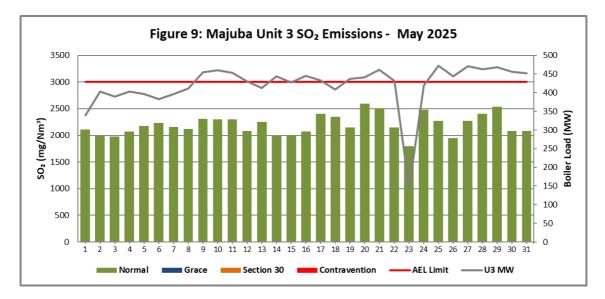


Figure 9. SO_2 emissions (daily averages) for the month of May 2025 against emission limit for Unit 3.

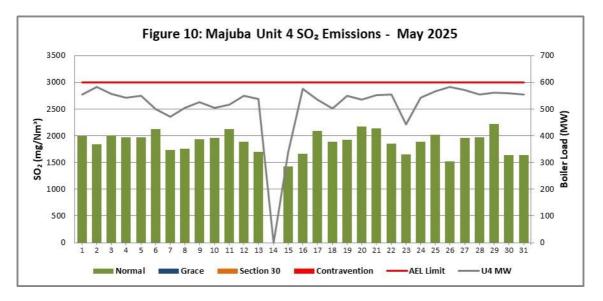


Figure 10. SO_2 emissions (daily averages) for the month of May 2025 against emission limit for Unit 4.

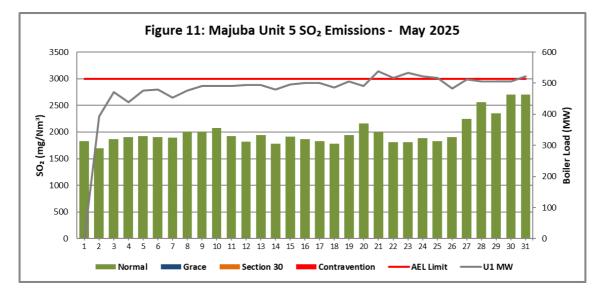


Figure 11. SO_2 emissions (daily averages) for the month of May 2025 against emission limit for Unit 5.

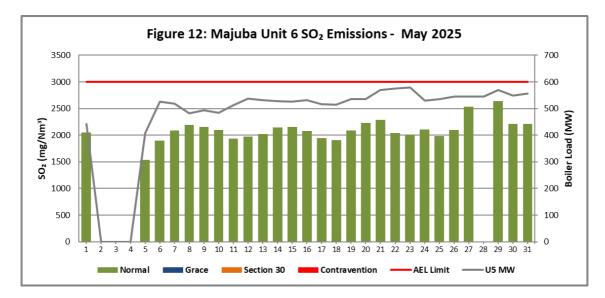


Figure 12. SO $_2$ emissions (daily averages) for the month of May 2025 against emission limit for Unit 6.

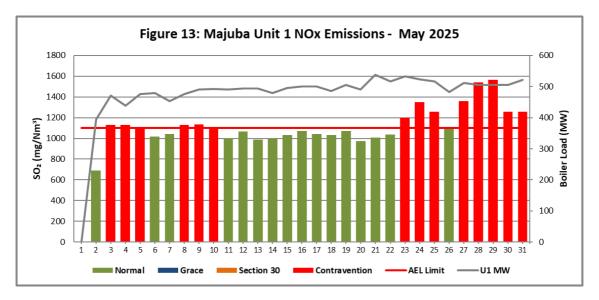


Figure 13. NOx emissions (daily averages) for the month of May 2025 against emission limit for Unit 1.

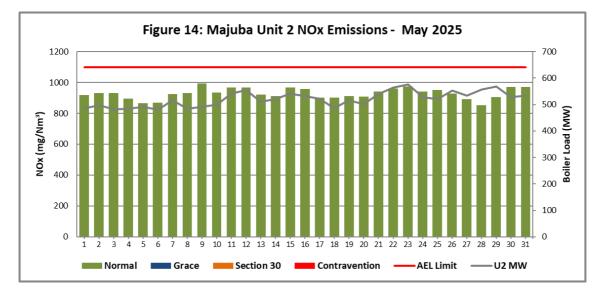


Figure 14. NOx emissions (daily averages) for the month of May 2025 against emission limit for Unit 2.

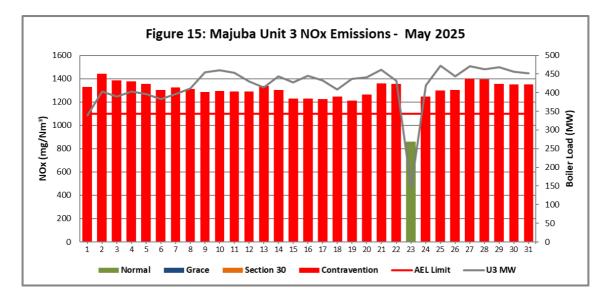


Figure 15. NOx emissions (daily averages) for the month of May 2025 against emission limit for Unit 3.

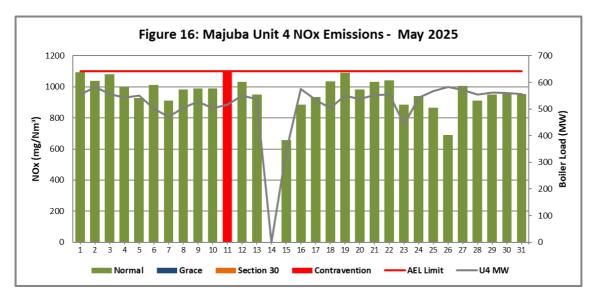


Figure 16. NOx emissions (daily averages) for the month of May 2025 against emission limit for Unit 4

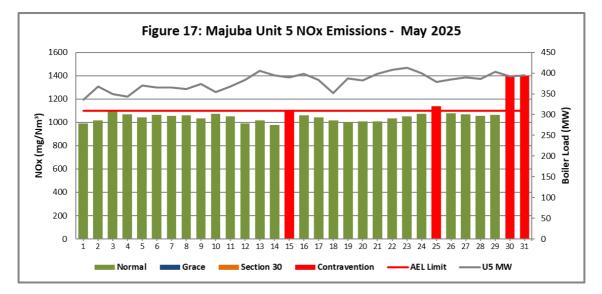


Figure 17. NOx emissions (daily averages) for the month of May 2025 against emission limit for Unit 5

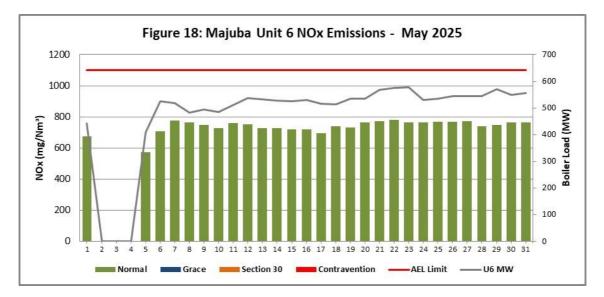


Figure 18. NOx emissions (daily averages) for the month May 2025 against emission limit for Unit 6

1		, ,	month of May 2025					
	Unit	PM (tons)	SO ₂ (tons)	NOx (tons)				
	Unit 1	50.2	4 080	2 641				
	Unit 2	62.7	5 581	2 335 1 254				
	Unit 3	22.6	2 120					
	Unit 4	40.5	3 803	1 935				
	Unit 5	38.6	3 513	1 886				
	Unit 6	41.8	4 985	1 727				

Table 4: Monthly tonnages for the month of May 2025

Table 5: Average monthly	concentrations	(ma/Nm ³)) for the month	of May 2025
Table J. Average monung		(IIIg/INIII)		UI Way ZUZJ

Unit	PM (Mg/Nm³)	SO ₂ (Mg/Nm³)	NOx (Mg/Nm³)
1	22.0	1 748.2	1 130.7
2	24.9	2 220.9	928.8
3	26.7	2 202.8	1 302.0
4	22.3	1 897.4	966.4
5	21.7	1 989.3	1 068.6
6	18.6	2 133.2	739.9

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits
(SO ₂ , NOx, and PM)

Associated Unit/Stack	Normal Grace		Section 30	Contravention	Total Exceedance			
Unit 1	16	0	0	14	14			
Unit 2	31	0	0	0	0			
Unit 3	01	0	0	30	30			
Unit 4	29	0	0	01	01			
Unit 5	nit 5 27		0 04		04			
Unit 6	27	0	0	01	01			

Table 7: MONITOR RELIABILITY (%)

Associated Unit/Stack	РМ	SO₂	NO	02	
Unit 1	100.0	88.9	88.9	99.9	
Unit 2	100.0	99.6	100.0	0.0	
Unit 3	99.5	99.5	99.5	96.3	
Unit 4	100.0	97.2	99.4	99.3	
Unit 5	100.0	96.9	100.0	100.0	
Unit 6	100.0	99.5	99.7	99.5	

Table 8: CO_2 and O_2 deviations of the Month of May 2025

*Diank anagag indiagta	that the unit was	offline during that period
Diank spaces indicate	inal the unit was	omme durind triat period

2025/06/09		CO	₂ (Actu	al Dry %	%)		Final O_2 CEMS Data (%)			SU	SUM CO ₂ + O ₂ CEMS Data (%)							
Date	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
2025/05/01		9.2	8.4	9.5	11.5	9.0		10.3	13.1	11.9	10.3	11.8		19.5	21.4	21.4	21.9	20.8
2025/05/02	10.6	9.2	8.6	9.7	11.5		9.1	10.3	11.9	11.4	9.7		19.7	19.5	20.5	21.1	21.2	
2025/05/03	10.6	9.0	8.5	9.2	11.4		9.1	10.3	11.9	12.1	9.9		19.7	19.3	20.4	21.4	21.3	
2025/05/04	7.3	9.1	8.5	9.2	11.4		12.8	10.3	11.9	11.5	10.2		20.1	19.4	20.4	20.7	21.6	
2025/05/05	8.9	9.0	8.5	9.4	11.5	11.0	10.4	10.3	11.9	10.8	9.3	9.8	19.3	19.3	20.4	20.2	20.8	20.8
2025/05/06	9.4	8.8	8.5	8.5	11.6	11.3	9.3	10.3	12.1	12.5	9.6	9.4	18.7	19.1	20.6	21.0	21.1	20.8
2025/05/07	9.8	9.2	8.5	8.2	11.6	10.5	9.7	10.3	11.9	11.6	9.5	10.3	19.5	19.5	20.4	19.8	21.1	20.8
2025/05/08	10.0	8.9	8.6	8.5	11.6	10.1	9.9	10.3	11.7	11.3	10.3	10.7	19.9	19.2	20.3	19.8	21.9	20.8
2025/05/09	10.0	9.0	8.5	8.7	11.6	10.5	9.5	10.3	11.0	11.2	9.9	10.2	19.5	19.3	19.5	19.9	21.5	20.8
2025/05/10	10.1	9.2	8.5	8.8	11.7	10.6	9.1	10.3	11.0	11.4	10.8	10.1	19.2	19.5	19.4	20.2	22.5	20.8
2025/05/11	10.0	9.5	8.4	8.8	11.6	11.1	8.8	10.3	11.2	12.3	10.5	9.6	18.8	19.8	19.6	21.1	22.1	20.8
2025/05/12	9.7	9.5	8.3	9.1	11.5	11.0	9.0	10.3	11.4	11.6	9.5	9.7	18.8	19.8	19.7	20.7	21.0	20.8
2025/05/13	9.8	9.0	8.4	9.0	11.5	10.9	8.3	10.3	11.8	10.8	9.6	9.9	18.1	19.3	20.2	19.8	21.1	20.8
2025/05/14	9.6	9.2	8.5		11.5	10.6	9.3	10.3	10.9		9.6	10.2	18.9	19.5	19.4		21.2	20.8
2025/05/15	9.8	9.3	8.4	7.3	11.6	10.6	8.4	10.3	11.0	12.0	9.8	10.2	18.2	19.6	19.4	19.3	21.4	20.8
2025/05/16	9.9	9.3	8.4	9.2	11.6	10.9	8.7	10.3	11.0	9.9	9.4	9.9	18.6	19.6	19.4	19.1	21.0	20.8
2025/05/17	9.9	9.3	8.5	8.9	11.6	10.9	8.6	10.3	11.3	10.8	9.8	9.9	18.5	19.6	19.8	19.8	21.4	20.8
2025/05/18	9.8	9.0	8.6	8.7	11.6	11.5	9.3	10.3	11.7	12.2	10.4	9.3	19.1	19.3	20.2	20.9	22.1	20.8
2025/05/19	10.0	9.2	8.6	9.2	11.6	11.3	8.8	10.3	11.2	11.6	9.4	9.4	18.8	19.5	19.8	20.9	21.0	20.8
2025/05/20	9.9	9.2	8.6	8.9	11.5	11.9	9.1	10.3	11.6	11.0	9.6	9.4	19.1	19.5	20.2	19.9	21.1	21.3
2025/05/21	9.9	9.6	8.6	9.1	11.2	11.6	8.4	10.3	11.5	11.4	9.4	9.0	18.3	19.9	20.1	20.5	20.6	20.6
2025/05/22	9.8	9.8	8.4	9.2	11.1	11.4	9.1	10.3	11.7	11.2	9.5	8.8	18.9	20.1	20.1	20.4	20.6	20.2
2025/05/23	10.2	9.8	7.3	8.4	11.1	11.4	10.3	10.3	14.4	11.7	9.3	8.8	20.6	20.1	21.7	20.1	20.5	20.2
2025/05/24	10.2	9.4	8.3	9.2	11.2	11.4	11.9	10.3	12.0	10.4	9.5	9.4	22.1	19.7	20.3	19.6	20.7	20.8
2025/05/25	10.2	9.4	8.3	9.6	11.2	11.4	11.5	10.3	11.8	10.7	10.0	9.2	21.7	19.7	20.1	20.3	21.3	20.7
2025/05/26	10.2	9.7	8.3	9.9	11.2	11.5	10.0	10.3	12.1	9.9	9.7	9.2	20.3	20.0	20.4	19.8	20.9	20.7
2025/05/27	10.0	9.8	8.4	9.7	11.2	11.4	10.2	10.3	12.0	10.8	9.4	9.4	20.2	20.1	20.4	20.5	20.6	20.8
2025/05/28	10.2	10.0	8.3	9.4	11.2	11.5	11.7	10.3	12.0	10.2	9.5	9.8	21.9	20.3	20.3	19.6	20.7	21.2
2025/05/29	10.2	9.8	8.4	9.0	11.3	11.5	12.1	10.3	12.1	10.7	9.4	9.5	22.2	20.1	20.4	19.7	20.7	21.0
2025/05/30	10.1	9.5	8.4	9.2	10.0	11.5	9.6	10.3	12.3	10.7	8.7	9.4	19.7	19.8	20.7	19.9	18.7	20.9
2025/05/31	10.1	9.4	8.3	9.2	9.8	11.4	11.6	10.3	12.3	11.5	8.3	9.3	21.6	19.7	20.6	20.6	18.2	20.7

Calculation: $CO_2\% + O_2\% = 19.5-21.5\%$

Emergency Generation

Table 9: Emergency Generation for the month of May 2025

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

Comments on the performance and availability of each unit UNIT 1

The unit base loaded for most of the days during the month and off for one day. Forty-two fabric filter bags were replaced during the month.

UNIT 2

The unit base loaded for all the days during the month. Seventy-four fabric filter bags were replaced during the month.

UNIT 3

The unit base loaded for all the days during the month. One hundred and twenty-four and five fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for most of the days during the month and off for one day. Forty-eight fabric filter bags were replaced during the month.

UNIT 5

The unit base loaded for all the days during the month. Thirty-nine fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for most of the days during the month and off for a total of Three days. Thirtyone fabric filter bags were replaced during the month.

Complaints Register

Table 10: Complaints for the month of May 2025

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modelling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received during the month of May 2025.				

General

Unit 2 O₂ monitor remains faulty, the Station is still in the process of sourcing spares.

The new exemption limit of 1100 mg/Nm³ for NOx was exceeded at Unit 1 (14 times), Unit 3 (30 times) and Unit 4 (4 times). In addition, the new exemption limit of 3000 mg/Nm³ for SO₂ was exceeded at Unit 6 (once). The Station is currently concluding the investigation, and the report will be shared with the licensing authority once the investigation has been completed.

Yours sincerely

Report compiled by:

Faith Kagoda ENVIRONMENTAL MANAGER: (MAJUBA)

Date 11/06/2025

Report verified by:

Lindani Madonsela BOILER ENGINEERING MANAGER: (MAJUBA)

Date 12/06/2025

Report approved by:

X

Johan Swanepoel ENGINEERING MANAGER: (MAJUBA)

2025/06/12

Date