	Monthly Report	Matla Power Station
---	----------------	---------------------

Title: **Matla Power Station Monthly Emissions Report – May 2025**

Document Identifier: **06C-31482**

Alternative Reference: **31482**
Number:

Area of Applicability: **Matla Power Station**





Functional Area: **Environmental Department**

Revision: **0**

Total Pages: **13**





Next Review Date: **N/A**

Disclosure Classification: **Controlled Disclosure**

Compiled by  M.P Chipa	Verified by  M Gcaleka	Verified by  N Molefe	Supported by  L.A Murovhi
Initials and Surname Officer Environmental	Initials and Surname Senior Advisor Engineer Boiler	Initials and Surname C&I System Engineer	Initials and Surname Environmental Manager (Acting)
Date: 18/06/2025	Date: 19/06/2025	Date:19/06/2025	Date:19/06/2025

**Matla Power Station May Monthly Emissions
Report**

Unique Identifier: **06C-31482**
Revision: **0**
Page: **2 of 13**

Supported by  J Makuleka	Supported by  K Mangope	Supported by  L Ngelese	Authorized by  B Phahle
Initials and Surname Boiler Engineering Manager	Initials and Surname C&I Engineering Manager	Initials and Surname Engineering Group Manager	Initials and Surname General Manager (Acting)
Date: <u>20/06/2025</u>	Date: <u>20/06/2025</u>	Date: <u>20/06/2025</u>	Date: <u>2025/06/24</u>

Content

1. Introduction	4
2. Raw Materials and Products	4
3. Abatement Technology	4
4. Energy Source Characteristics	5
5. Emissions Reporting	5
5.1 PM Daily Averages	5
5.2 Sox Daily Averages	7
5.3 NOx Daily Averages	9
6. Continuous Emissions Monitoring System (CEMS)	12
7. CEMS Calibration and Equipment Used for Calibration	12
8. Validity of Correlation and Parallel Test	12
9. Complaint Register	13

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system. No part of this document may be reproduced in any manner or form by third parties without the written consent of Eskom Holdings SOC Ltd, © copyright Eskom Holdings SOC Ltd, Reg No 2002/015527/30

1. Introduction

MATLA POWER STATION MONTHLY EMISSIONS REPORT FOR THE MONTH OF MAY 2025

This document serves as the monthly emissions report required in terms of Section 7.6 of Matla Power Station Provisional Atmospheric Emission License (AEL), 17/4/AEL/MP312/11/14

This report reflects Unit 1 to Unit 6 gaseous and particulate emissions performance against the AEL limit for the month of May 2025 only.

2. Raw Materials and Products

Table 1- Quantity of Raw Materials and Products Consumption in 05/2025

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption – 05/2025
	Coal	Tons/month	1 475 000	685 803
	Fuel Oil	Tons/month	3 500	823
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of 05/2025
	Energy	GWh	2 745	1 243
	Ash Produced	Tons/month	471 000	182 698

3. Abatement Technology

Table 2-Abatement Equipment Control Technology Efficiency in 05/2025

Associated Unit/Stack	Technology Type	Efficiency	ESP Utilization
South Stack (Unit 1, 2 and 3)	Electrostatic Precipitators (ESP)	99.315%	100%
	Electrostatic Precipitators (ESP)		
	Electrostatic Precipitators (ESP)		
Unit 4	Electrostatic Precipitators (ESP)	99.596%	100%
Unit 5	Electrostatic Precipitators (ESP)	99.702%	100%
Unit 6	Electrostatic Precipitators (ESP)	Off	Off

Note: Abatement plant does not have bypass mode operation, hence plant 100% Utilised.

CONTROLLED DISCLOSURE

4. Energy Source Characteristics

Table 3: Energy Source Material Characteristics for 05/2025

Characteristic	Stipulated Range (% by weight on a dry basis)	Monthly Average Content (% by weight on a dry basis)
Coal		
Sulphur Content	0.8-1.1	0.82
Ash Content	21-40	24.96


5. Emissions Reporting

In terms of Section 59 of National Environmental Management: Air Quality Act (Act no.39 of 2004) a decision made by the Minister of DFFE, in respect of the Eskom exemption applications for new Minimum Emission Standards (MES) were granted and effective as of 01st April 2025.

Table 4- New Minimum Emission Limits are as follows:

SO ₂ Monthly = 2600 mg/Nm ³	Dust Daily= 50 mg/Nm ³ (South Stack) Dust Daily= 100 mg/Nm ³ (Unit 4, 5 and 6)	NO ₂ Daily= 1100 mg/Nm ³
---	---	--


5.1 PM Daily Averages

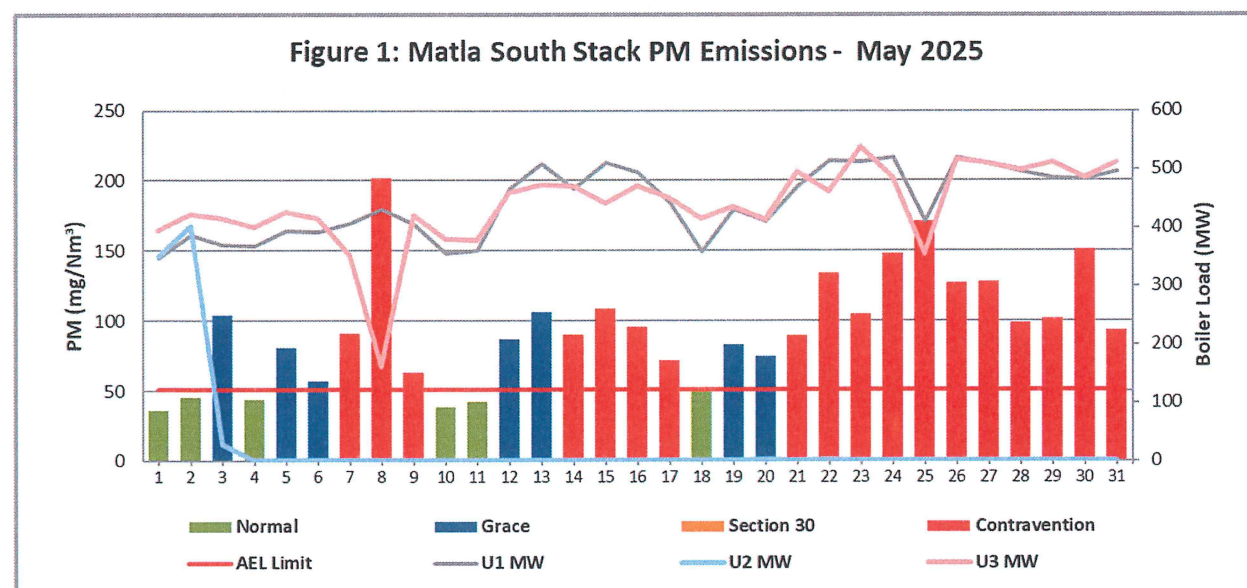


Matla Power Station South Stack exceeded PM MES limit of 50mg/Nm³ from the 05th – 09th, 12th – 17th and from 19th – 31st of May 2025. Matla Power Station South Stack units are still struggling to operate within limit on full load. The station has submitted a letter to the Nkangala District Municipality

CONTROLLED DISCLOSURE

licensing Officer on the challenges and actions that are being taken to address the stations non-compliance of the South Stack to the MES limits.

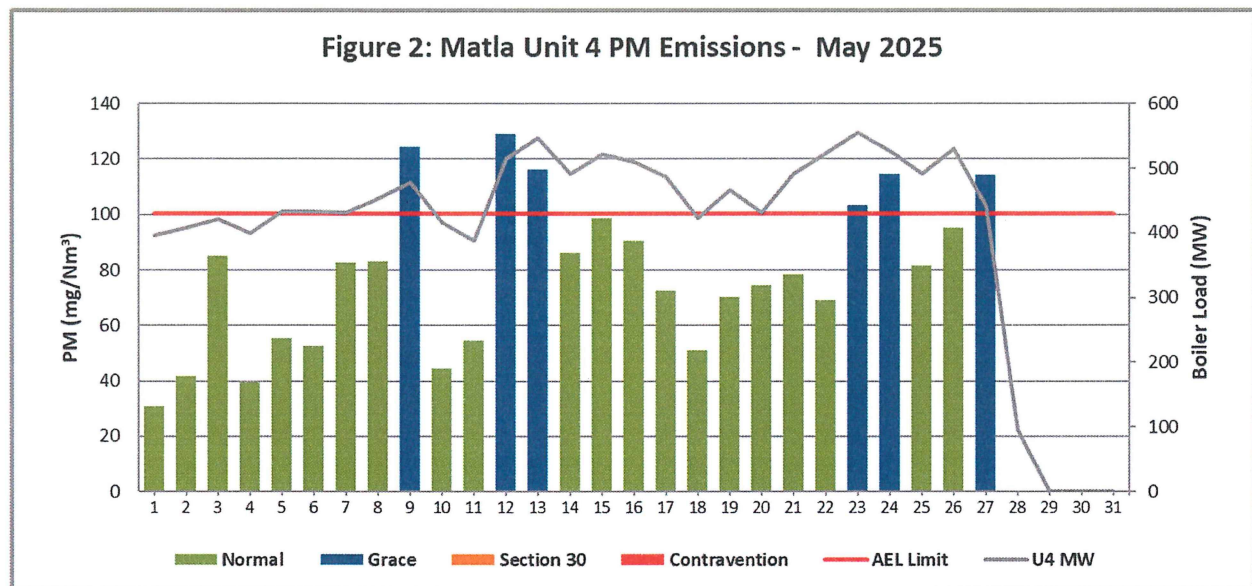

Matla Power Station Unit 4 exceeded PM MES limit of 100 mg/Nm³ on the 09th of May 2025, the exceedances were due to the Dust Handling Plant (DHP) conveying line blockages and poorly performing Electrostatic Precipitators, on the 12th – 13th of May 2025. The exceedances on the 23rd – 24th May 2025 were due to the Sulphur Common plant tripping due to low steam temperature. Unit 4 shutdown on the 27th of May 2025.

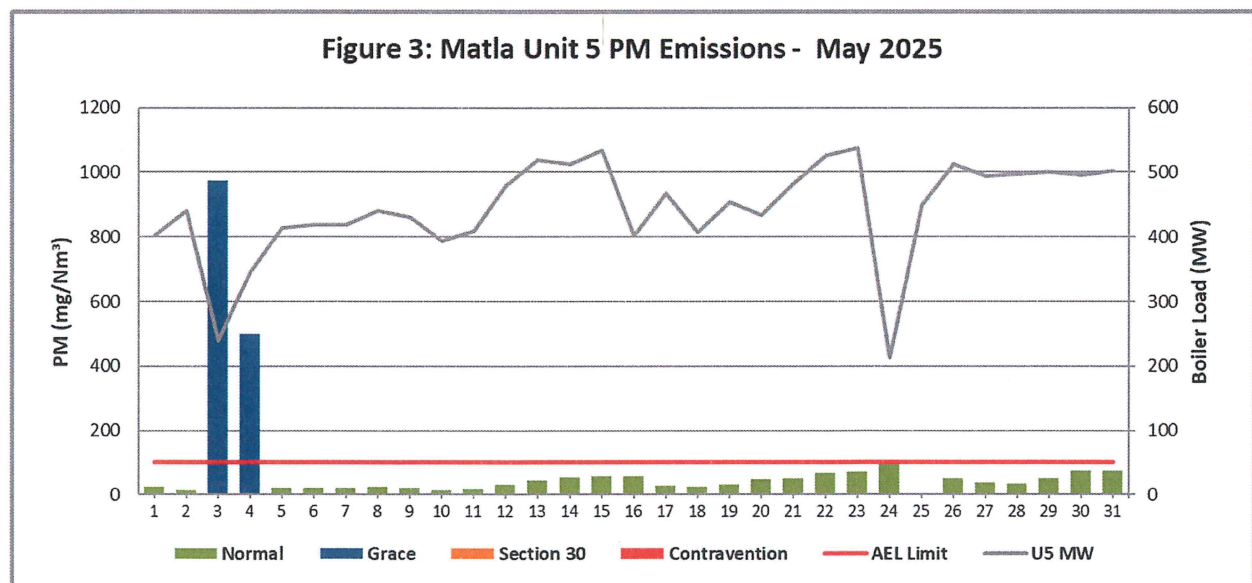

CONTROLLED DISCLOSURE

When downloaded from the document management system, this document is uncontrolled and the responsibility rests with the user to ensure it is in line with the authorized version on the system. No part of this document may be reproduced in any manner or form by third parties without the written consent of Eskom Holdings SOC Ltd, © copyright Eskom Holdings SOC Ltd, Reg No 2002/015527/30


Matla Power Station Unit 5 exceeded PM MES limit of 100 mg/Nm³ during the period from 03rd – 04th of May 2025, due to the electrostatic precipitators being isolated because of low load conditions.

Figure 4: Matla Unit 6 PM Emissions - May 2025



5.2 Sox Daily Averages


Figure 5: Matla South Stack SO₂ Emissions - May 2025

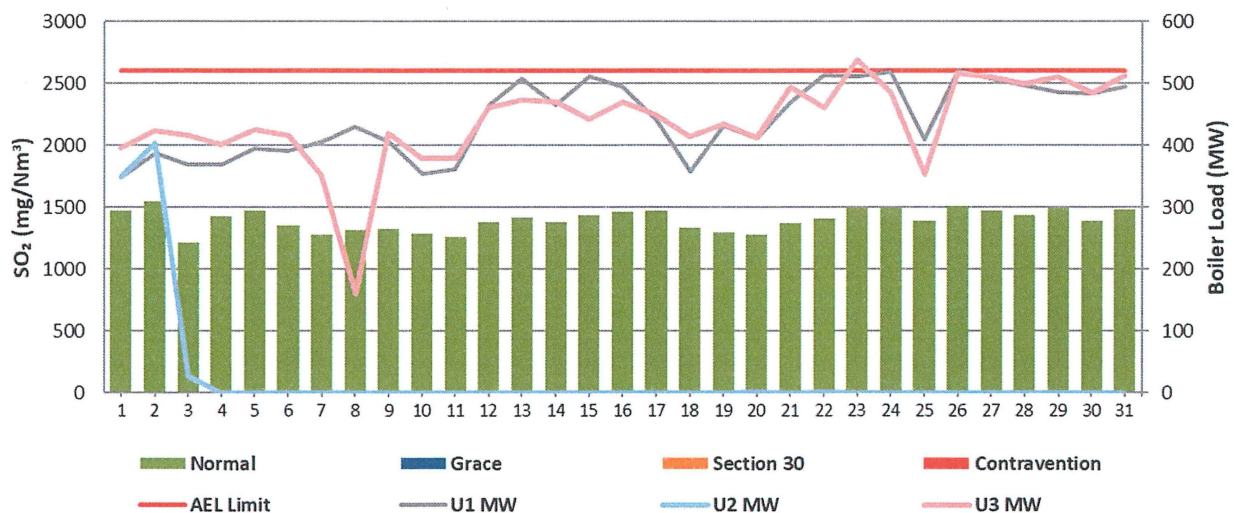

Note: Matla Power Station did not exceed SOX Limit.


CONTROLLED DISCLOSURE

Figure 6: Matla Unit 4 SO₂ Emissions - May 2025

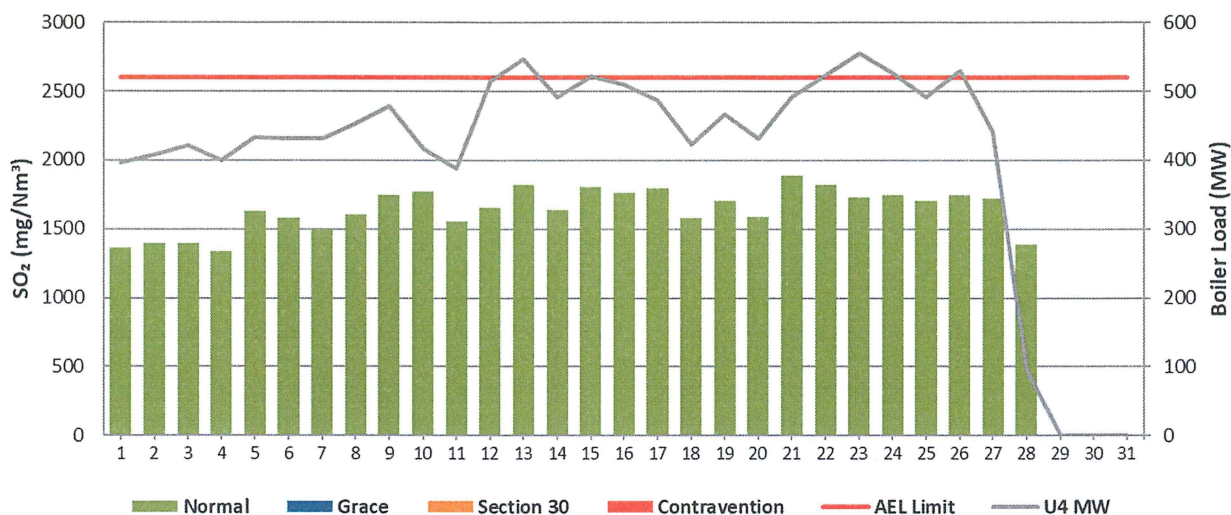

Note: Matla Power Station did not exceed SOX Limit.


Figure 7: Matla Unit 5 SO₂ Emissions - May 2025

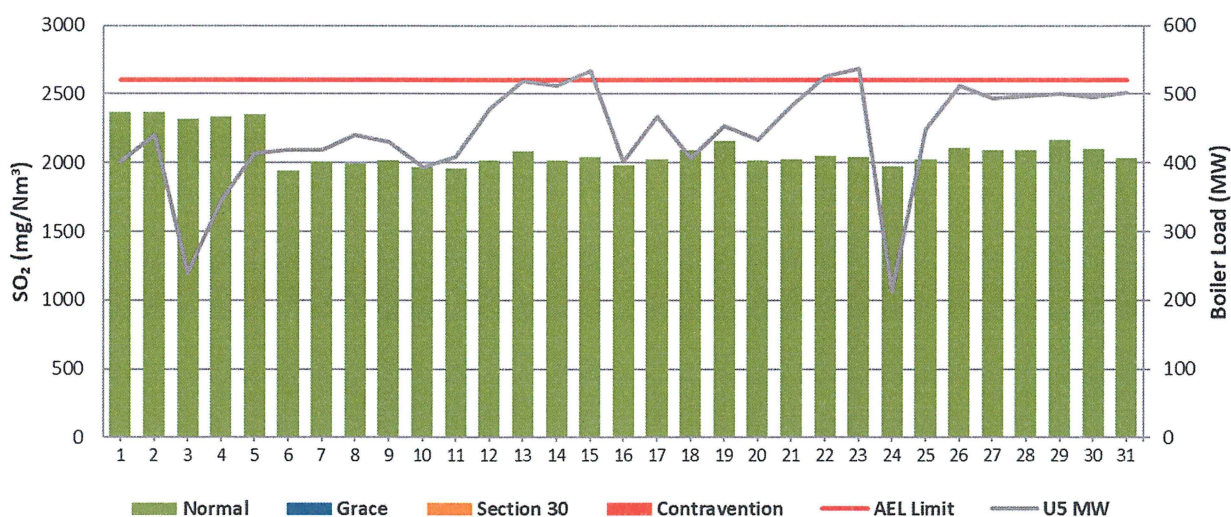

Note: Matla Power Station did not exceed SOX Limit.

CONTROLLED DISCLOSURE


Figure 8: Matla Unit 6 SO₂ Emissions - May 2025

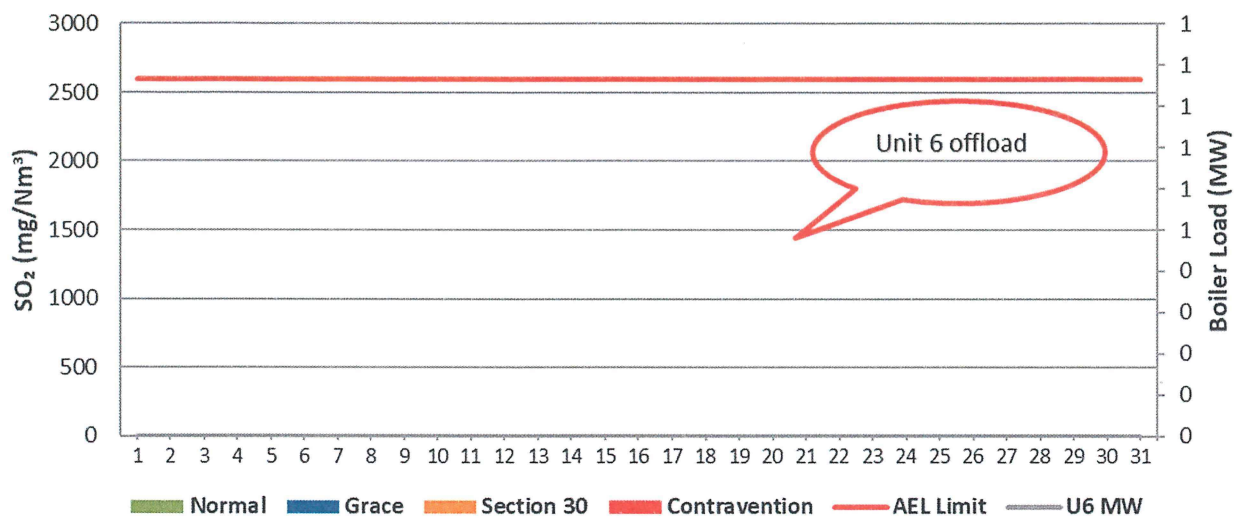

Note: Matla Power Station did not exceed SOX Limit.

5.3 NOx Daily Averages


Figure 9: Matla South Stack NOx Emissions - May 2025

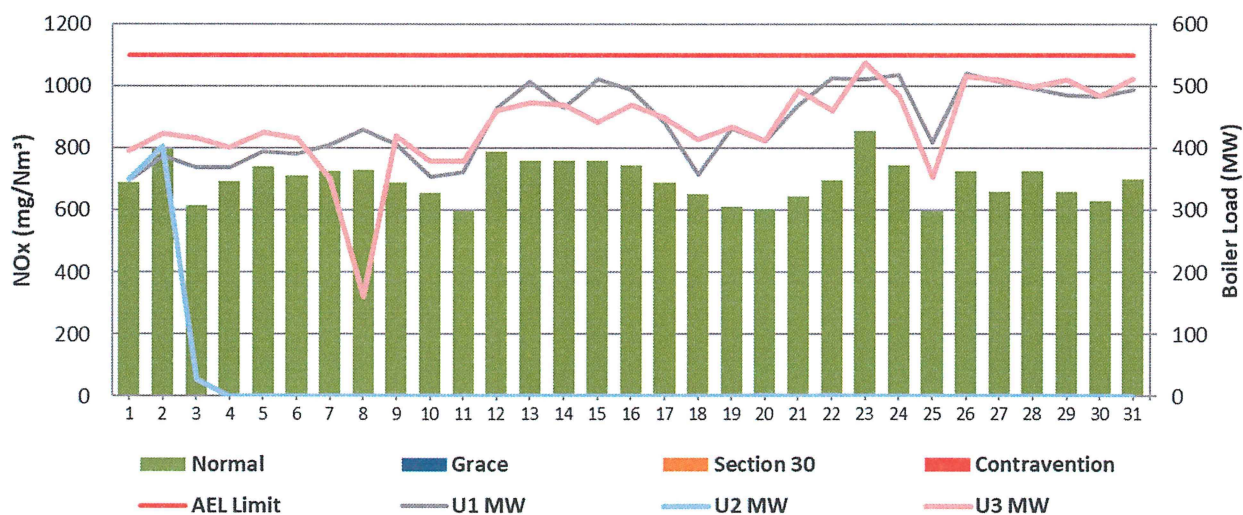

Note: Matla Power Station did not exceed NOX Limit.


CONTROLLED DISCLOSURE

Figure 10: Matla Unit 4 NOx Emissions - May 2025

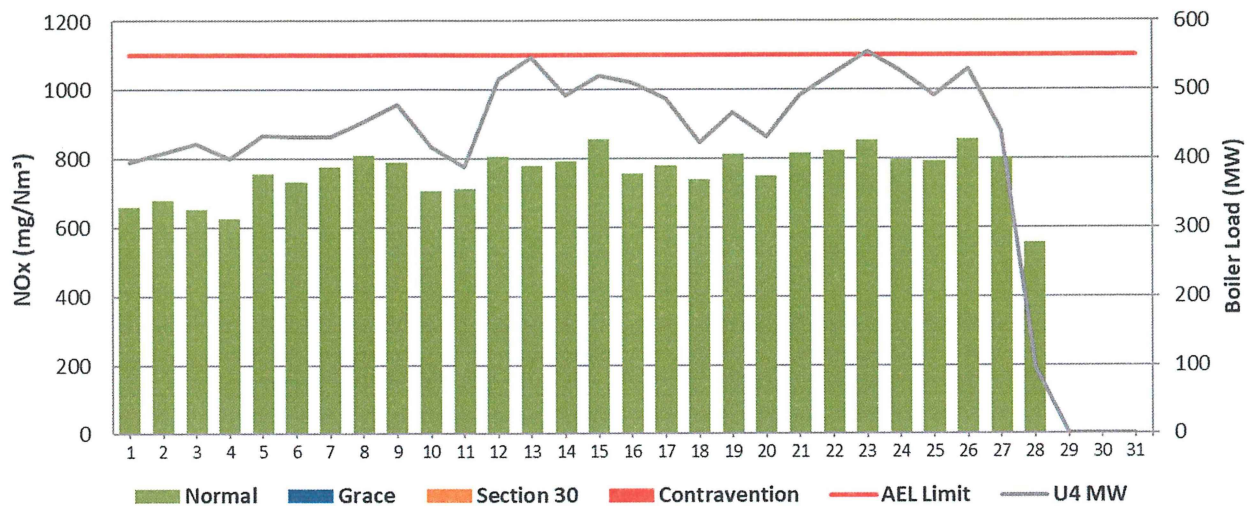


Note: Matla Power Station did not exceed NOX Limit.

Figure 11: Matla Unit 5 NOx Emissions - May 2025

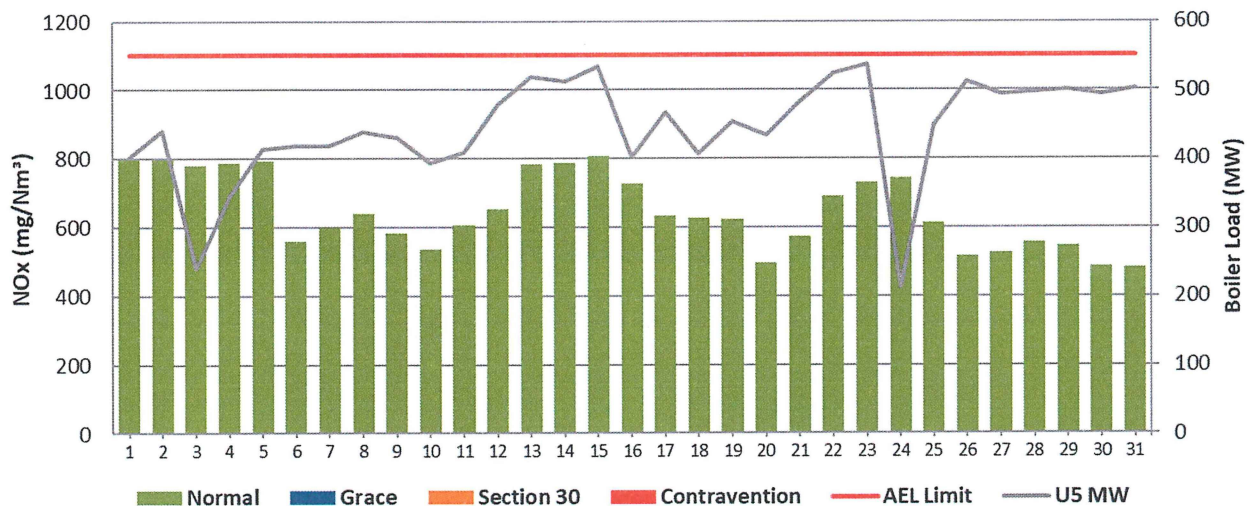

Note: Matla Power Station did not exceed NOX Limit.

CONTROLLED DISCLOSURE

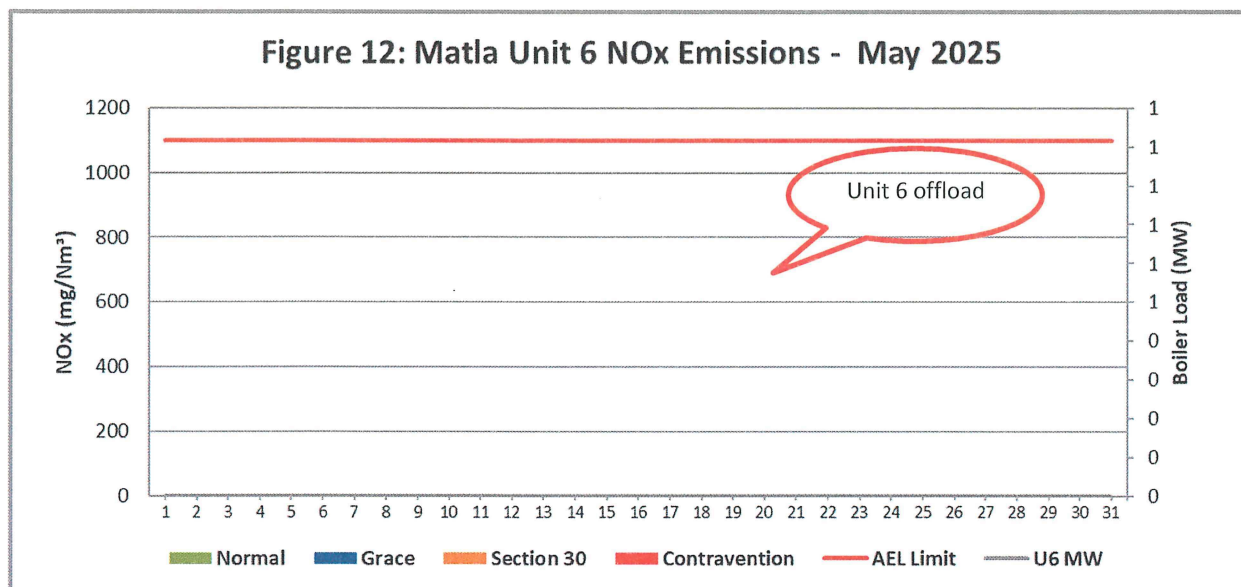

Note: Matla Power Station did not exceed NO_x Limit.

Table 5-Monthly Tonnages for 05/2025

Associated Unit/Stack	PM	SO ₂	NO ₂
Unit 1	295.4	2 673.2	1 335.2
Unit 2	4.7	162.7	80.3
Unit 3	251.4	2 380.5	1 184.7
Unit 4	140.1	2 888.9	1 340.7
Unit 5	116.0	3 117.8	959.6
Unit 6	Off	Off	Off
SUM	807.6	11 223.1	4 900.5

Table 6-Monthly Averages Concentration for 05/2025 in mg/Nm³

Associated Unit/Stack	PM	SO ₂	NO ₂
South Stack	152.7	1 399.4	698.9
Unit 4	79.3	1 644.3	760.0
Unit 5	88.6	2 091.3	648.0
Unit 6	Off	Off	Off

CONTROLLED DISCLOSURE

6. Continuous Emissions Monitoring System (CEMS)

Table 7- Periods during which was inoperative/malfunctioning.

Date	CEMS status	Comments
May 2025	Malfunctioning	<p>The station gas monitors have been reading inaccurately for South Stack, however parallel tests averages were used for the purpose of accurate reporting of the gases during this reporting period.</p> <p>The station is in a process of sourcing some of components for the gas monitors such Lenses, Zirconium cells for O₂ and Heater gaskets to improve the Monitor reliability and CO₂+O₂ relationship hence the Monitor reliability is not reported on the table above.</p>

Table 8-CEMS Monitor Reliability Percentage

Associated Unit/Stack	PM	SO ₂	NO ₂	O ₂
South Stack	89.0	-	-	-
Unit 4	100.0	94.9	94.9	100.0
Unit 5	97.6	99.9	99.9	100.0
Unit 6	Off	Off	Off	Off

Note: Parallel tests averages were used on South Stack for the purpose of accurate reporting of the gases. The station is in a process of sourcing some of components for the gas monitors such Lenses, Zirconium cells for O₂ and Heater gaskets to improve the Monitor reliability and CO₂+O₂ relationship hence the Monitor reliability is not reported on the table above.

7. CEMS Calibration and Equipment Used for Calibration

Calibration certificates to be made available upon request.

8. Validity of Correlation and Parallel Test

Table 9-Validity of Correlation and Parallel Test.

Associated Unit/Stack	Correlation Test (PM)	Parallel Test (NO ₂ , CO ₂ , O ₂ , SO ₂)
South Stack	Valid until 27 February 2027	Valid until 30 October 2025
Unit 4	Valid until 19 May 2025	Valid until 11 May 2027
Unit 5	Valid Until 25 August 2026	Valid until 29 May 2027
Unit 6	Valid until 02 August 2026	Valid until 30 June 2025

CONTROLLED DISCLOSURE

9. Complaint Register

Table 10-Complaints for the month of 05/2025

Source Code/ Name	Air pollution complaints received	Calculation of Impacts/ emissions associated with the incident	Date of complaint and date of response by the license holder	Action taken to resolve the complaint	Date when the action was implemented.
N/A	N/A	N/A	N/A	N/A	N/A

CONTROLLED DISCLOSURE