

Ms Tebogo Mogakabe
 Manager: Municipal Environmental Services
 Gert Sibande District Municipality
 PO BOX 1748
 ERMELO
 2350

Date:
 11 July 2025

Enquiries: Johan Swanepoel
 Tel +27 17 799 2047

MAJUBA POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JUNE 2025

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2019/F03) under section 7 routine reporting and record keeping. The emissions are for the month of June 2025. Verified emissions of particulates are included. SO₂ and NO_x (as NO₂) emissions are included for all units. Greenhouse gasses are excluded as per the agreement reached between Eskom and the Department of Forestry, Fisheries and the Environmental in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting.

Raw Materials and Products

Table 1. Quantity of Raw Materials and Products used/produced for the month of June 2025

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of June 2025
	Coal	Tons/month	1 800 000	1 246 387.7
	Fuel Oil	Tons/month	6 000	3 457
Production Rates	Product/ By-Product Name	Unit	Maximum Production Rate Permitted (Quantity)	Production Rate in Month of June 2025
	Energy	*GWh	*3 058	2 014.98
	Ash	Tons/month	Not stated in the license	370 301.8

*Majuba AEL stipulates a maximum production capacity of 4110 MW. This equates to a production rate of 3058 GWh per month when converted, as indicated above. This is to align to the monthly production rates reported.

Abatement Technology

Table 2. Abatement Equipment Control Technology for the month of June 2025

Associated Unit	Technology Type	Actual Utilisation (%) for the month of July 2024	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.91
Unit 2	Fabric Filter Plant	100	99.92
Unit 3	Fabric Filter Plant	100	99.88
Unit 4	Fabric Filter Plant	100	99.93
Unit 5	Fabric Filter Plant	100	99.93
Unit 6	Fabric Filter Plant	100	99.89

*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal

Energy Source Characteristics

Table 3. Energy Source Material Characteristics for the month of June 2025

Characteristic	Stipulated Limit (Unit)	Monthly Average Content
Sulphur Content	0.9%	0.79
Ash Content	30%	29.71

Emissions Reporting

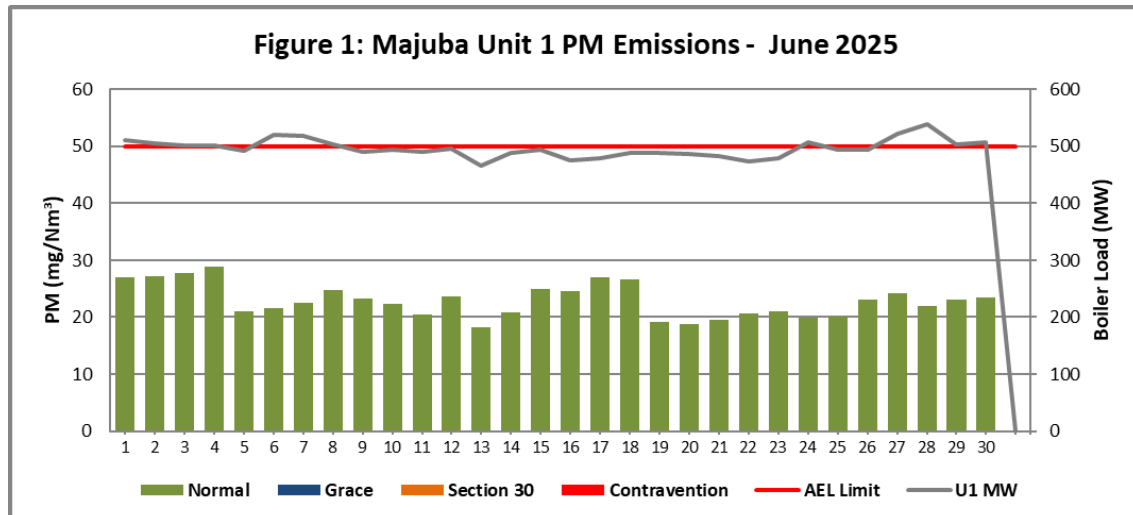


Figure 1. Particulate Matter emissions (daily averages) for the month of June 2025 against emission limit for Unit 1.

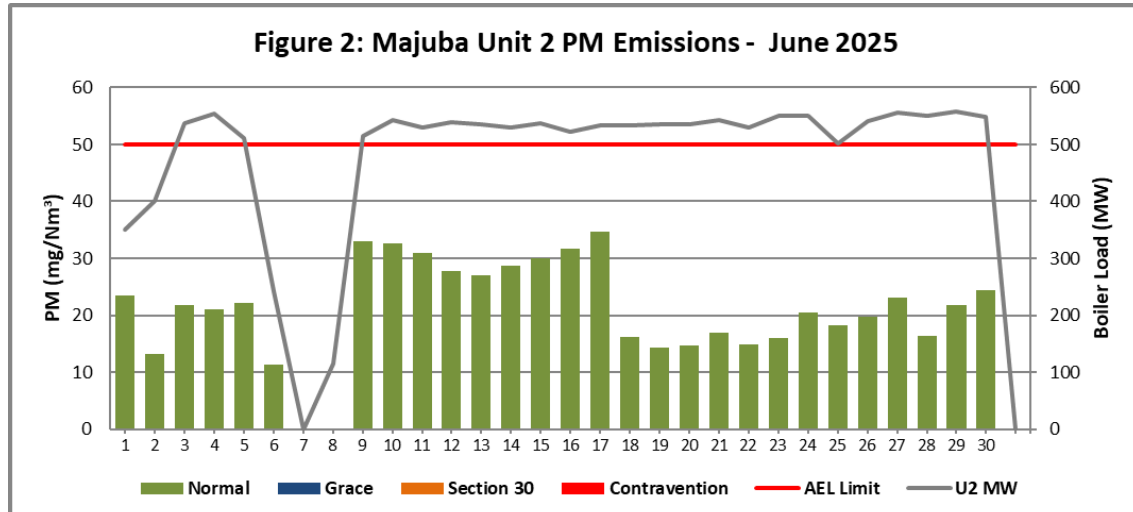


Figure 2. Particulate Matter emissions (daily averages) for the month of June 2025 against emission limit for Unit 2.

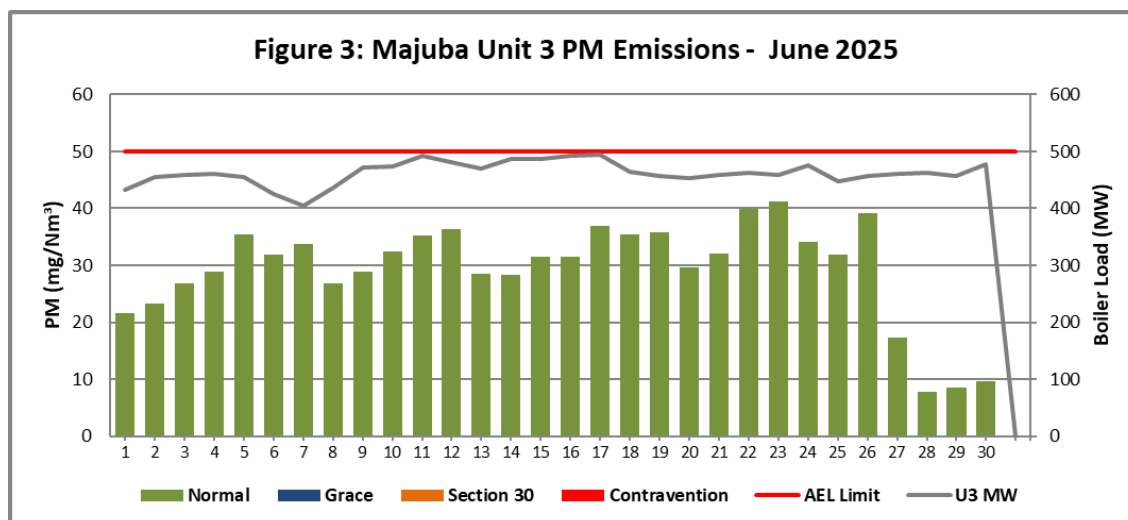


Figure 3. Particulate Matter emissions (daily averages) for the month of June 2025 against emission limit for Unit 3.

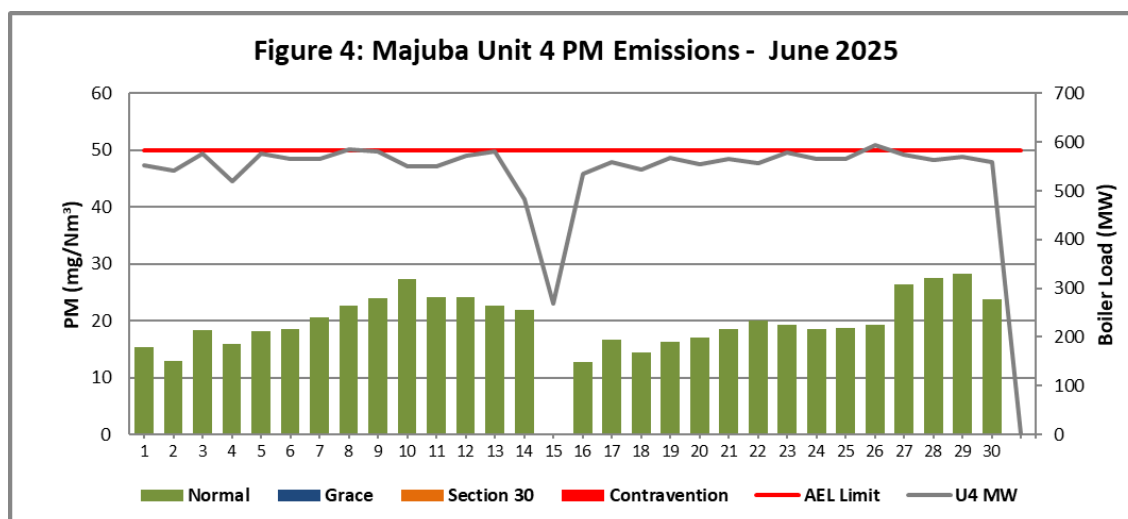


Figure 4. Particulate Matter emissions (daily averages) for the month of June 2025 against emission limit for Unit 4.

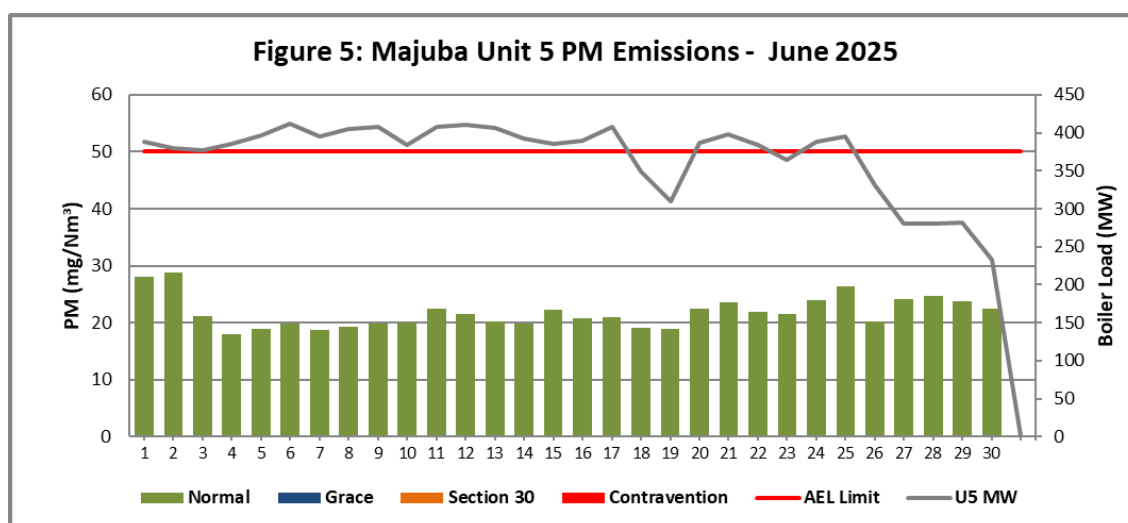


Figure 5. Particulate Matter emissions (daily averages) for the month of June 2025 against emission limit for Unit 5.

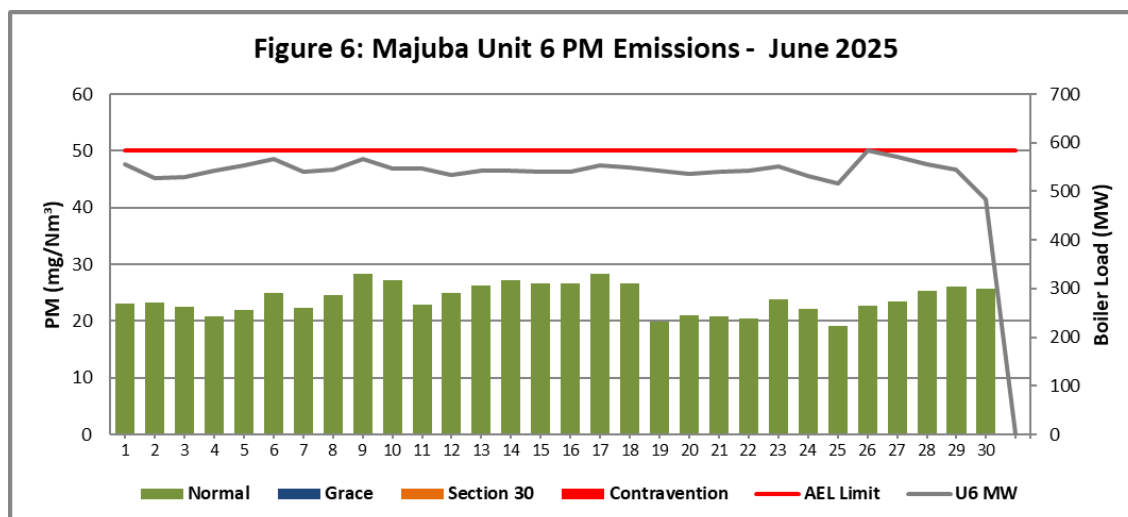


Figure 6. Particulate Matter emissions (daily averages) for the month of June 2025 against emission limit for Unit 6.

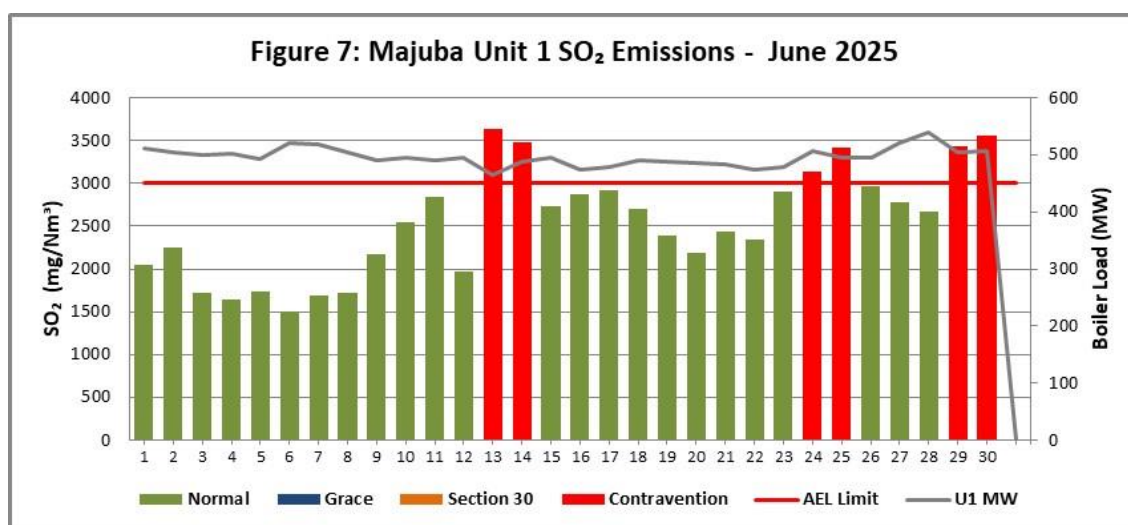


Figure 7. SO₂ emissions (daily averages) for the month of June 2025 against emission limit for Unit 1.

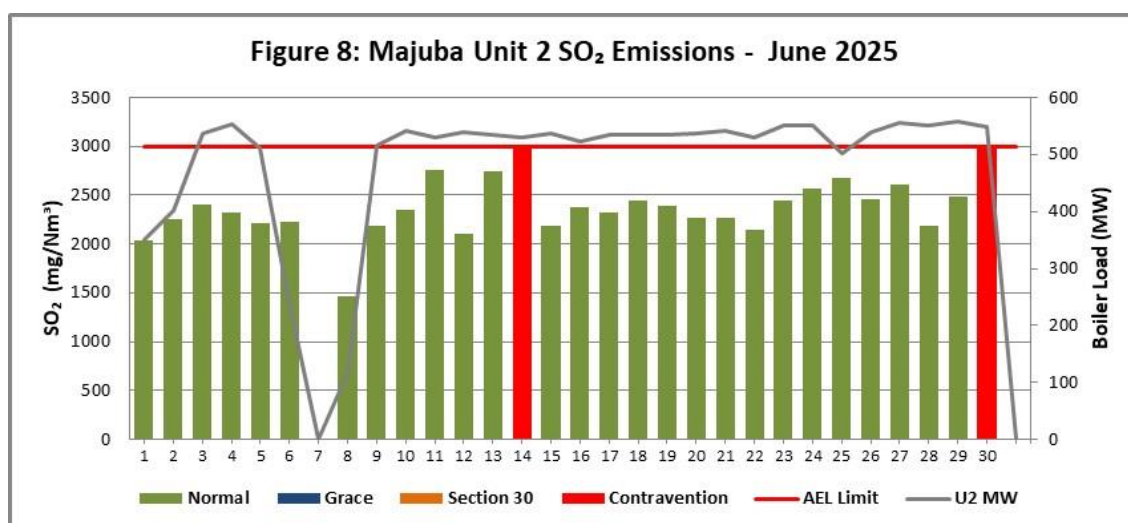


Figure 8. SO₂ emissions (daily averages) for the month of June 2025 against emission limit for Unit 2.

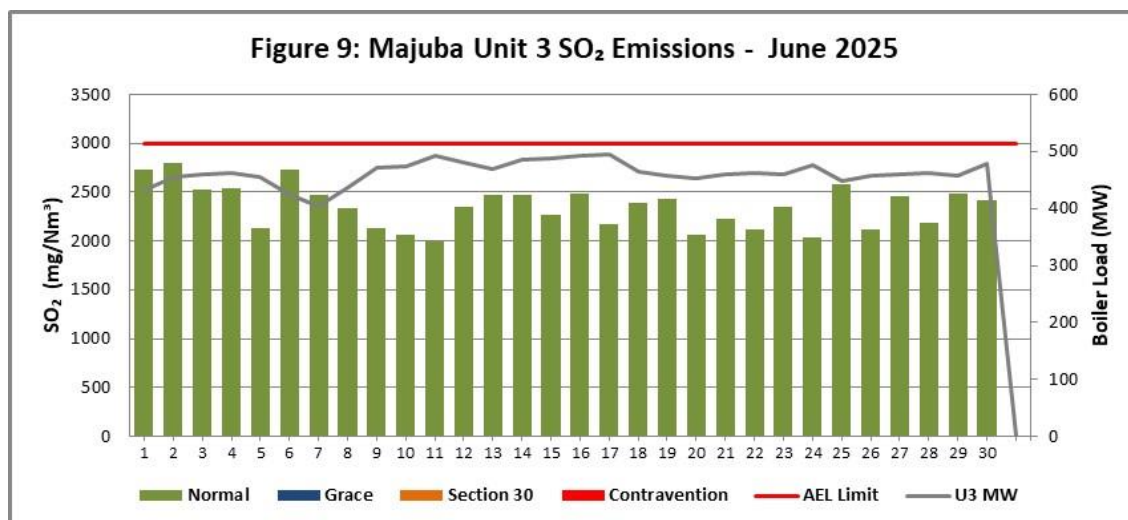


Figure 9. SO₂ emissions (daily averages) for the month of June 2025 against emission limit for Unit 3.

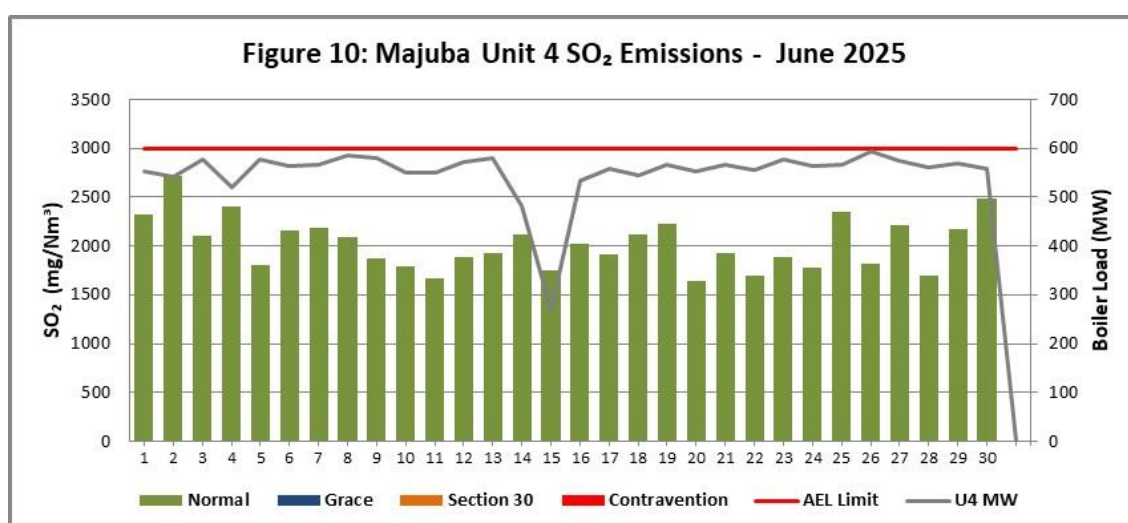


Figure 10. SO₂ emissions (daily averages) for the month of June 2025 against emission limit for Unit 4.

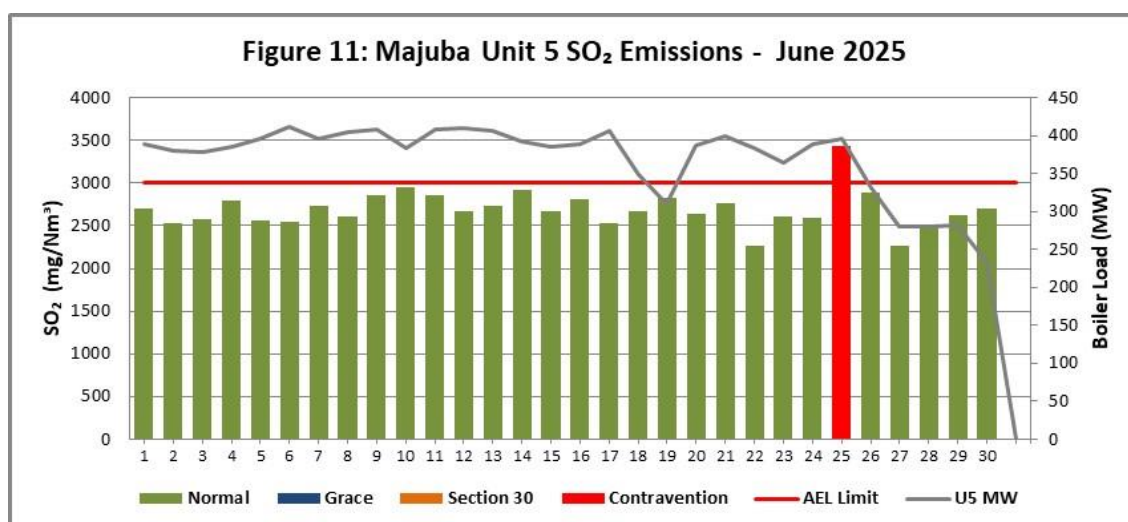


Figure 11. SO₂ emissions (daily averages) for the month of June 2025 against emission limit for Unit 5.

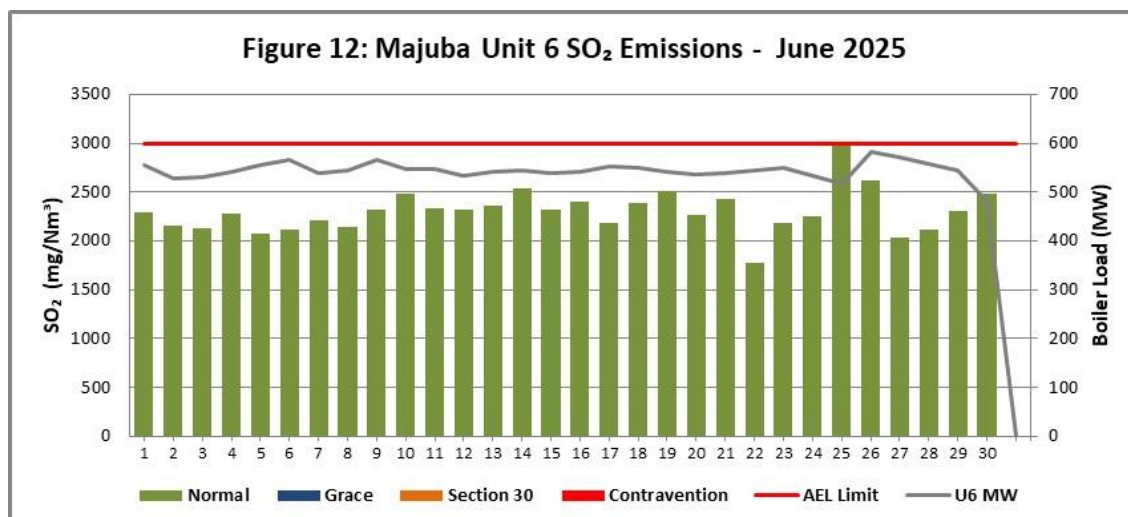


Figure 12. SO₂ emissions (daily averages) for the month of June 2025 against emission limit for Unit 6.

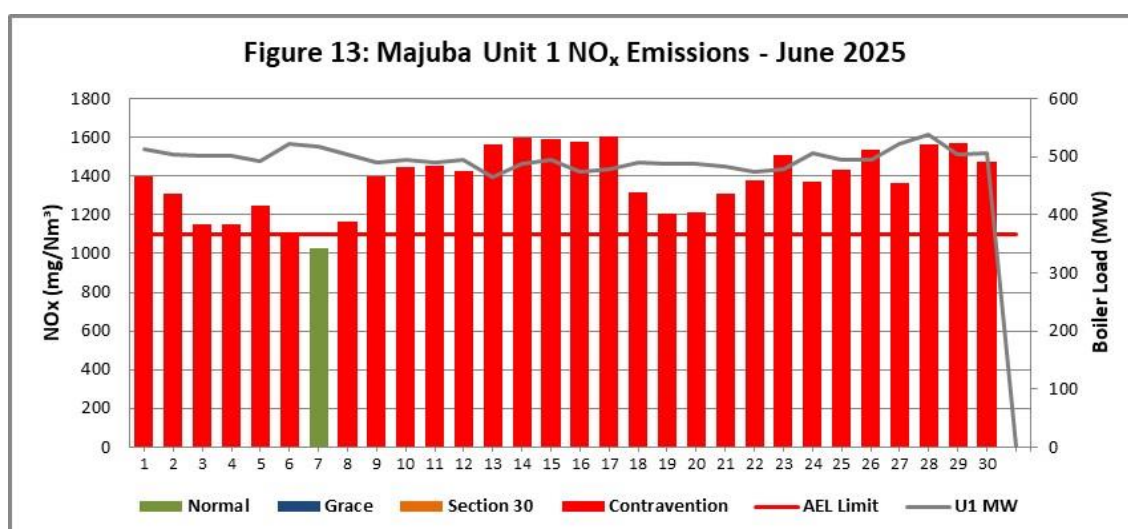


Figure 13. NO_x emissions (daily averages) for the month of June 2025 against emission limit for Unit 1.

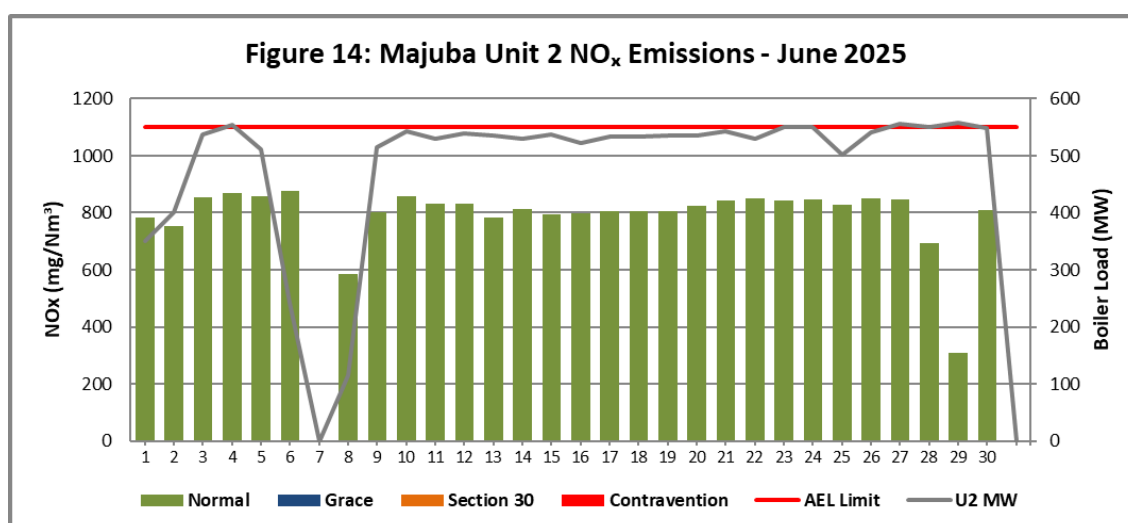


Figure 14. NO_x emissions (daily averages) for the month of June 2025 against emission limit for Unit 2.

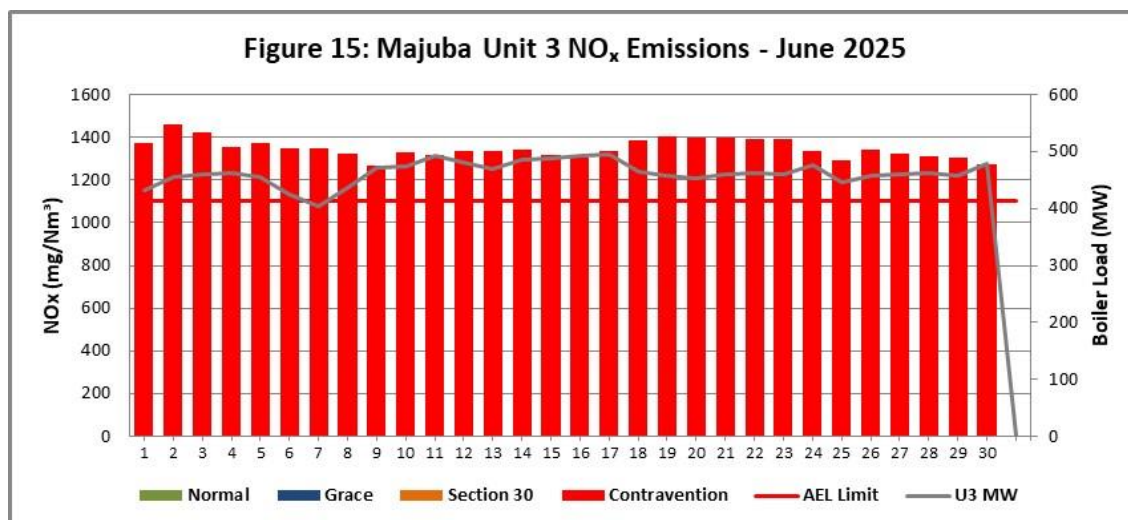


Figure 15. NO_x emissions (daily averages) for the month of June 2025 against emission limit for Unit 3.

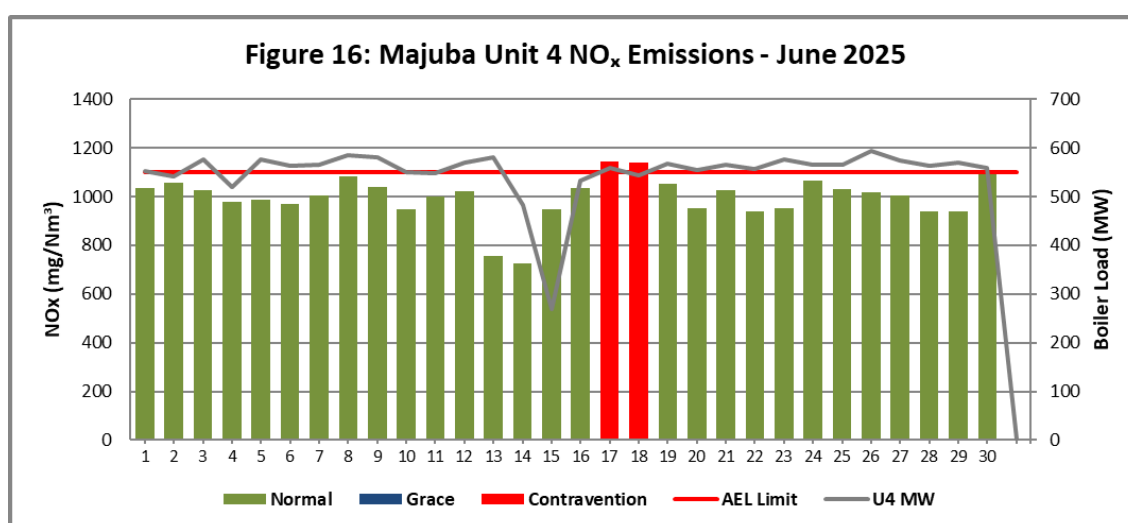


Figure 16. NO_x emissions (daily averages) for the month of June 2025 against emission limit for Unit 4

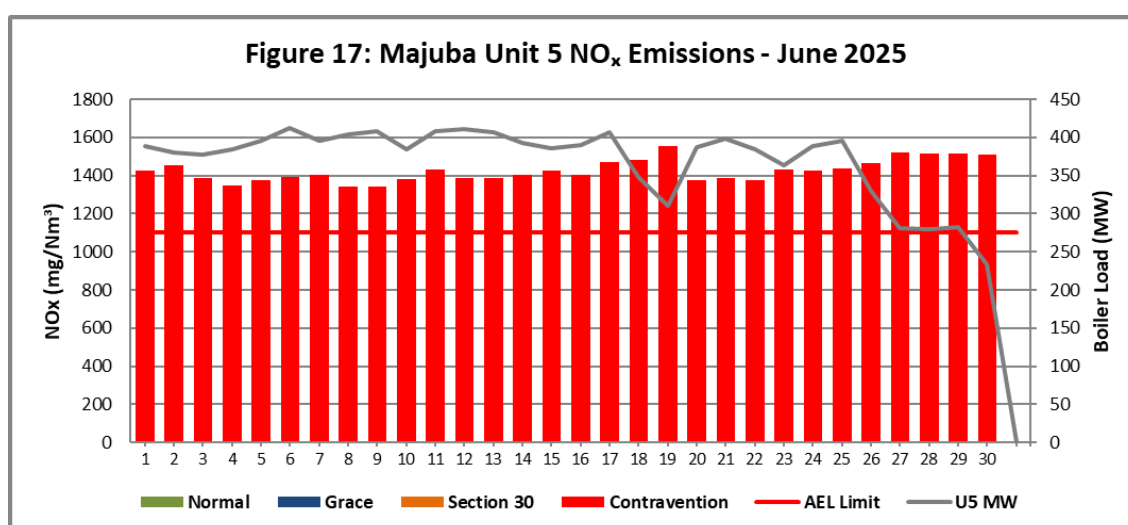


Figure 17. NO_x emissions (daily averages) for the month of June 2025 against emission limit for Unit 5

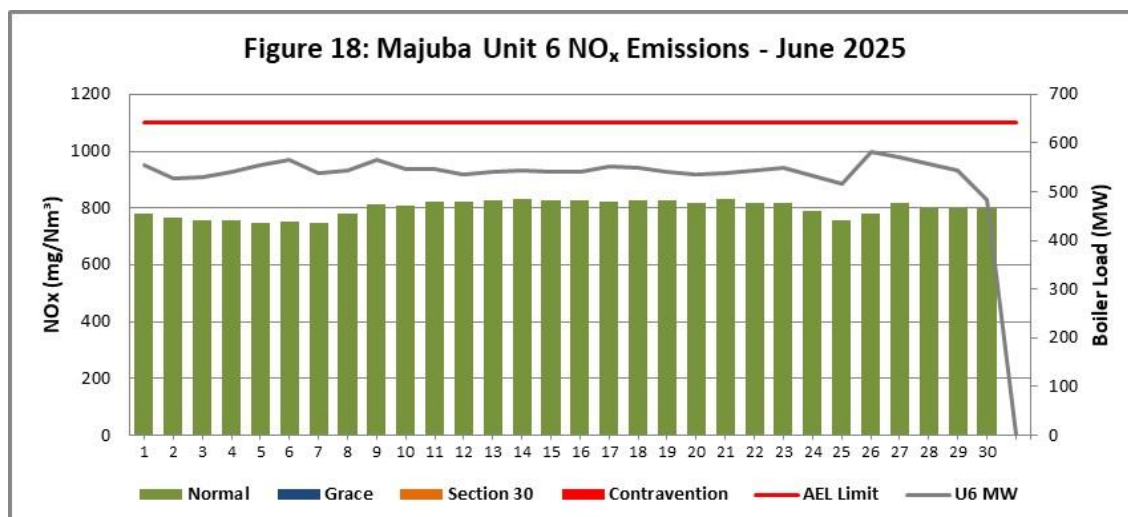


Figure 18. NO_x emissions (daily averages) for the month June 2025 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of June 2025

Unit	PM (tons)	SO ₂ (tons)	NO _x (tons)
Unit 1	49.7	5 376	2 943
Unit 2	48.5	5 551	1 843
Unit 3	57.0	4 691	2 699
Unit 4	42.1	4 309	2 130
Unit 5	39.6	4 894	2 569
Unit 6	61.8	5 910	2 055

Table 5: Average monthly concentrations (mg/Nm³) for the month of June 2025

Unit	PM (Mg/Nm ³)	SO ₂ (Mg/Nm ³)	NO _x (Mg/Nm ³)
1	22.9	2 547.2	1 381.4
2	22.4	2 375.7	795.0
3	29.3	2 352.0	1 348.5
4	20.1	2 024.0	997.1
5	21.8	2 694.7	1 425.1
6	24.0	2 300.2	798.9

Table 6: Each unit and respective days operating in compliance to the AEL Emission Limits (SO₂, NO_x, and PM)

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	1	0	0	29	29
Unit 2	27	0	0	2	2
Unit 3	0	0	0	30	30
Unit 4	28	0	0	02	02
Unit 5	0	0	0	30	30
Unit 6	30	0	0	0	0

Table 7: Monitor Reliability (%)

Associated Unit/Stack	PM	SO ₂	NO	O ₂
Unit 1	100.0	96.0	100.0	100.0
Unit 2	99.4	96.0	100.0	0.0
Unit 3	99.4	100.0	100.0	100.0
Unit 4	100.0	96.5	100.0	99.6
Unit 5	100.0	97.9	100.0	100.0
Unit 6	100.0	100.0	100.0	100.0

Table 8: CO₂ and O₂ deviations of the Month of June 2025

	Final O ₂ CEMS Data (%)						CO ₂ (Actual Dry %)						SUM CO ₂ + O ₂ CEMS Data (%)					
	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
2025/07/08	10.8	10.3	13.1	11.8	8.2	9.4	10.1	8.1	8.4	8.9	11.3	11.5	20.9	18.4	21.5	20.7	19.5	20.9
2025/06/01	10.3	10.3	12.7	11.9	8.5	9.9	9.8	7.9	8.4	8.8	11.3	11.5	20.1	18.2	21.1	20.7	19.8	21.4
2025/06/02	8.8	10.3	12.7	11.4	8.5	9.9	9.5	9.5	8.4	9.2	11.3	11.5	18.3	19.8	21.0	20.6	19.8	21.4
2025/06/03	8.8	10.3	12.6	11.9	8.6	9.8	9.5	9.8	8.4	8.8	11.2	11.5	18.3	20.1	21.0	20.7	19.8	21.3
2025/06/04	10.9	10.3	12.5	10.4	8.3	9.6	9.3	9.3	8.3	9.8	11.1	11.4	20.2	19.6	20.8	20.1	19.4	20.9
2025/06/05	9.4	10.3	13.1	10.0	8.3	9.7	9.4	7.9	8.4	9.5	11.2	11.5	18.8	18.2	21.5	19.5	19.5	21.2
2025/06/06	9.0		12.6	10.1	8.6	9.9	9.5		8.3	9.6	11.3	11.5	18.4		20.9	19.7	19.9	21.4
2025/06/07	10.2	10.3	12.5	10.7	8.4	9.9	9.5	7.6	8.4	9.7	11.3	11.6	19.7	17.9	20.9	20.5	19.7	21.5
2025/06/08	12.2	10.3	11.8	10.3	8.3	9.7	9.4	8.8	8.3	10.0	11.3	11.5	21.7	19.1	20.1	20.3	19.6	21.2
2025/06/09	12.7	10.3	11.9	10.6	8.6	9.7	9.3	9.1	8.3	9.1	11.1	11.3	22.0	19.4	20.2	19.7	19.7	21.0
2025/06/10	12.7	10.3	11.7	10.6	8.3	9.8	9.4	8.9	8.3	9.1	11.1	11.3	22.0	19.2	20.0	19.7	19.5	21.1
2025/06/11	12.3	10.3	11.9	10.6	8.1	10.1	9.3	9.4	8.2	9.3	11.1	11.3	21.6	19.7	20.1	19.9	19.3	21.4
2025/06/12	13.1	10.3	12.1	11.0	8.1	10.0	9.3	9.0	8.2	9.4	11.2	11.3	22.3	19.3	20.3	20.5	19.3	21.3
2025/06/13	12.6	10.3	11.8	11.2	8.5	9.9	9.1	9.1	8.2	9.3	11.1	11.4	21.7	19.4	20.1	20.6	19.6	21.3
2025/06/14	12.5	10.3	11.8	11.7	8.6	9.8	9.1	9.5	8.2	8.6	11.1	11.3	21.5	19.8	20.0	20.3	19.7	21.0
2025/06/15	12.6	10.3	11.7	11.4	8.6	9.7	9.1	9.3	8.3	8.7	11.1	11.4	21.7	19.6	20.0	20.1	19.8	21.1
2025/06/16	12.7	10.3	11.8	12.1	8.2	9.3	9.2	9.3	8.3	9.0	11.3	11.4	21.8	19.6	20.1	21.1	19.5	20.7
2025/06/17	10.8	10.3	12.4	12.2	9.7	9.9	9.2	9.2	8.4	8.8	11.4	11.5	20.0	19.5	20.8	21.0	21.0	21.3
2025/06/18	10.2	10.3	12.6	11.5	10.3	10.0	9.2	9.3	8.5	9.2	11.2	11.5	19.4	19.6	21.0	20.8	21.5	21.5
2025/06/19	10.1	10.3	12.5	10.4	8.6	9.9	9.2	9.5	8.4	9.3	11.2	11.4	19.2	19.8	20.9	19.7	19.8	21.3
2025/06/20	11.1	10.3	12.0	11.0	8.5	9.9	9.1	9.5	8.6	9.2	11.2	11.4	20.2	19.8	20.7	20.2	19.7	21.3
2025/06/21	11.4	10.3	11.8	10.4	8.8	9.3	9.1	9.6	9.1	9.2	11.2	11.3	20.4	19.9	20.8	19.6	20.0	20.6
2025/06/22	12.4	10.3	11.9	10.4	9.2	9.5	9.2	9.7	9.2	9.5	11.2	11.4	21.5	20.0	21.0	19.8	20.4	20.9
2025/06/23	11.9	10.3	11.8	11.5	8.9	9.7	9.2	9.6	9.0	9.4	11.2	11.4	21.2	19.9	20.8	20.9	20.0	21.1
2025/06/24	12.2	10.3	12.4	11.5	9.0	10.2	9.3	9.1	9.2	9.0	11.3	11.4	21.6	19.4	21.5	20.5	20.3	21.5
2025/06/25	12.2	10.3	12.1	11.0	9.8	8.8	9.4	9.6	9.1	9.5	11.2	11.6	21.6	19.9	21.2	20.5	20.9	20.4
2025/06/26	10.7	10.3	12.0	11.0	10.2	8.8	9.2	9.7	9.1	9.3	10.7	11.3	20.0	20.0	21.1	20.3	20.9	20.1
2025/06/27	11.9	10.3	11.8	10.2	10.3	8.9	9.3	9.8	9.0	9.3	10.7	11.3	21.2	20.1	20.8	19.5	21.0	20.2
2025/06/28	12.0	10.3	11.8	10.3	10.2	9.0	9.2	9.7	9.0	9.3	10.6	11.3	21.2	20.0	20.8	19.6	20.8	20.3
2025/06/29	11.8	10.3	11.4	10.0	10.3	10.8	9.2	9.6	9.0	9.8	10.7	11.4	21.0	19.9	20.4	19.8	21.1	22.2

Calculation: CO₂% + O₂% = 19.5-21.5%

*Blank spaces indicate that the unit was offline during that period

Emergency Generation

Table 9: Emergency Generation for the month of June 2025

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

Comments on the performance and availability of each unit

UNIT 1

The unit base loaded for all the days during the month. Twenty-seven fabric filter bags were replaced during the month.

UNIT 2

The unit base loaded for most of the days during the month and off for two days. Thirty fabric filter bags were replaced during the month.

UNIT 3

The unit base loaded for all the days during the month. One hundred and twelve and five fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for most of the days during the month and off for one day. Fifty-five fabric filter bags were replaced during the month.

UNIT 5

The unit base loaded for all the days during the month. Thirteen fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for all the days during the month. Thirty-four fabric filter bags were replaced during the month.

Complaints Register

Table 10: Complaints for the month of June 2025


Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modelling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received during the month of June 2025.				

General

Unit 2 O₂ monitor remains faulty, the Station is still in the process of sourcing spares. The new exemption limit of 1100 mg/Nm³ for NO_x was exceeded at Unit 1 (29 times), Unit 3 (30 times), Unit 4 (3 times) and Unit 5 (30 times). In addition, the new exemption limit of 3000 mg/Nm³ for SO₂ was exceeded at Unit 1 (6 times), Unit 2 (2 times) and Unit 5 (once). The Station has concluded the investigation, and the report will be shared with the licensing authority once it has been signed off.

Yours sincerely

Report compiled by:



Faith Kagoda

ENVIRONMENTAL MANAGER: (MAJUBA)

Date 11/07/2025

Report verified by:



Lindani Madonsela

BOILER ENGINEERING MANAGER: (MAJUBA)

Date 11/07/2025

Report approved by:



Johan Swanepoel

ENGINEERING MANAGER: (MAJUBA)

2025/07/11

Date