

Ms Tebogo Mogakabe
 Manager: Municipal Environmental Services
 Gert Sibande District Municipality
 PO BOX 1748
 ERMELO
 2350

Date:
 14 August 2025

Enquiries: Johan Swanepoel
 Tel +27 17 799 2047

MAJUBA POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JULY 2025

This serves as the monthly report required in terms of Majuba Power Station's Atmospheric Emission License (MPS/0014/2025/F05) under section 7.6 routine reporting and record keeping. The emissions are for the month of July 2025. Verified emissions of particulates are included. SO₂ and NO_x (as NO₂) emissions are included for all units. Greenhouse gases are excluded as per the agreement reached between Eskom and the Department of Forestry, Fisheries and the Environmental in the first quarter of 2017/18 financial year's MINTEC and MINMEC management meeting.

Raw Materials and Products

Table 1. Quantity of Raw Materials and Products used/produced for the month of July 2025

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of July 2025
	Coal	Tons/month	1 800 000	1 133 247
	Fuel Oil	Tons/month	6 000	5 776.6
Production Rates	Product/ By-Product Name	Unit	Maximum Production Rate Permitted (Quantity)	Production Rate in Month of July 2025
	Energy	GWh	3 058	1 901
	Ash	Tons/month	429 746	389 837

Abatement Technology

Table 2. Abatement Equipment Control Technology for the month of July 2025

Associated Unit	Technology Type	Actual Utilisation (%) for the month of July 2025	*Minimum Control Efficiency (%)
Unit 1	Fabric Filter Plant	100	99.94
Unit 2	Fabric Filter Plant	100	99.93
Unit 3	Fabric Filter Plant	100	99.93
Unit 4	Fabric Filter Plant	100	99.95
Unit 5	Fabric Filter Plant	100	99.95
Unit 6	Fabric Filter Plant	100	99.92

*Calculated from the assumption of 90% fly ash to 10% bottom ash and percentage ash as measured in coal

Energy Source Characteristics

Table 3. Energy Source Material Characteristics for the month of July 2025

Characteristic	Stipulated Limit (Unit)	Monthly Average Content
Sulphur Content	<1.25%	0.60
Ash Content	<33.84%	34.4

Emissions Reporting

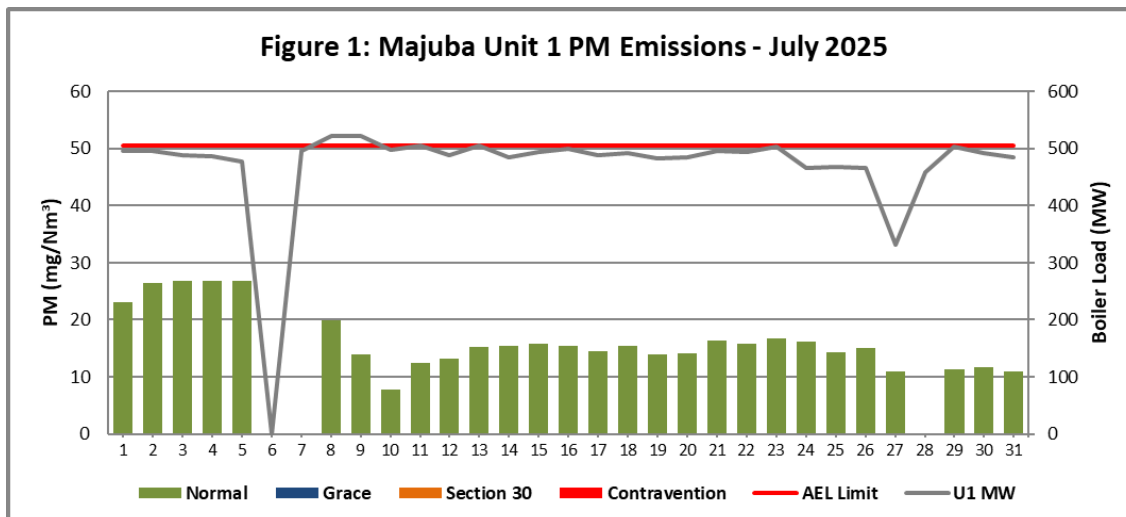


Figure 1. Particulate Matter emissions (daily averages) for the month of July 2025 against emission limit for Unit 1.

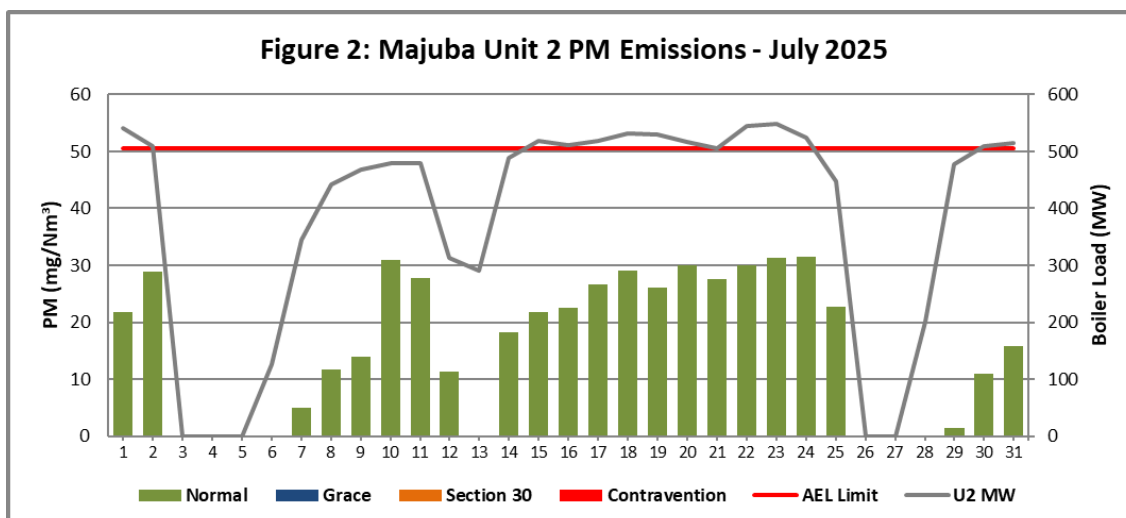


Figure 2. Particulate Matter emissions (daily averages) for the month of July 2025 against emission limit for Unit 2.

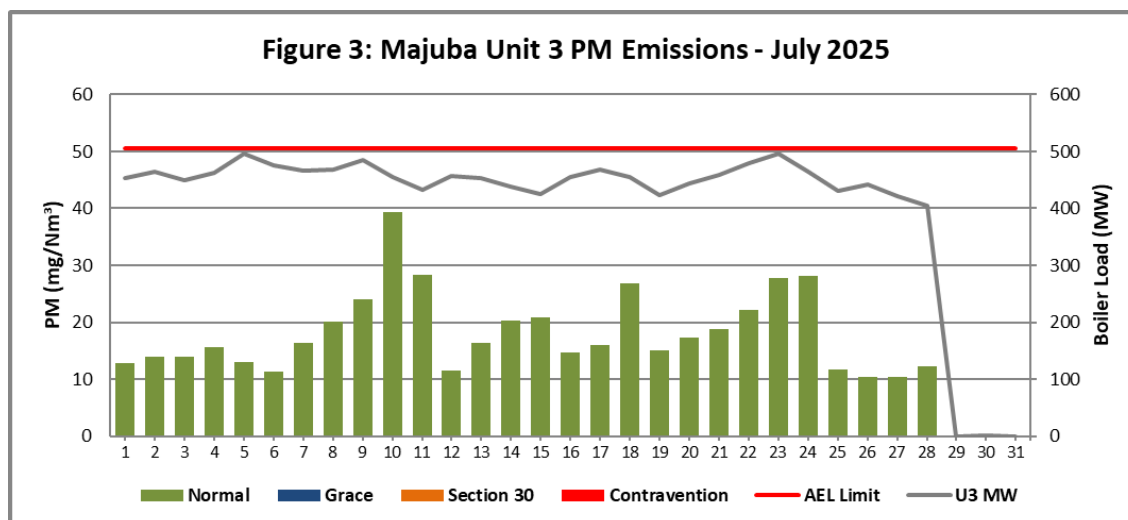


Figure 3. Particulate Matter emissions (daily averages) for the month of July 2025 against emission limit for Unit 3.

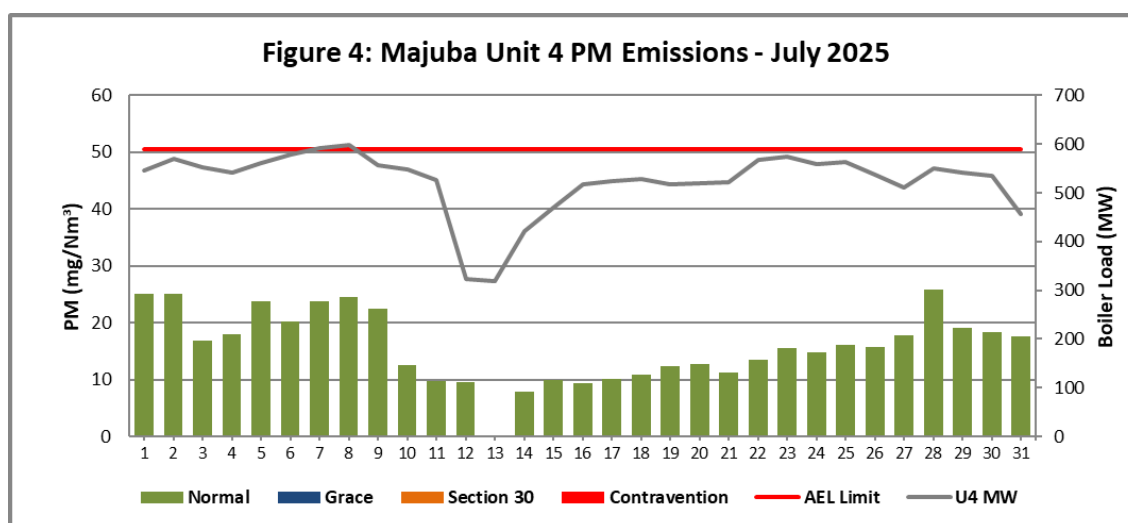


Figure 4. Particulate Matter emissions (daily averages) for the month of July 2025 against emission limit for Unit 4.

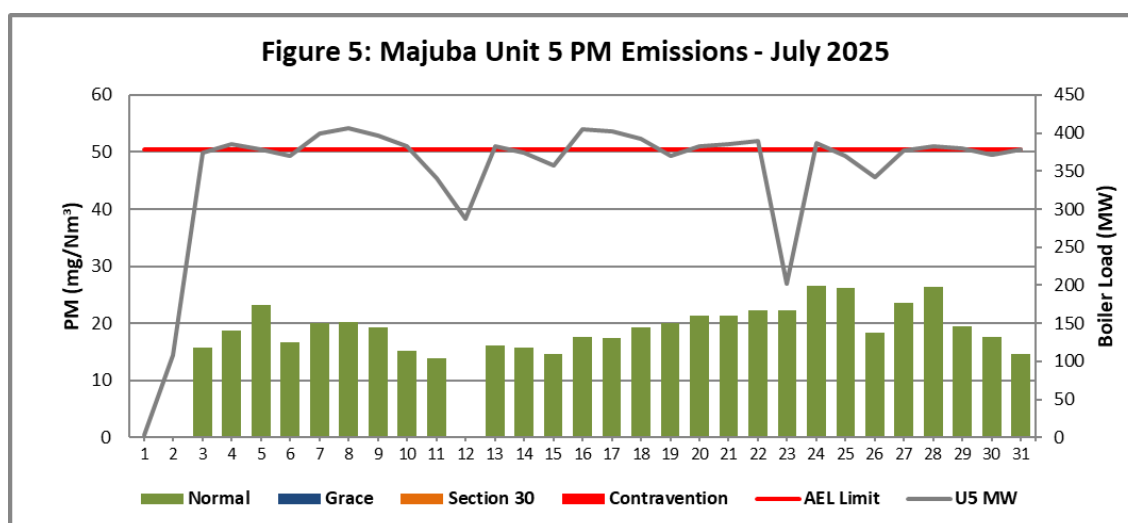


Figure 5. Particulate Matter emissions (daily averages) for the month of July 2025 against emission limit for Unit 5.

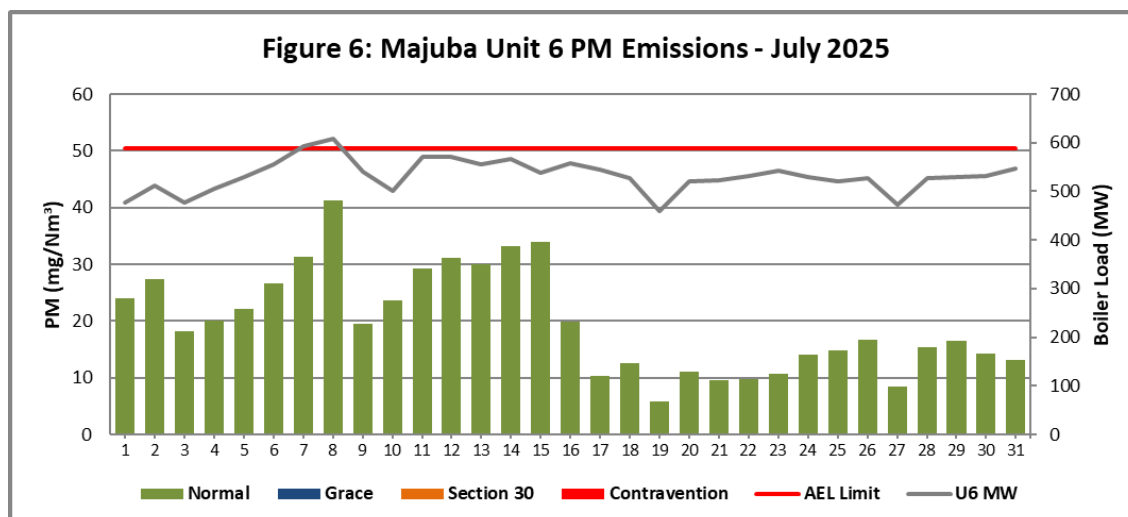


Figure 6. Particulate Matter emissions (daily averages) for the month of July 2025 against emission limit for Unit 6.

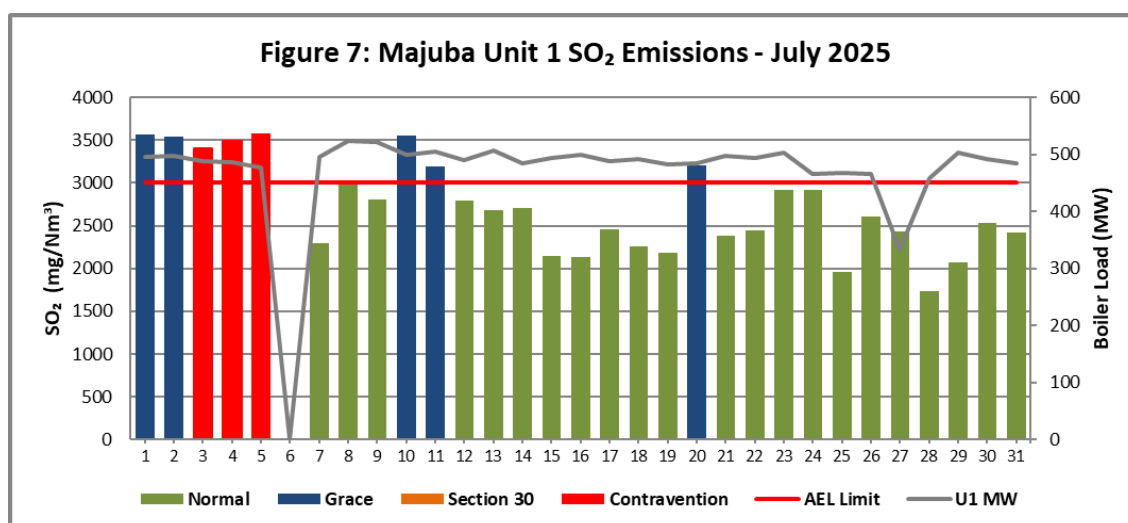


Figure 7. SO₂ emissions (daily averages) for the month of July 2025 against emission limit for Unit 1.

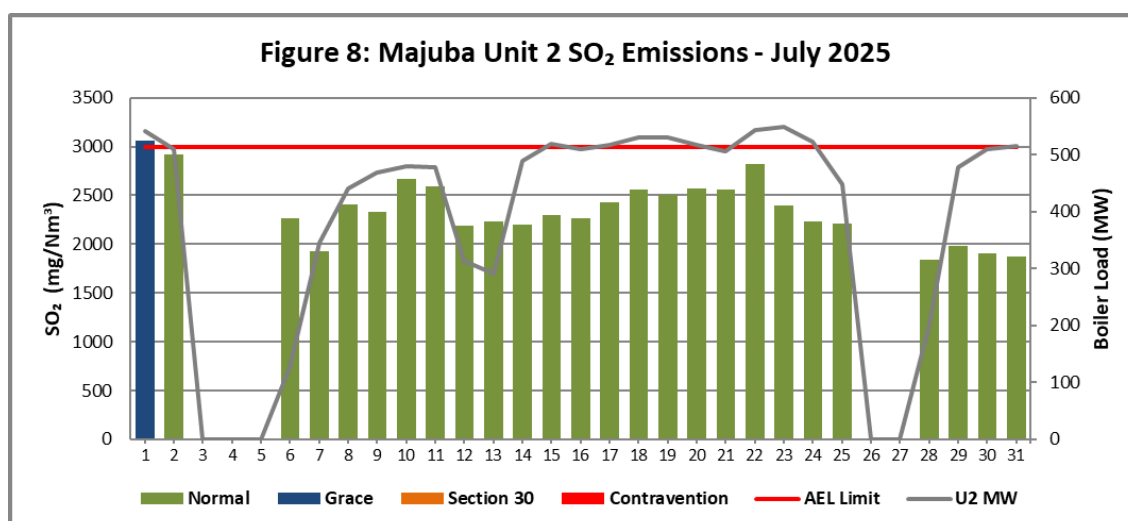


Figure 8. SO₂ emissions (daily averages) for the month of July 2025 against emission limit for Unit 2.

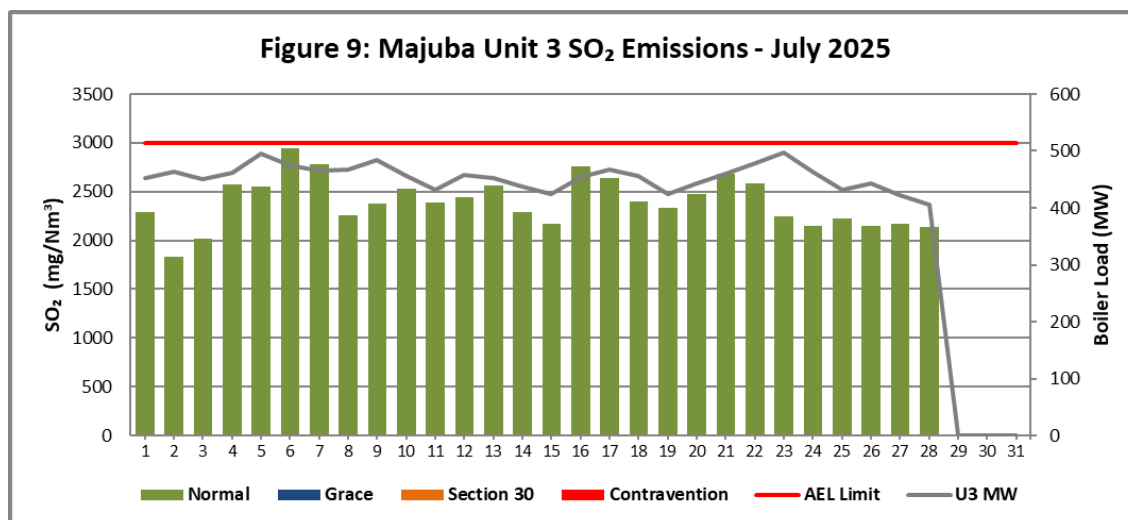


Figure 9. SO₂ emissions (daily averages) for the month of July 2025 against emission limit for Unit 3.

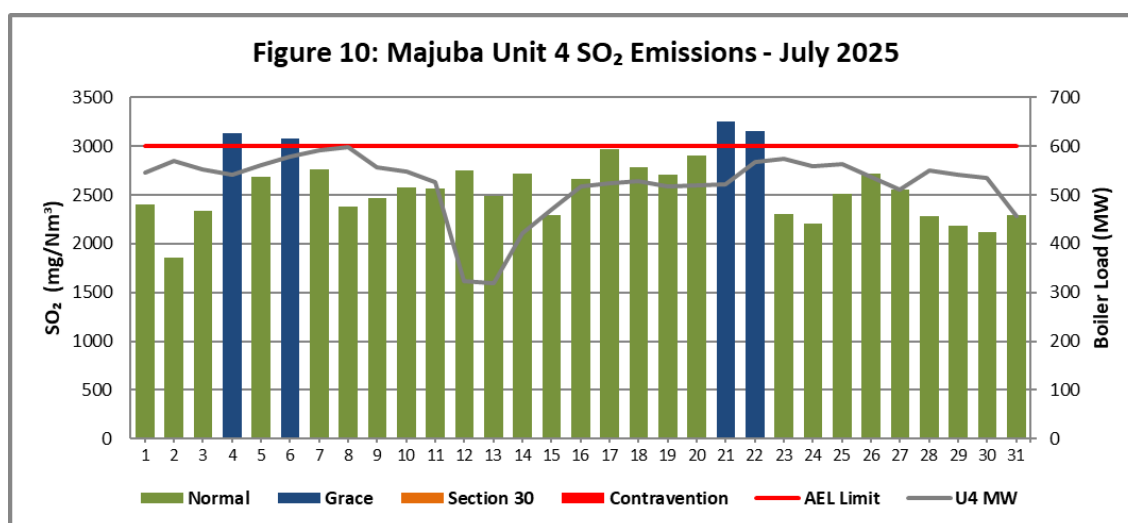


Figure 10. SO₂ emissions (daily averages) for the month of July 2025 against emission limit for Unit 4.

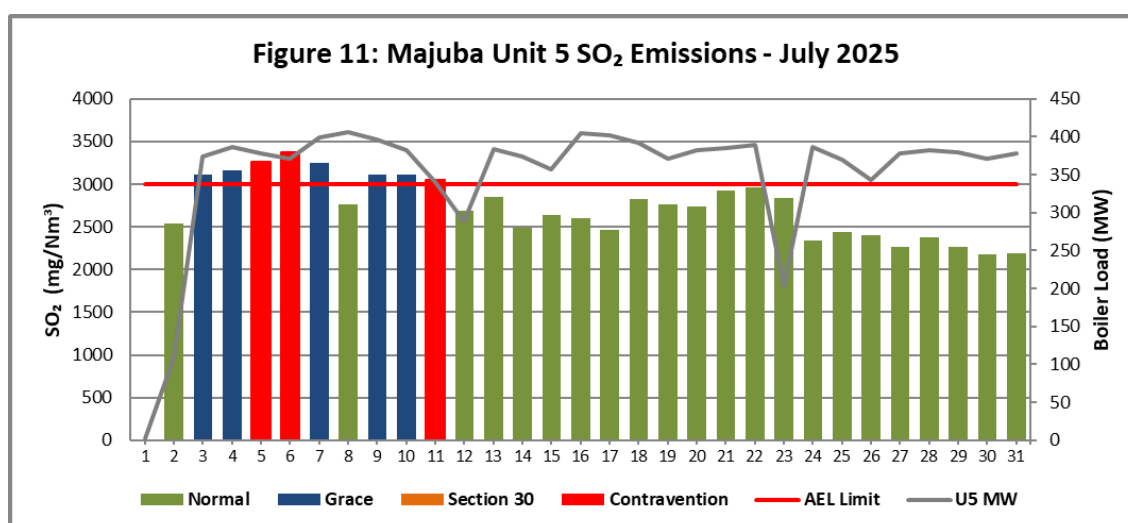


Figure 11. SO₂ emissions (daily averages) for the month of July 2025 against emission limit for Unit 5.

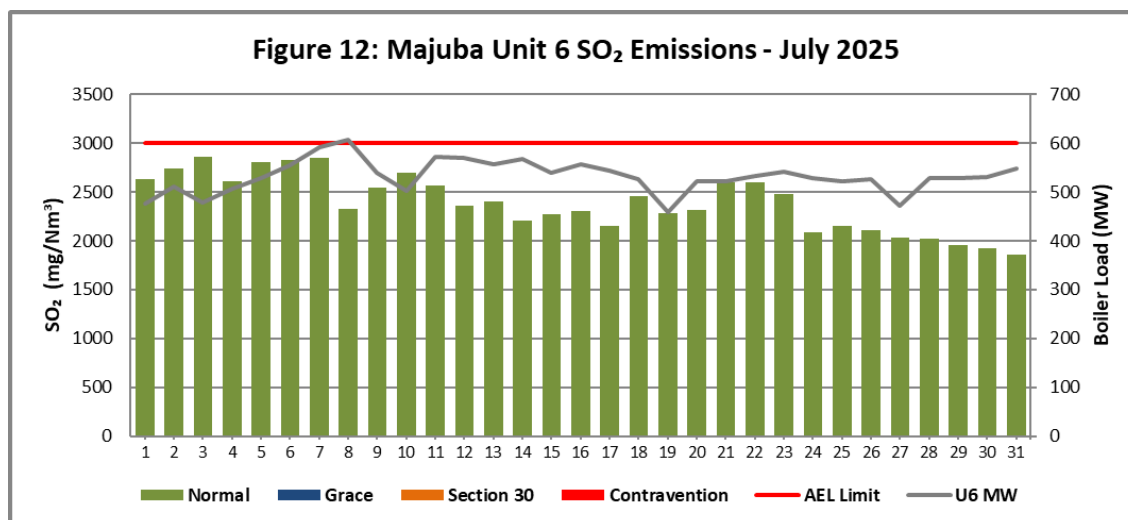


Figure 12. SO₂ emissions (daily averages) for the month of July 2025 against emission limit for Unit 6.

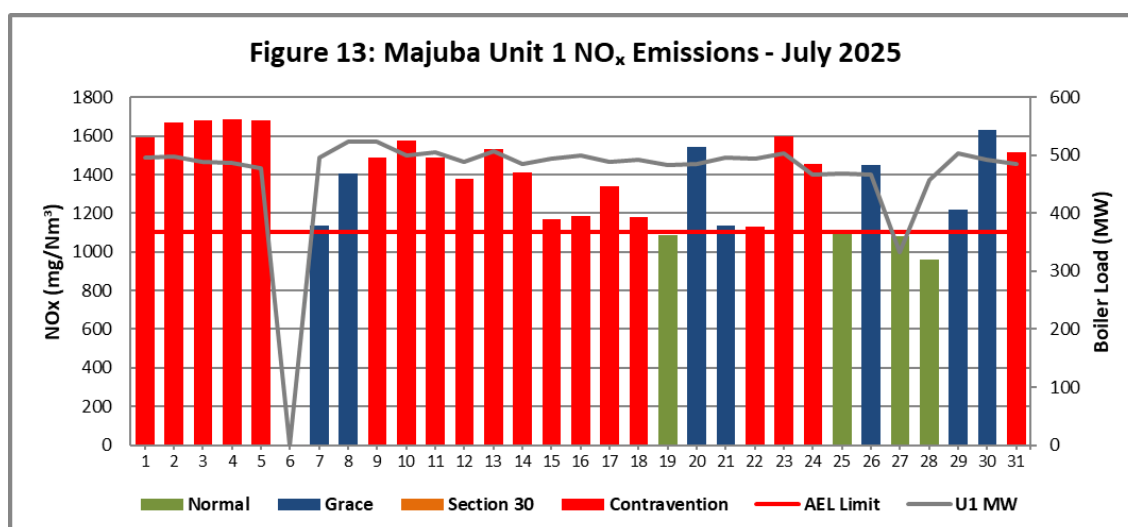


Figure 13. NO_x emissions (daily averages) for the month of July 2025 against emission limit for Unit 1.

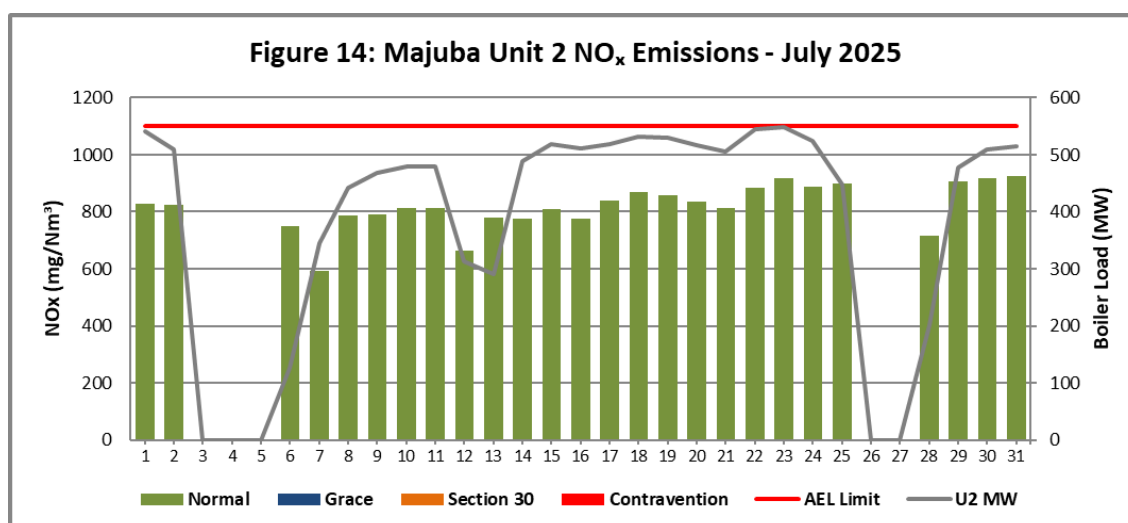


Figure 14. NO_x emissions (daily averages) for the month of July 2025 against emission limit for Unit 2.

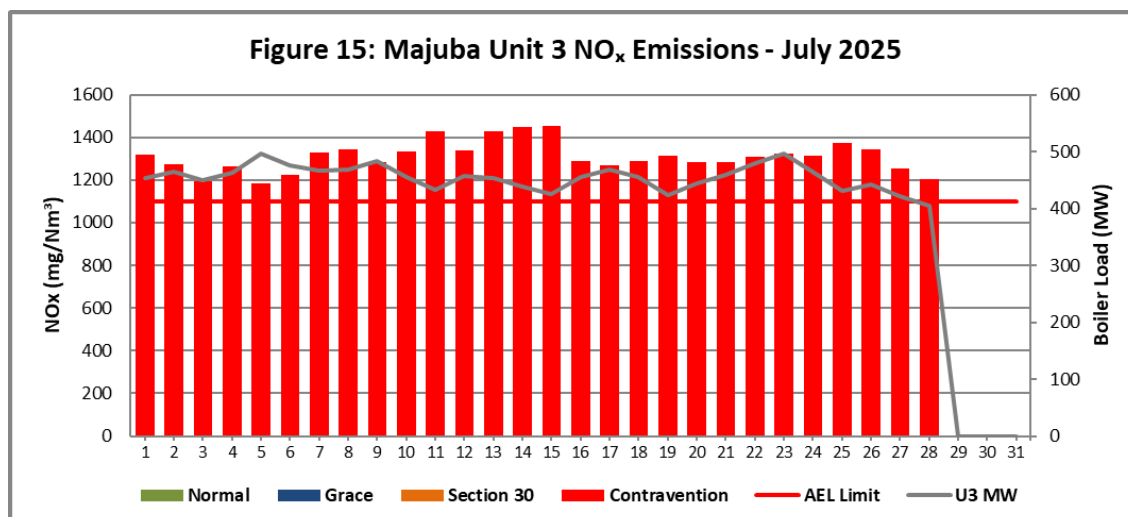


Figure 15. NO_x emissions (daily averages) for the month of July 2025 against emission limit for Unit 3.

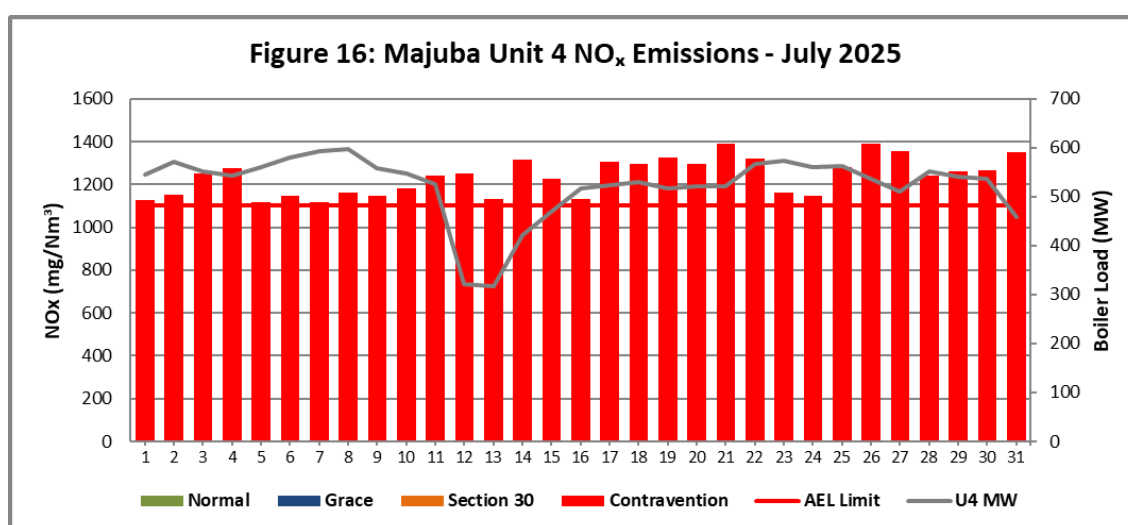


Figure 16. NO_x emissions (daily averages) for the month of July 2025 against emission limit for Unit 4

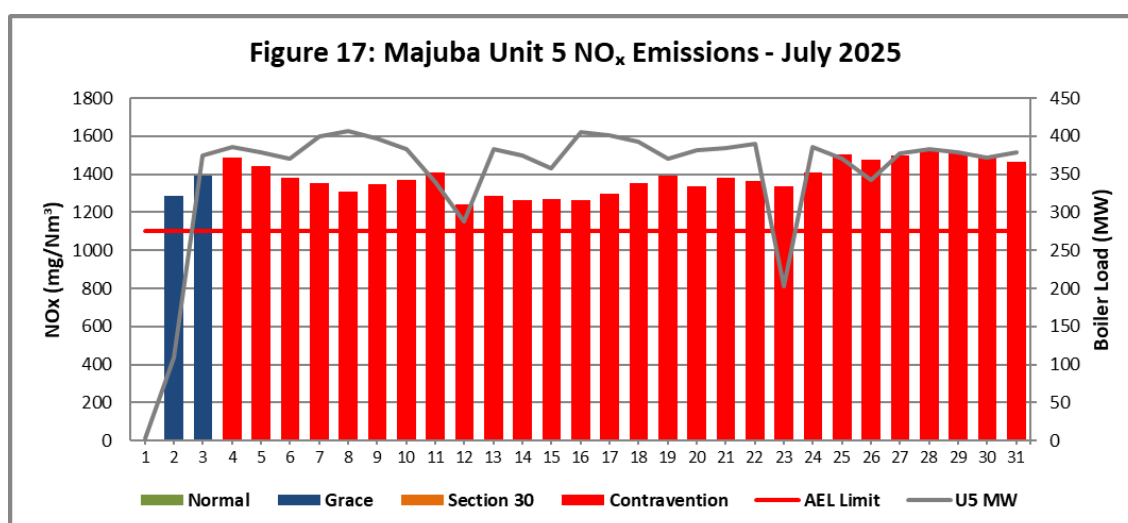


Figure 17. NO_x emissions (daily averages) for the month of July 2025 against emission limit for Unit 5

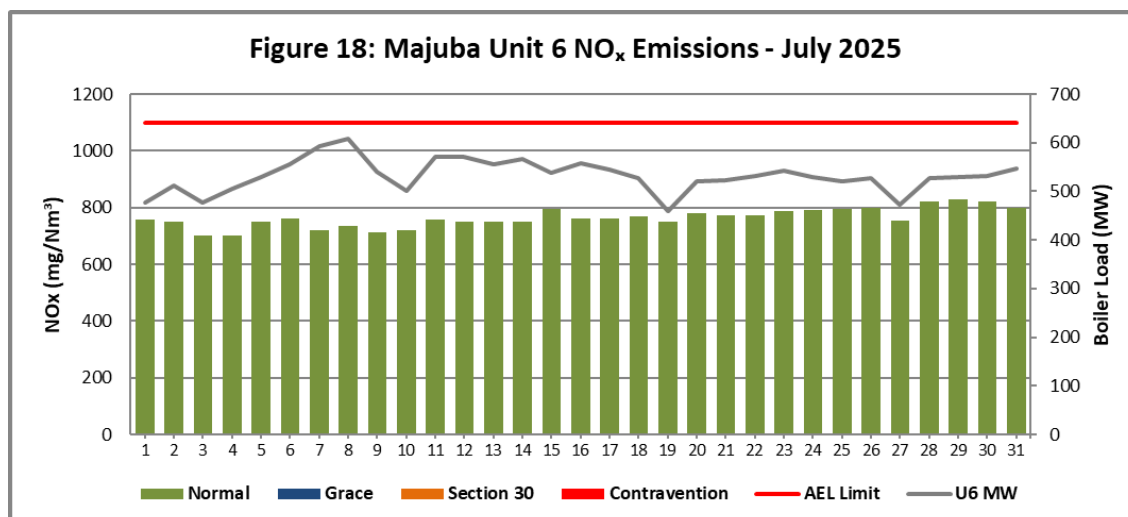


Figure 18. NO_x emissions (daily averages) for the month July 2025 against emission limit for Unit 6

Table 4: Monthly tonnages for the month of July 2025

Unit	PM (tons)	SO ₂ (tons)	NO _x (tons)
Unit 1	30.6	5 511	2 829
Unit 2	38.9	4 633	1 612
Unit 3	34.1	4 482	2 452
Unit 4	35.0	5 489	2 630
Unit 5	31.6	5 012	2 535
Unit 6	52.2	6 169	1 974

Table 5: Average monthly concentrations (mg/Nm³) for the month of July 2025

Unit	PM (Mg/Nm ³)	SO ₂ (Mg/Nm ³)	NO _x (Mg/Nm ³)
1	16.3	2 713.0	1 383.1
2	21.6	2 353.9	818.0
3	18.2	2 391.0	1 310.5
4	16.3	2 583.9	1 237.4
5	19.4	2 732.0	1 381.8
6	19.8	2 389.5	763.8

Table 6: Each unit and respective days operating in compliance to the AEL PM Emission Limits

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	28	0	0	0	0
Unit 2	23	0	0	0	0
Unit 3	28	0	0	0	0
Unit 4	30	0	0	0	0
Unit 5	28	0	0	0	0
Unit 6	31	0	0	0	0

Table 7: Each unit and respective days operating in compliance to the AEL SO₂ Emission Limits

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	22	3	0	5	8
Unit 2	25	1	0	0	1
Unit 3	28	0	0	0	0
Unit 4	27	4	0	0	4
Unit 5	22	4	0	4	8
Unit 6	31	0	0	0	0

Table 8: Each unit and respective days operating in compliance to the AEL NOX Emission Limits

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance
Unit 1	4	7	0	19	26
Unit 2	26	0	0	0	0
Unit 3	0	0	0	28	28
Unit 4	0	0	0	31	31
Unit 5	0	2	0	28	30
Unit 6	31	0	0	0	0

Table 9: Monitor Reliability (%)

Associated Unit/Stack	PM	SO ₂	NO	O ₂
Unit 1	100.0	96.9	100.0	96.7
Unit 2	96.3	96.9	96.9	100.0
Unit 3	99.0	100.0	100.0	100.0
Unit 4	99.2	100.0	100.0	99.5
Unit 5	99.1	99.0	100.0	99.2
Unit 6	99.2	100.0	100.0	100.0

Table 10: CO₂ and O₂ deviations of the Month of July 2025

2025/08/11	Final O ₂ CEMS Data (%)						CO ₂ (Actual Dry %)						SUM CO ₂ + O ₂ CEMS Data (%)					
	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6	U1	U2	U3	U4	U5	U6
2025/07/01	12.0	10.6	11.9	10.6		10.0	9.2	9.6	9.0	9.5		11.0	21.2	20.2	21.0	20.1		21.1
2025/07/02	12.0	10.5	11.7	10.4	10.8	9.9	9.3	9.4	9.1	9.8	11.1	11.2	21.3	20.0	20.8	20.2	21.8	21.2
2025/07/03	12.1		11.9	11.4	8.7	10.1	9.4		9.1	9.7	11.4	11.1	21.4		21.0	21.1	20.0	21.2
2025/07/04	12.3		11.6	11.7	8.8	9.7	9.3		9.1	9.6	11.2	11.1	21.6		20.7	21.3	19.9	20.8
2025/07/05	12.4		11.2	10.3	8.7	9.6	9.2		8.9	9.7	11.0	11.2	21.6		20.1	20.0	19.7	20.7
2025/07/06		10.5	11.7	10.2	8.9	9.7		7.0	9.0	9.9	11.0	11.4		17.4	20.6	20.1	19.9	21.1
2025/07/07	9.0	10.5	11.8	9.7	8.6	8.9	9.3	7.3	9.0	10.1	11.0	11.3	18.3	17.8	20.8	19.8	19.5	20.2
2025/07/08	11.5	10.5	12.0	10.0	8.4	8.6	9.4	8.4	9.0	10.1	10.9	11.3	20.9	18.9	21.0	20.1	19.3	19.9
2025/07/09	12.1	10.5	11.9	10.4	8.8	9.1	9.4	8.8	8.9	9.8	11.0	11.2	21.5	19.3	20.8	20.1	19.8	20.3
2025/07/10	12.4	10.5	12.3	10.6	9.3	9.7	9.4	8.8	9.0	9.6	11.1	11.2	21.7	19.3	21.2	20.2	20.4	20.8
2025/07/11	11.6	10.5	12.3	11.4	9.1	9.4	9.3	8.7	9.1	9.2	11.2	11.4	20.9	19.2	21.4	20.6	20.3	20.8
2025/07/12	10.8	10.5	12.0	11.4	9.2	9.4	9.3	7.7	9.1	9.3	11.1	11.3	20.1	18.2	21.0	20.7	20.3	20.7
2025/07/13	11.7	10.5	12.2	11.2	8.5	9.6	9.2	8.8	9.0	8.7	11.2	11.3	20.9	19.3	21.2	19.8	19.7	20.9
2025/07/14	11.4	10.5	12.3	13.3	8.8	9.3	9.2	8.7	9.1	7.9	11.1	11.3	20.6	19.2	21.4	21.2	19.9	20.7
2025/07/15	8.9	10.5	12.4	12.2	9.1	9.6	9.3	8.7	9.1	8.4	11.1	11.3	18.1	19.2	21.5	20.6	20.2	20.9
2025/07/16	8.8	10.5	12.2	11.3	7.8	9.1	9.3	8.9	9.1	8.8	11.3	11.3	18.1	19.4	21.2	20.1	19.1	20.4
2025/07/17	10.4	10.5	11.9	12.3	7.9	9.0	9.3	9.3	9.0	8.8	11.3	11.3	19.7	19.9	20.9	21.1	19.1	20.3
2025/07/18	8.9	10.6	11.8	12.1	8.3	9.5	9.3	9.5	9.1	8.9	11.2	11.3	18.2	20.0	20.9	21.0	19.5	20.8
2025/07/19	8.8	10.6	12.4	12.3	9.2	10.6	9.1	9.3	8.8	8.7	11.1	11.0	17.9	19.9	21.2	21.0	20.3	21.6
2025/07/20	12.4	10.5	12.1	12.1	8.4	9.6	9.2	9.2	8.9	8.9	11.2	11.2	21.6	19.8	21.0	21.0	19.6	20.8
2025/07/21	8.9	10.5	12.1	12.5	8.7	9.8	9.3	8.9	9.0	9.0	11.3	11.3	18.2	19.5	21.1	21.5	20.0	21.1
2025/07/22	8.8	10.5	11.7	11.7	8.9	9.7	9.2	9.3	8.9	9.6	11.1	11.2	18.0	19.8	20.7	21.3	20.0	20.9
2025/07/23	12.0	10.6	11.4	10.2	9.6	9.5	9.1	9.5	8.9	9.8	10.9	11.2	21.1	20.1	20.3	20.0	20.5	20.7
2025/07/24	12.5	10.5	12.0	10.5	7.9	9.6	9.2	9.3	9.0	9.6	11.3	11.3	21.7	19.9	21.0	20.1	19.2	20.8
2025/07/25	8.9	10.5	12.8	11.3	8.8	9.5	9.2	9.2	9.0	9.6	11.2	11.2	18.1	19.8	21.8	21.0	20.0	20.7
2025/07/26	11.8		12.3	12.4	9.7	9.5	9.2		8.9	9.3	11.1	11.3	21.0		21.2	21.7	20.8	20.7
2025/07/27	13.2		12.3	12.6	8.9	10.8	9.0		8.8	9.1	11.1	10.9	22.2		21.1	21.7	20.0	21.6
2025/07/28	8.1	10.5	12.2	11.4	8.7	9.8	8.9	8.3	8.8	9.2	11.0	11.0	17.1	18.8	20.9	20.6	19.7	20.8
2025/07/29	9.6	10.5		11.5	8.6	9.7	9.2	8.8		9.1	11.1	11.1	18.7	19.3		20.6	19.7	20.9
2025/07/30	12.5	10.5		11.6	8.6	9.7	9.0	9.0		9.1	11.1	11.2	21.5	19.5		20.7	19.7	20.9
2025/07/31	12.0	10.5		12.2	8.4	9.2	8.9	8.9		9.2	11.2	11.2	20.9	19.5		21.3	19.5	20.5

Calculation: CO₂% + O₂% = 19.5-21.5%

*Blank spaces indicate that the unit was offline during that period

Emergency Generation

Table 11: Emergency Generation for the month of July 2025

	Unit 1	Unit 2	Unit 3	Unit 4	Unit 5	Unit 6
Emergency Generation hours declared by national Control	0	0	0	0	0	0
Emergency Hours declared including hours after stand down	0	0	0	0	0	0
Hours over the Limit during Emergency Generation	0	0	0	0	0	0

Comments on the performance and availability of each unit

UNIT 1

The unit base loaded for most of the days during the month and off for one day. Sixty-seven fabric filter bags were replaced during the month.

UNIT 2

The unit base loaded for most of the days during the month and off for five days. Fifty-three fabric filter bags were replaced during the month

UNIT 3

The unit base loaded for most of the days during the month and off for three days. Seventeen and twelve and five fabric filter bags were replaced during the month.

UNIT 4

The unit base loaded for all the days during the month. Sixty-four fabric filter bags were replaced during the month.

UNIT 5

The unit base loaded for most of the days during the month and off for one day. Thirty-eight fabric filter bags were replaced during the month.

UNIT 6

The unit base loaded for all the days during the month. Sixty-nine fabric filter bags were replaced during the month.

Complaints Register

Table 12: Complaints for the month of July 2025


Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident	Dispersion modelling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
	No complaints were received in July 2025.				

General

Unit 2 O₂ monitor remains faulty, the Station is still in the process of sourcing spares. The exceedances on NO_x and SO₂ are detailed in Table 7 and 8 of the report. The Station has concluded the investigation, and the report is attached to this month's submission.

Yours sincerely

Report compiled by:



Faith Kagoda
ENVIRONMENTAL MANAGER: (MAJUBA)

Date 14/08/2025

Report verified by:



Lindani Madonsela
BOILER ENGINEERING MANAGER: (MAJUBA)

Date 14/08/2025

Report approved by:



Johan Swanepoel
ENGINEERING MANAGER: (MAJUBA)

14/08/2025
Date