

Nkangala District Municipality
2A Walter Sisulu
Middelburg
1050

Date:
2026. 02.10

Inquiries:
Mariam Joseph
Tel +27 13 297 9828
Fax + 27 86 661 7663

Dear Mrs Simelane

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2026

This serves as the monthly report required in terms of Section 6 in Arnot Power Station's Atmospheric Emission License. The emissions are for January 2026, verified emissions of particulates; SO₂ and NO_x (as NO₂) are also included.

Raw Materials and Products

Table1: Quantity of Raw Materials and Products used/produced for the Month of January 2026

Raw Materials and Products used	Raw Material Type	Unit	Maximum Permitted Consumption/ Rate (Quantity)	Consumption/ Rate in Month of January 2026
	Coal	Tons/month	1 050 330	277 944.50
	Fuel Oil	Tons/month	10 000	1359.94
Production Rates	Product/ By-Product Name	Unit	Maximum Production Capacity Permitted (Quantity)	Production Rate in Month of January 2026
	Energy	GWh	1 785 600	526.001
	Ash	Tons/month	421 000	64 260.583

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2026

Abatement Technology

Table 2.1 (a) Abatement Equipment Efficiency Control Technology for month of January 2026

Associated Unit/Stack	Technology Type	Actual Efficiency (%) for the month of January 2026
North Stack	Fabric Filter Bags	99.905%
South Stack	Fabric Filter Bags	99.934%

Table 2.1 (b) Abatement Equipment Utilisation (%) for the month of January 2026

Associated Unit/Stack	Technology Type	Utilisation January 2026
North	<i>Fabric Filter Plant (FFP)</i>	100 %
South	<i>Fabric Filter Plant (FFP)</i>	100 %

Table 2.1 (c) Monitor Reliability (%)

Associated Unit/Stack	PM	SO ₂	NO
Stack 1	100	39.9	99.5
Stack 2	100	39.9	43.4

Energy Source Characteristics

Table 3: Energy Source Material Characteristics for the month of January 2026

Characteristic	Stipulated Range (Unit)	Monthly Average Content
Sulphur Content	0.5 to < 1 (%)	0.680
Ash Content	17 to < 40 (%)	23.12
Calorific Value (Dry base)	≥ 22.76 (MJ/kg)	21.74

Table 4 Operating days in compliance to PM AEL Limit – January 2026.3

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average PM (mg/Nm ³)
North	31	0	0	0	0	15.8
South	31	0	0	0	0	12.8
	62	0	0	0	0	

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2026

Table 5: Operating days in compliance to NOx AEL Limit –January 2026

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average NOx (mg/Nm ³)
North	31	0	0	0	0	550.2
South	31	0	0	0	0	542.9
SUM	62	0	0	0	0	

Table 6: Operating days in compliance to SOx AEL Limit – January 2026

Associated Unit/Stack	Normal	Grace	Section 30	Contravention	Total Exceedance	Average SOx (mg/Nm ³)
North	31	0	0	0	0	1206.8
South	31	0	0	0	0	1210.2
SUM	62	0	0	0	0	

Emissions Reporting

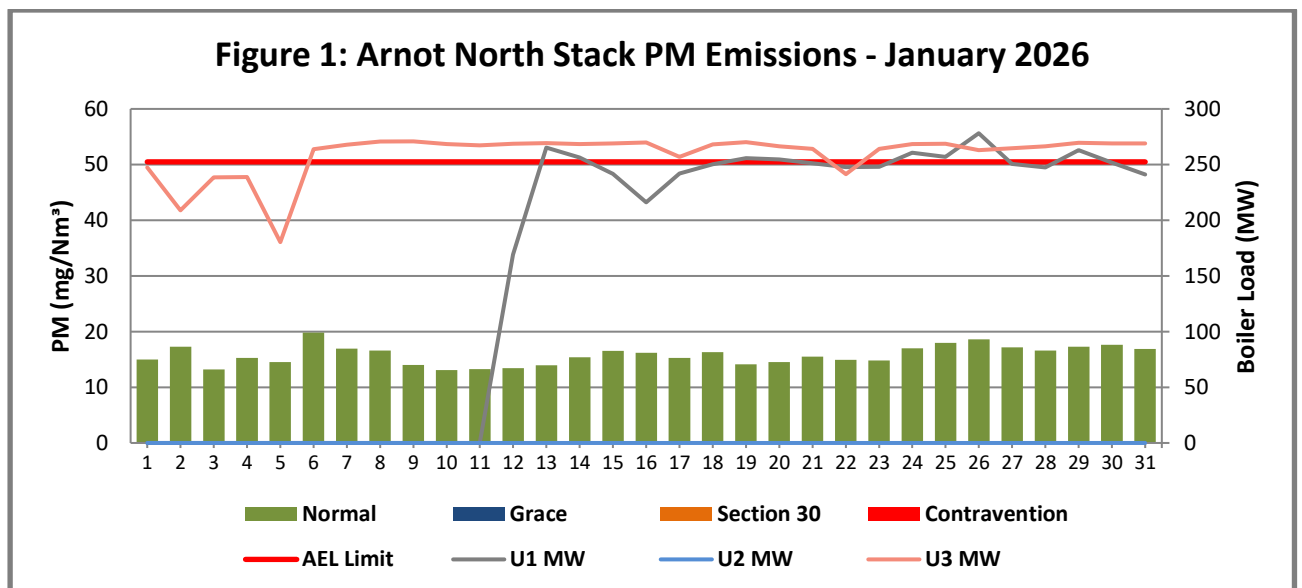


Figure 1: PM emissions (daily averages) for the month of January 2026 against the emission limit for the North Stack

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2026

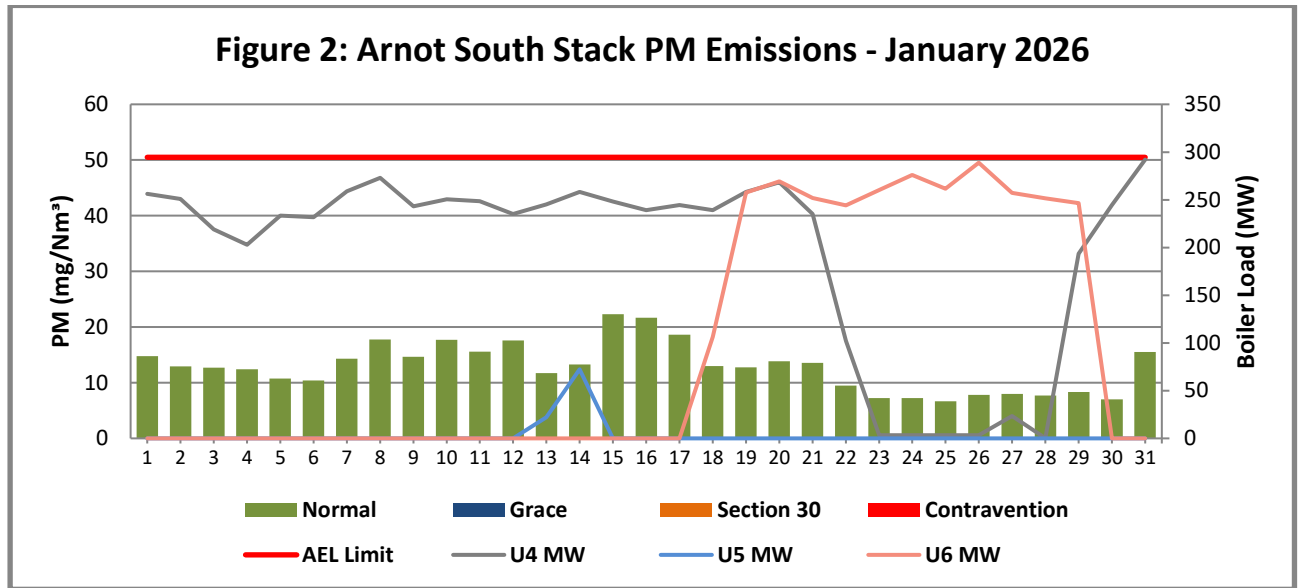


Figure 2: PM emissions (daily averages) for the month of January 2026 against emission limit for the South Stack

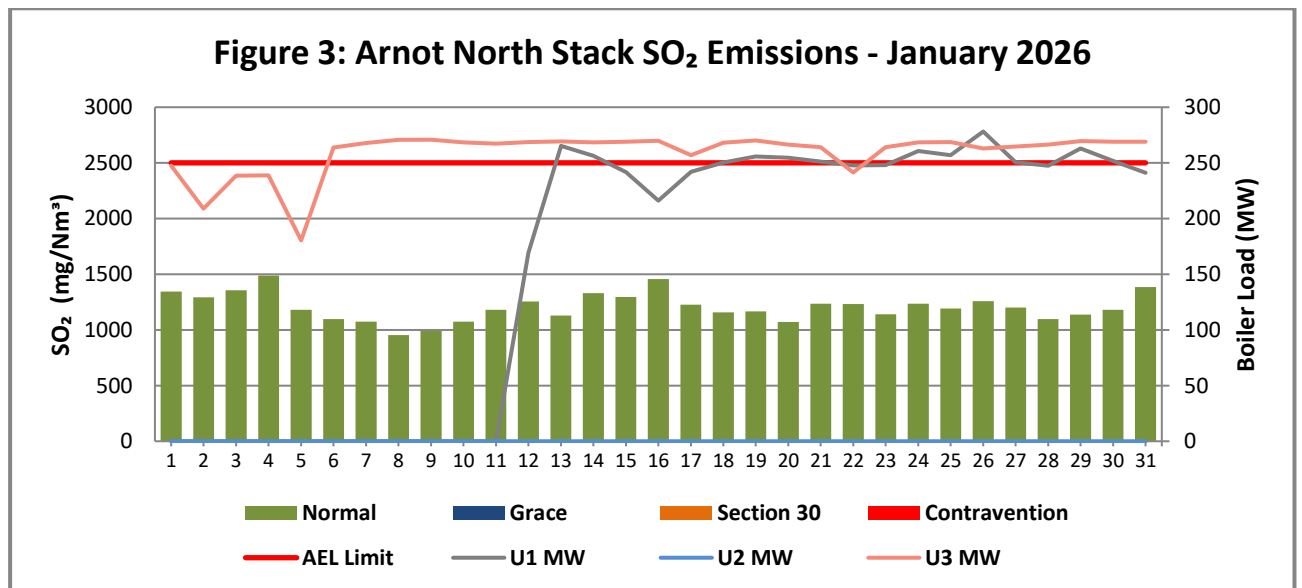


Figure 3: SO₂ emissions (daily averages) for the month of January 2026 against emission limit for the North Stack

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2026

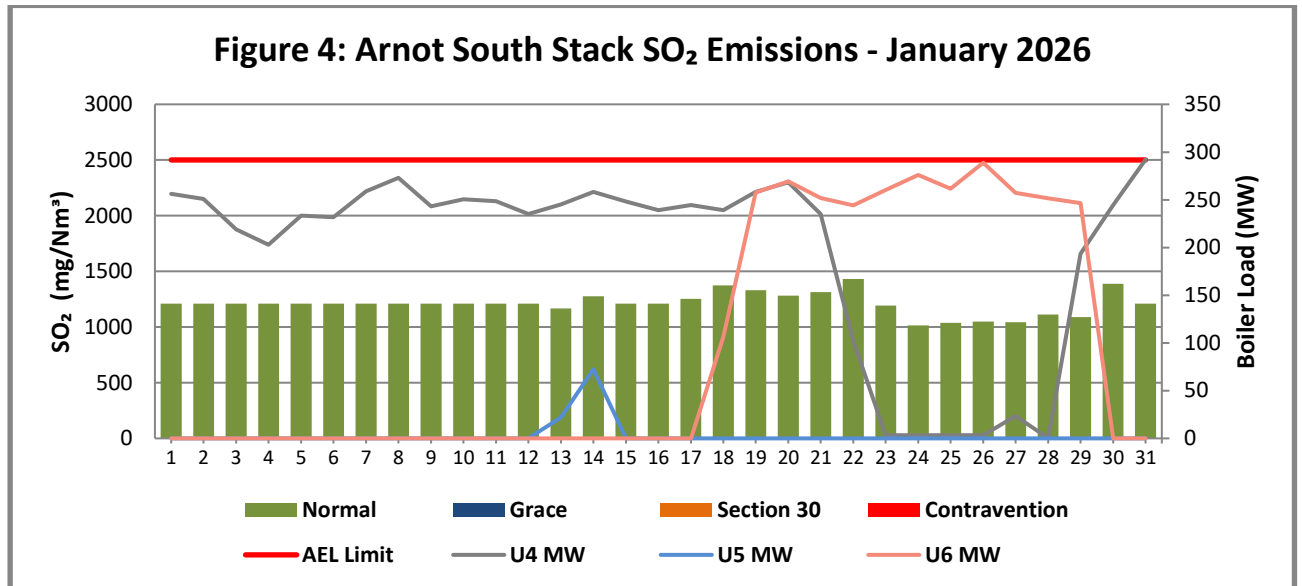


Figure 4: SO₂ emissions (daily averages) for the month of January 2026 against emission limit for the South Stack

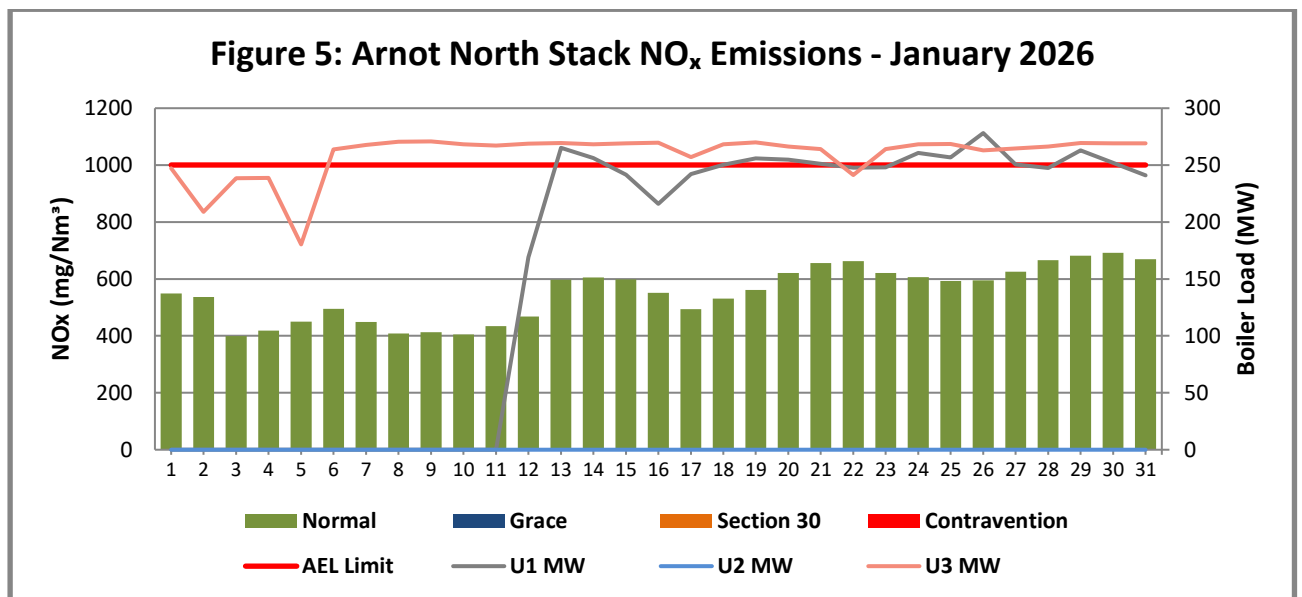


Figure 5: NO₂ emissions (daily averages) for the month of January 2026 against emission limit for the North Stack

ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF JANUARY 2026

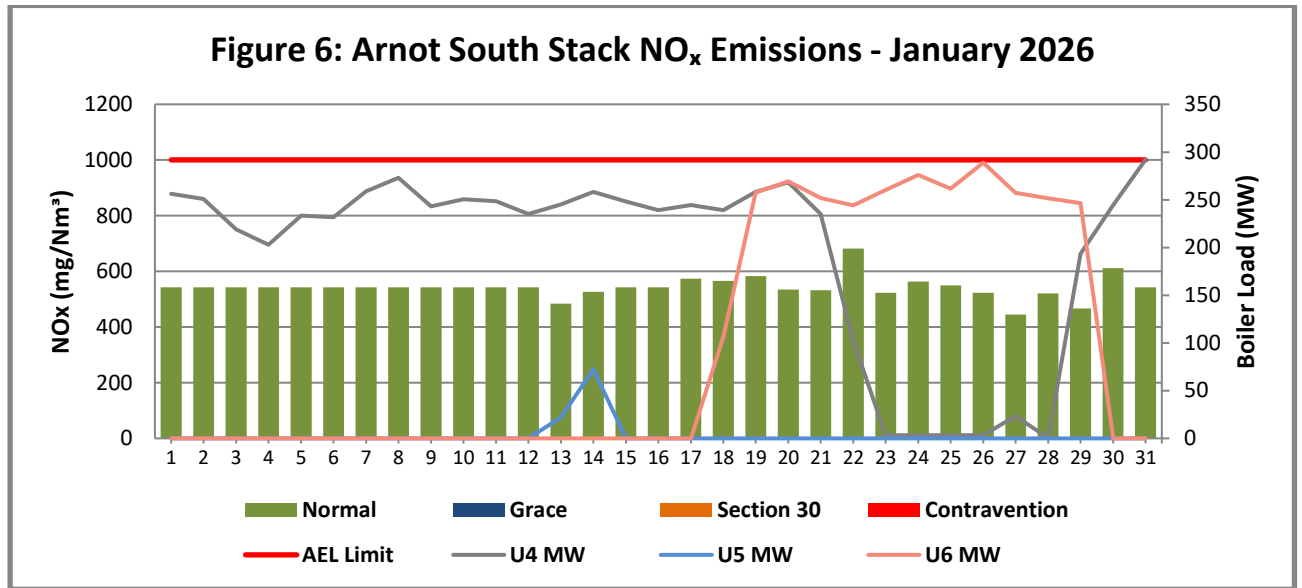


Figure 6: NO₂ emissions (daily averages) for the month of January 2026 against emission limit for the South Stack

Table 7: Monthly tonnages for the month of January 2026

Unit	PM (tons)	SO ₂ (tons)	NO ₂ (tons)
Total Tons (North & South Stack)	47.88	4189	1945

Light up information

Continuous reporting is being done even during start-ups, emissions were not affected.

Complaints Register

Table 8. Complaints for the month of January 2026

No Noise, dust and offensive odors complaints registered in the month of January 2026.

Source Code/ Name	Root Cause Analysis	Calculation of Impacts/ emissions associated with the incident and dispersion modelling of pollutants, where applicable	Dispersion modeling of pollutants where applicable	Measures implemented to prevent reoccurrence	Date by which measure will be implemented
None	0	0	0	0	0

**ARNOT POWER STATION'S MONTHLY EMISSIONS REPORT FOR THE MONTH OF
JANUARY 2026**

Comments

General

The rest of the information demonstrating compliance with the emission license conditions is supplied in the annual emission reports sent to your office.

South stack gas monitors unable to read the extremely low values for 1-13, 15-16, 30 and 31 January due to only Unit 4 in operation on South Stack. The flow velocity through the stack is too low to register a reading for the ERT as reliable data.

Hoping the above will meet your satisfaction.

Compiled by

Date:




26.02.2026

Lawrence Machebe

ENVIRONMENTAL OFFICER: ARNOT POWER STATION

Verified by

Date:



20-02-2026

Jan-Louis Human

SYSTEM ENGINEER: ARNOT POWER STATION

Supported by:

Date: 2026.02.26



Rofhiwa Tshikovha

SENIOR ENVIRONMENTAL ADVISOR: ARNOT POWER STATION

Yours sincerely



Marcus Nemadodzi

Date: 2026-02-27

GENERAL MANAGER: ARNOT POWER STATION