


Koeberg Composite Projects

Nuclear 1	EIR submitted to DEA for authorisation.
Insulator Pollution Test Station (KIPTS)	Basic Assessment in progress
Weskusfleur Substation	EA authorisation dated 8 September 2016, DEA Ref: 14/12/16/3/3/2/508
KBG Ankerlig 132kV	Basic Assessment in 2016
TISF (dry nuclear used fuel storage)	EA authorised 2 February 2017 for approval. DEA Ref: 14/12/16/3/3/2/947
Hardened Water Reservoir	Draft Basic Assessment Report PPP completed.
Car Park extension	Basic Assessment Report submitted to DEA for authorisation. (DEA Ref: 14/12/16/3/3/1/1687
Diesel Storage Facility	Basic Assessment Report PPP completed.
Koeberg Training Centre	Amended EA approval dated 26 Feb 2015, Ref: 12/12/20/997

Refer to the Composite Map included hereafter.

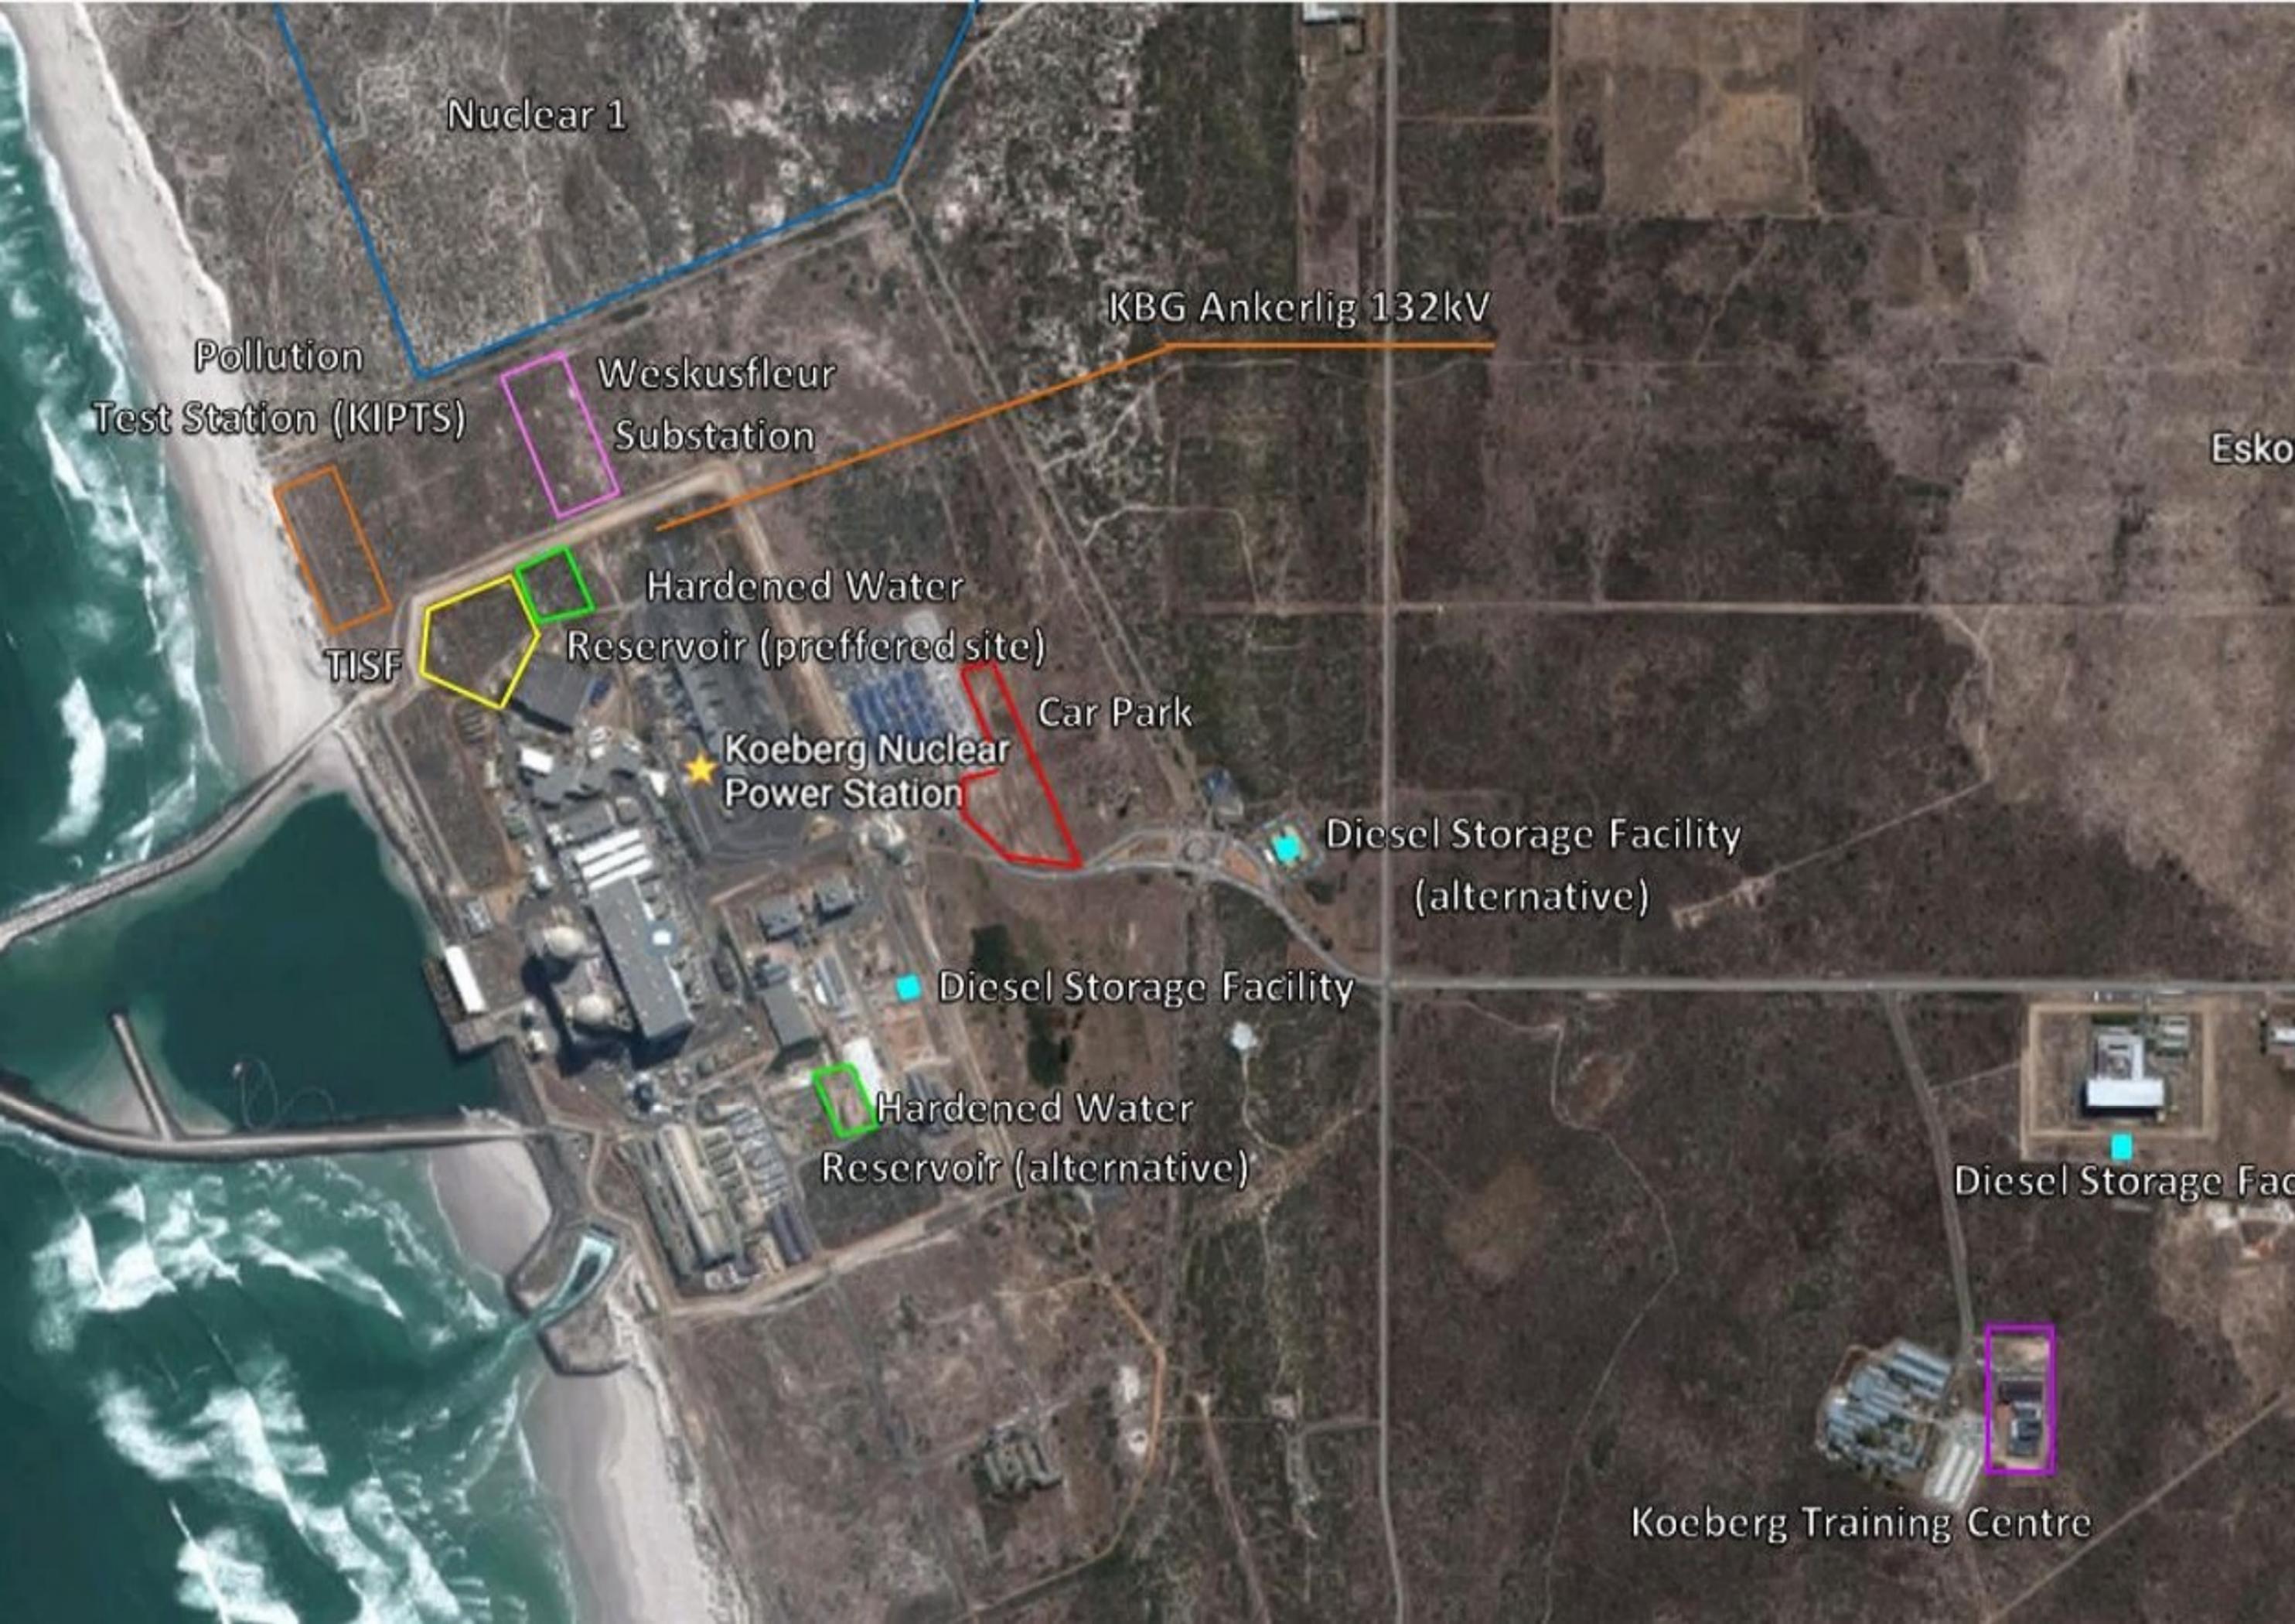

Nuclear 1

KBG Ankerlig 132kV

Pollution
Test Station (KIPTS)

Weskusfleur
Substation

Esko

TISF

Hardened Water
Reservoir (preffered site)

Car Park

Koeberg Nuclear
Power Station

Diesel Storage Facility
(alternative)

Diesel Storage Facility

Hardened Water
Reservoir (alternative)

Diesel Storage Fac

Koeberg Training Centre