

Figure 1: Layout of Upgraded DHP with Chain Conveyors and Bucket Elevator Technology for Two Units

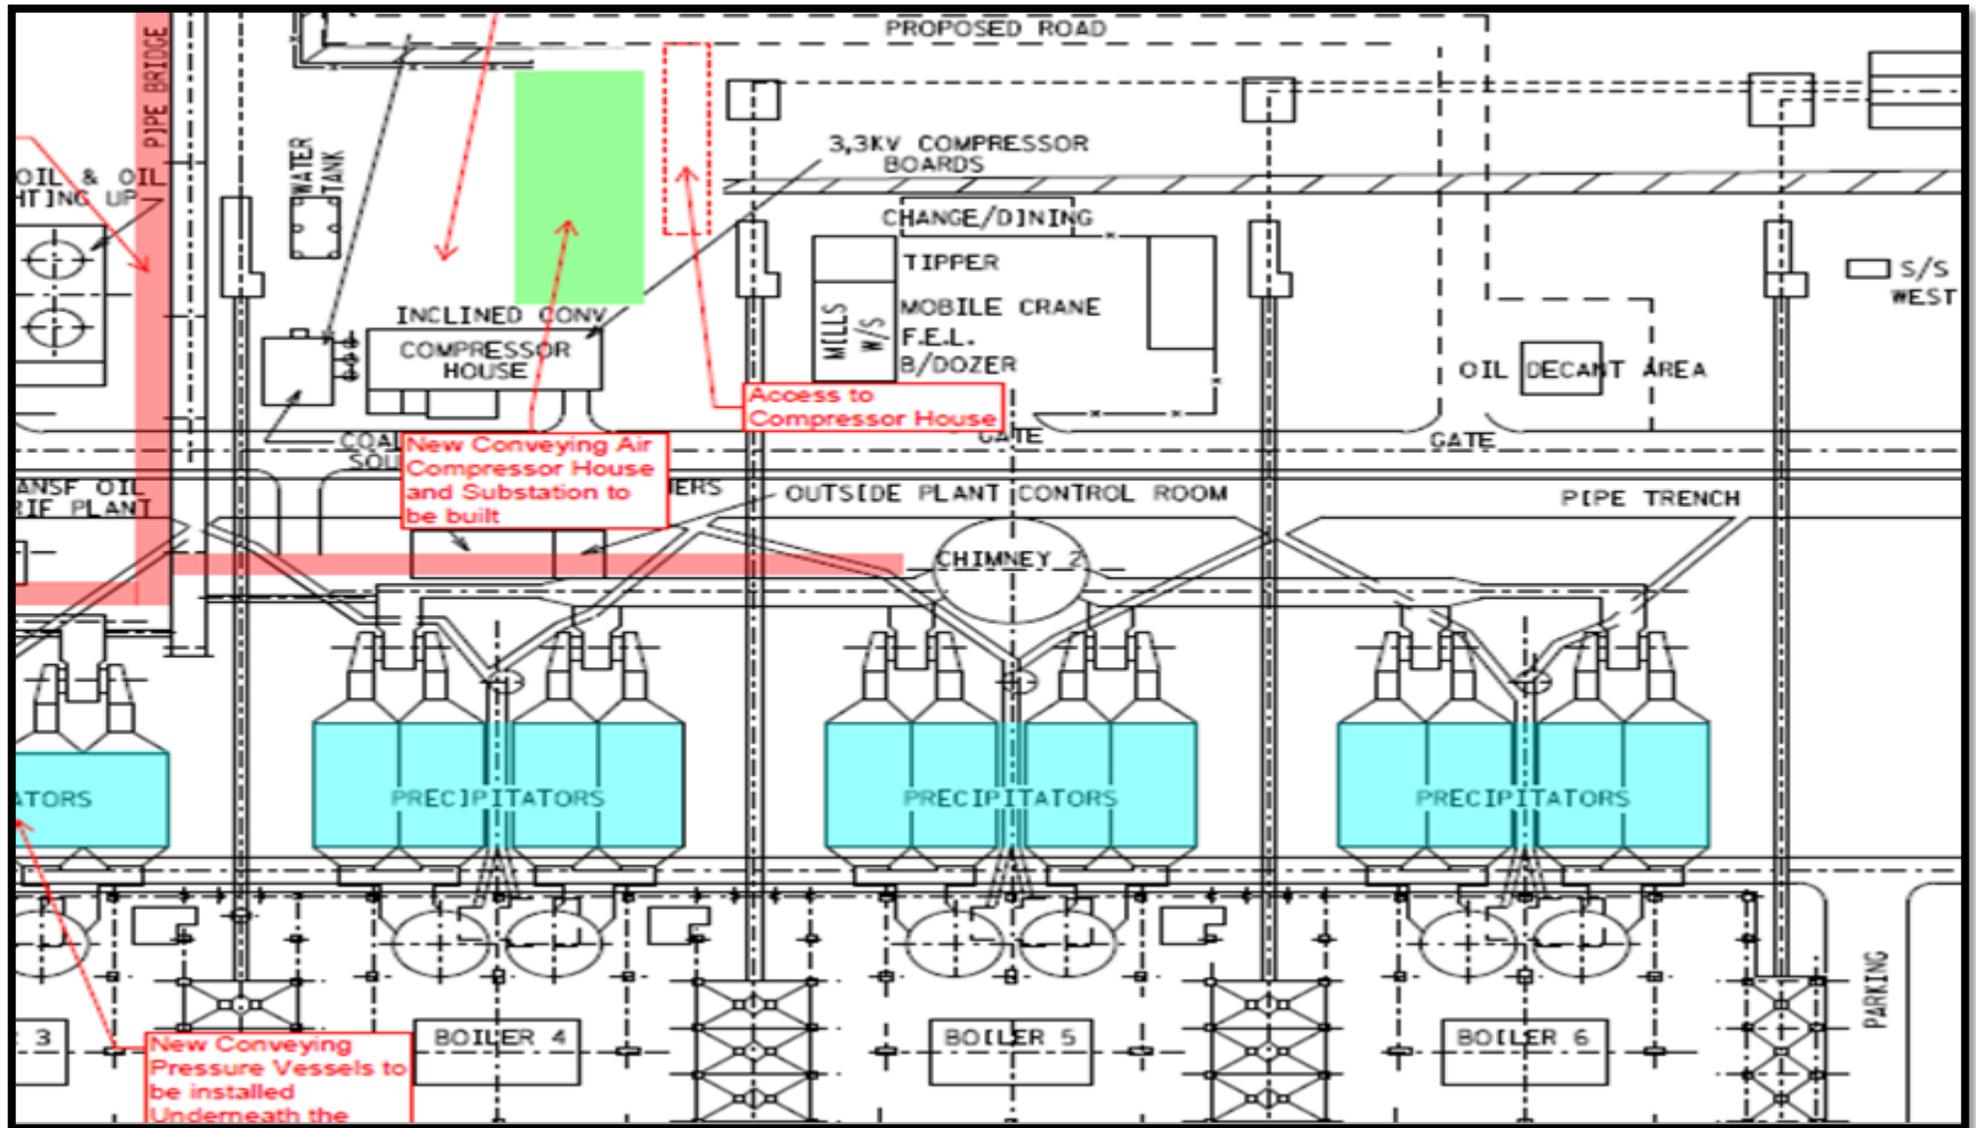


Figure 2: Position of the Compressor House for the Pneumatic DHP

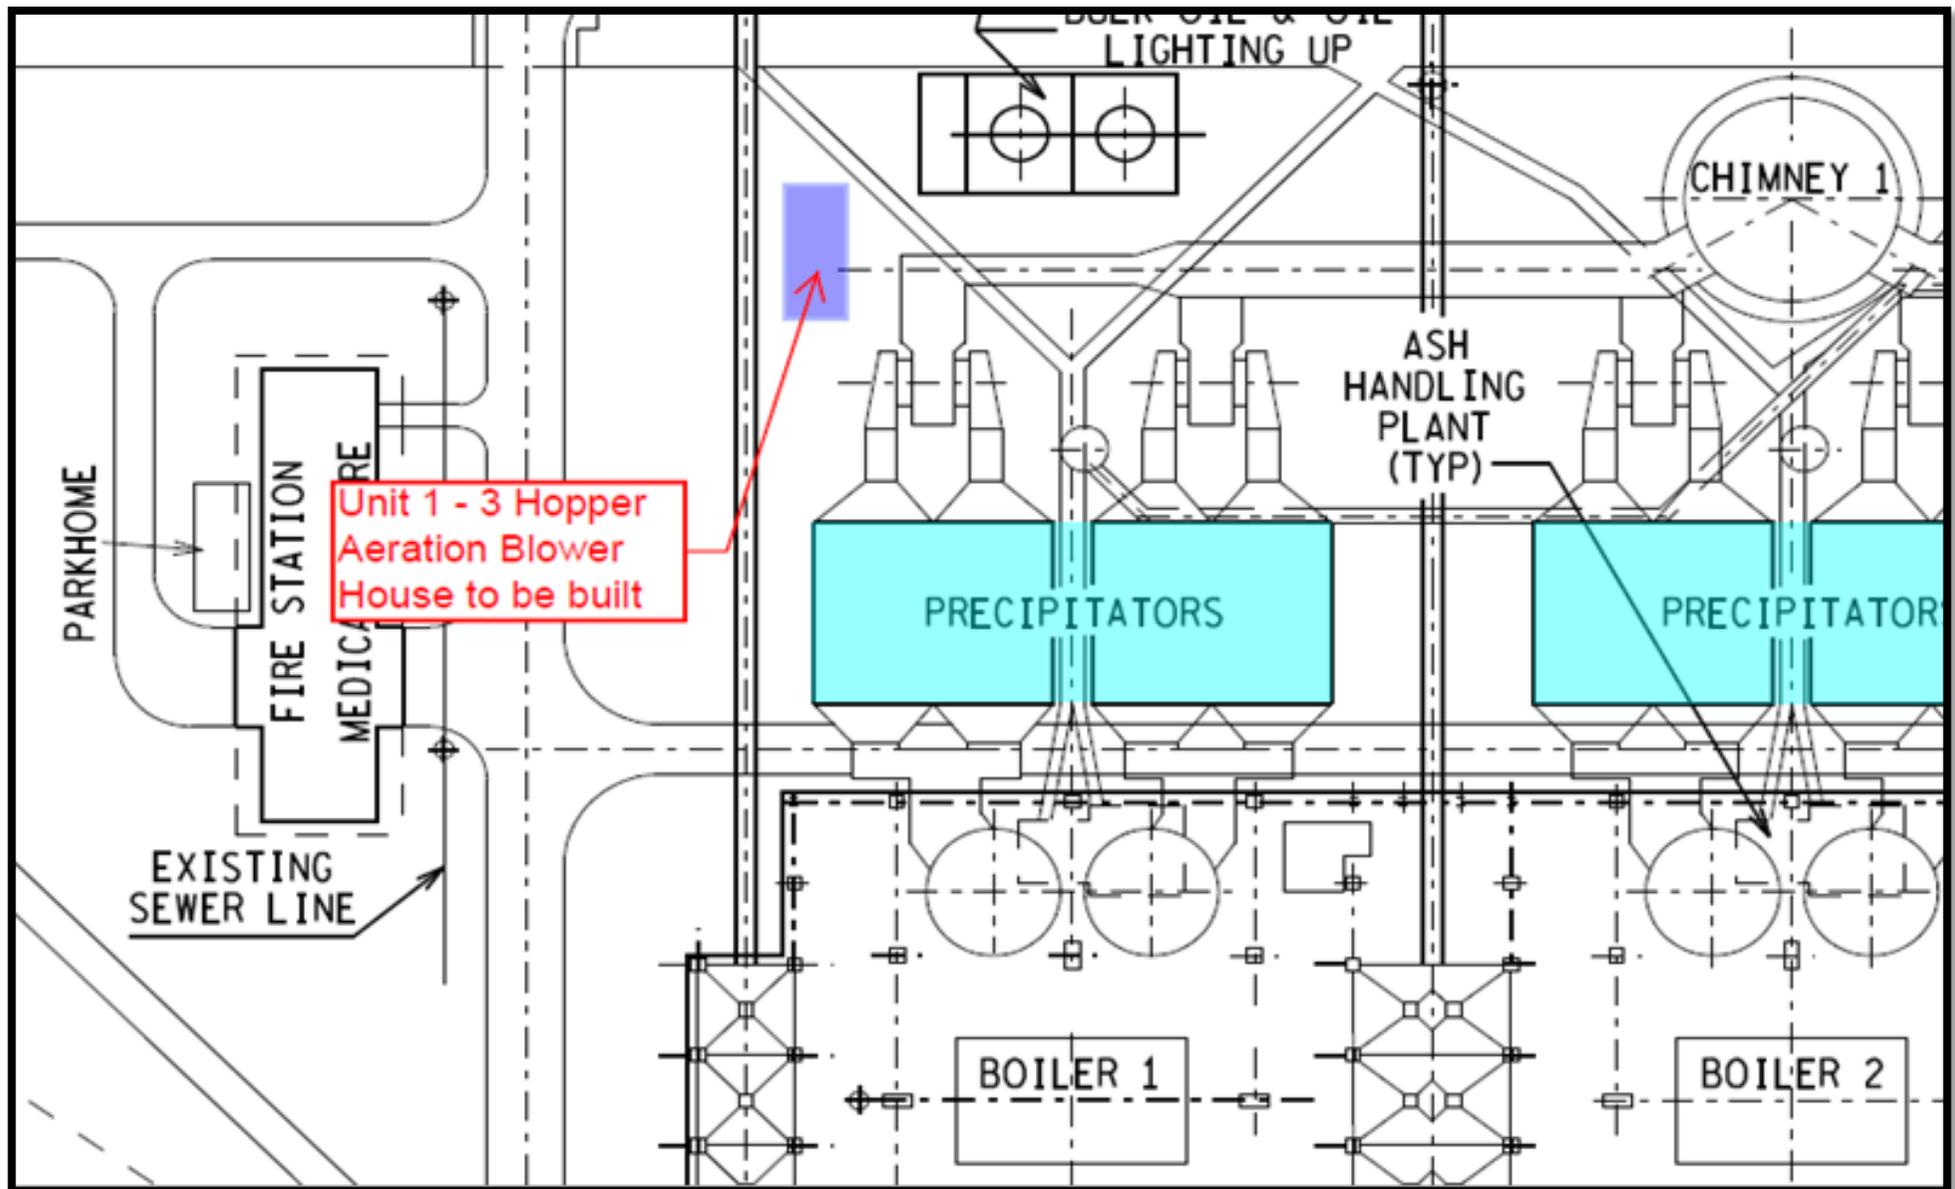


Figure 3: Position of the Blower House for the Aeration System

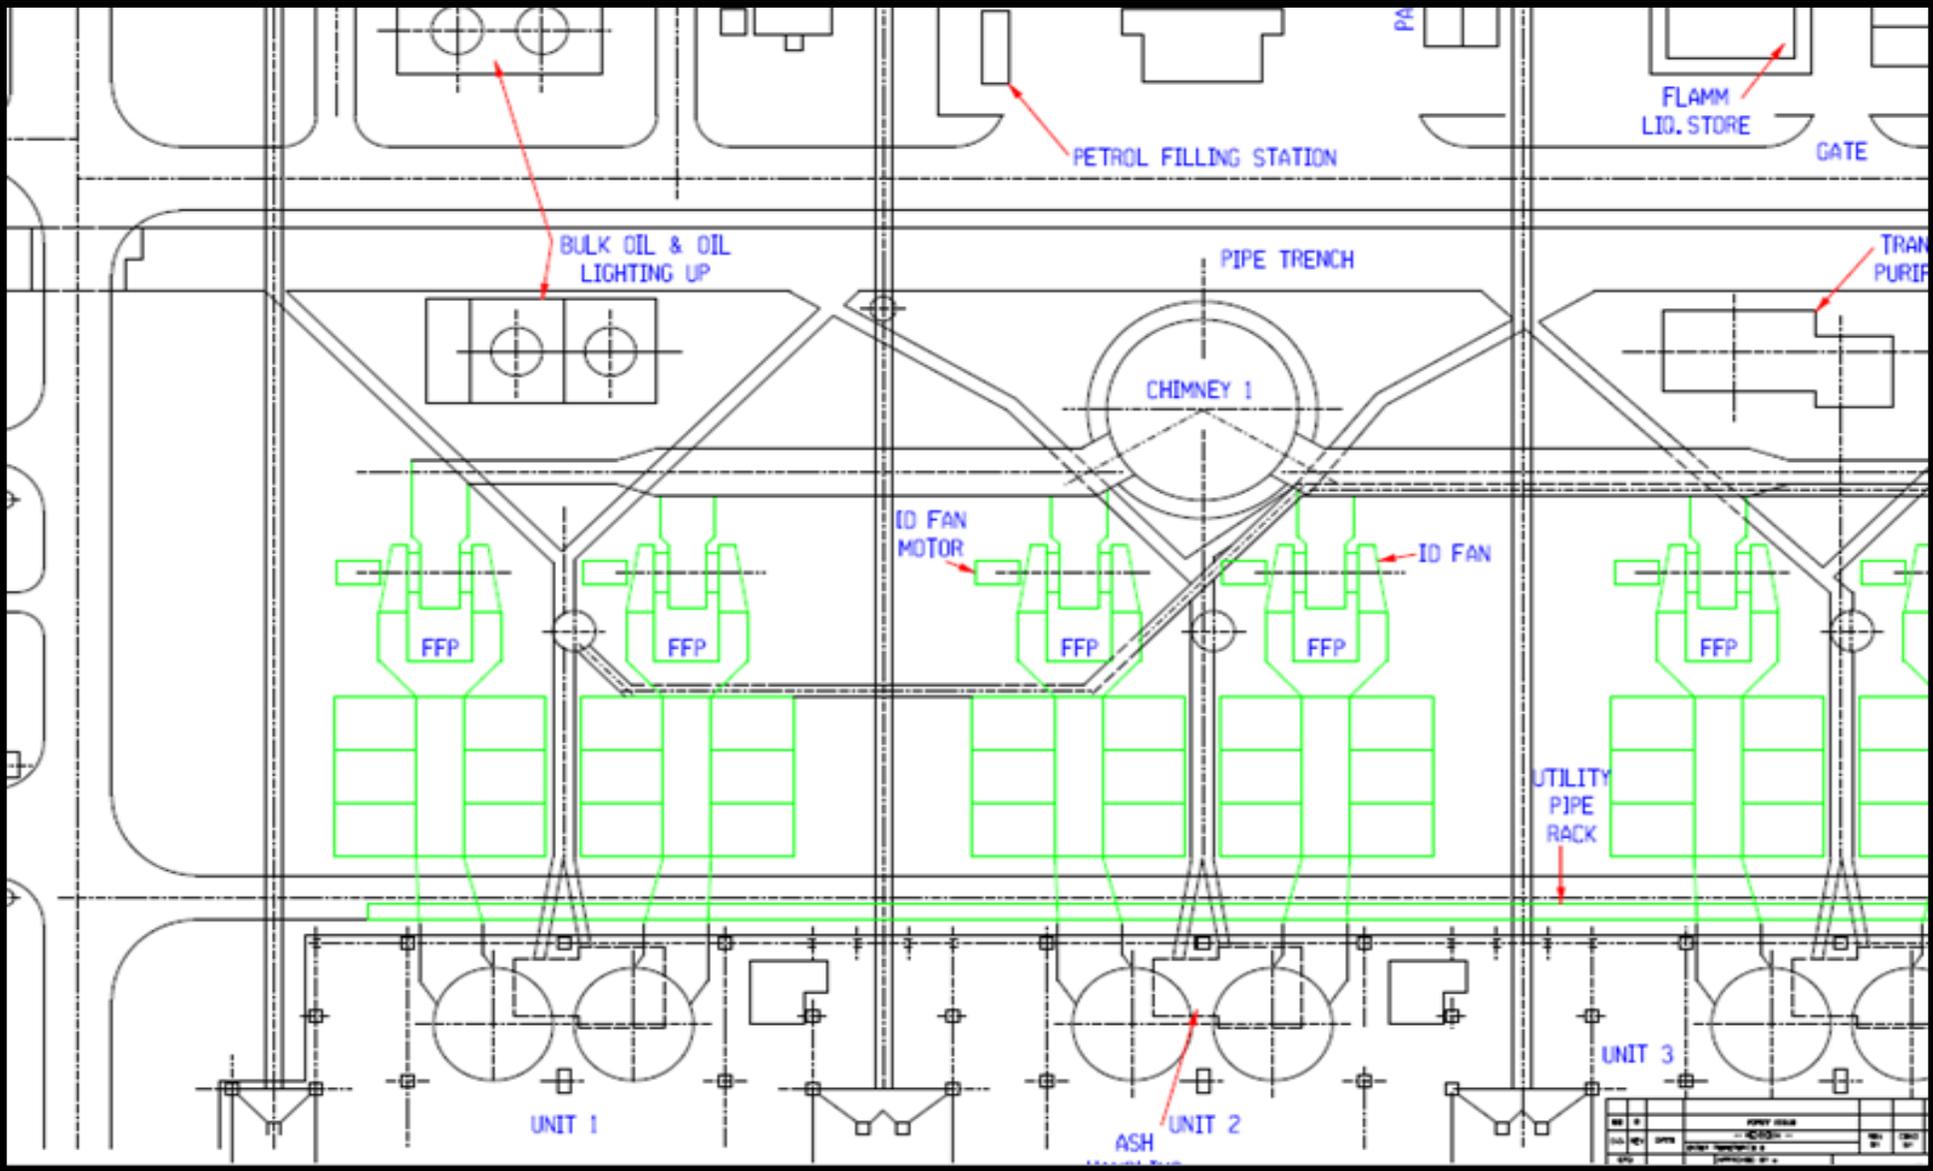


Figure 4: FFP Arrangements (Units 1 to 3)



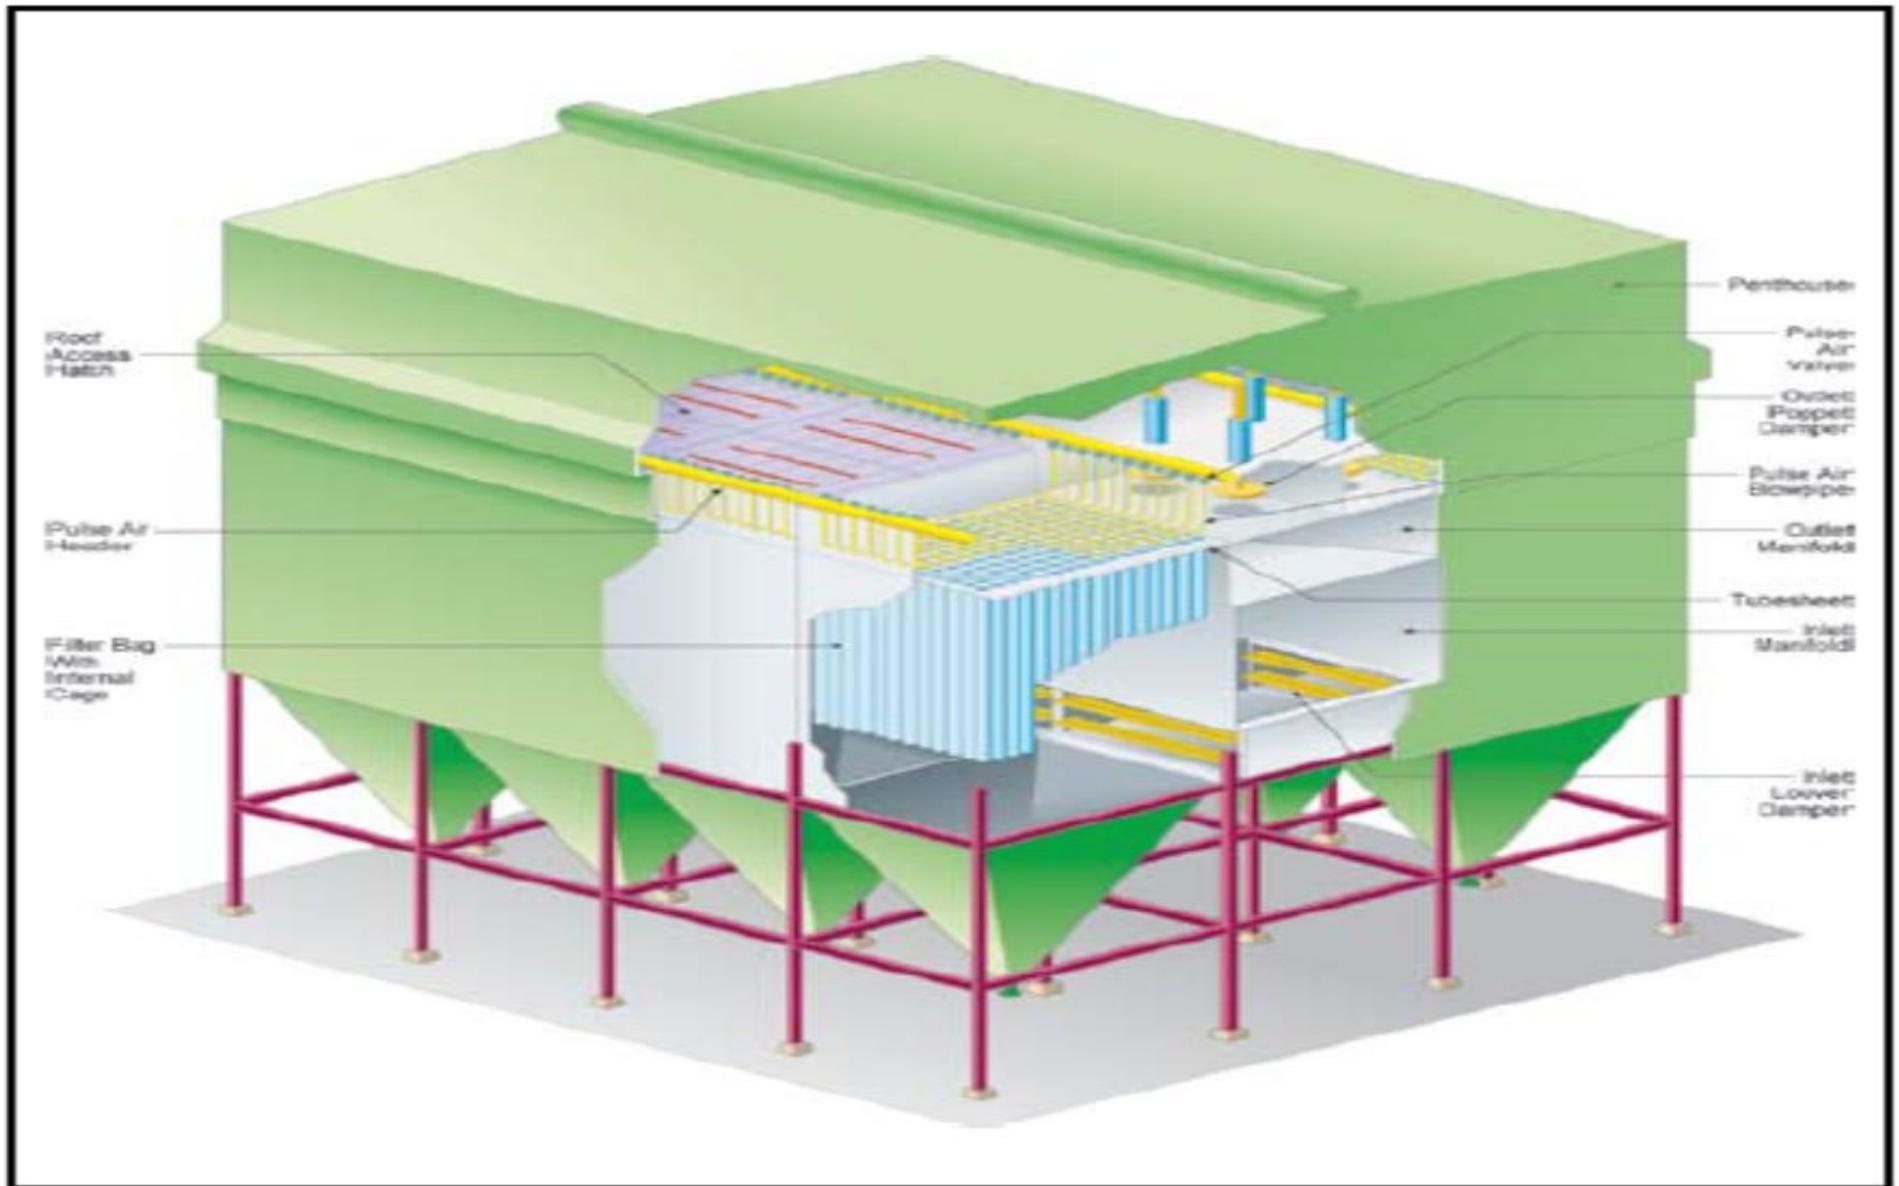


Figure 6: FFP Illustration

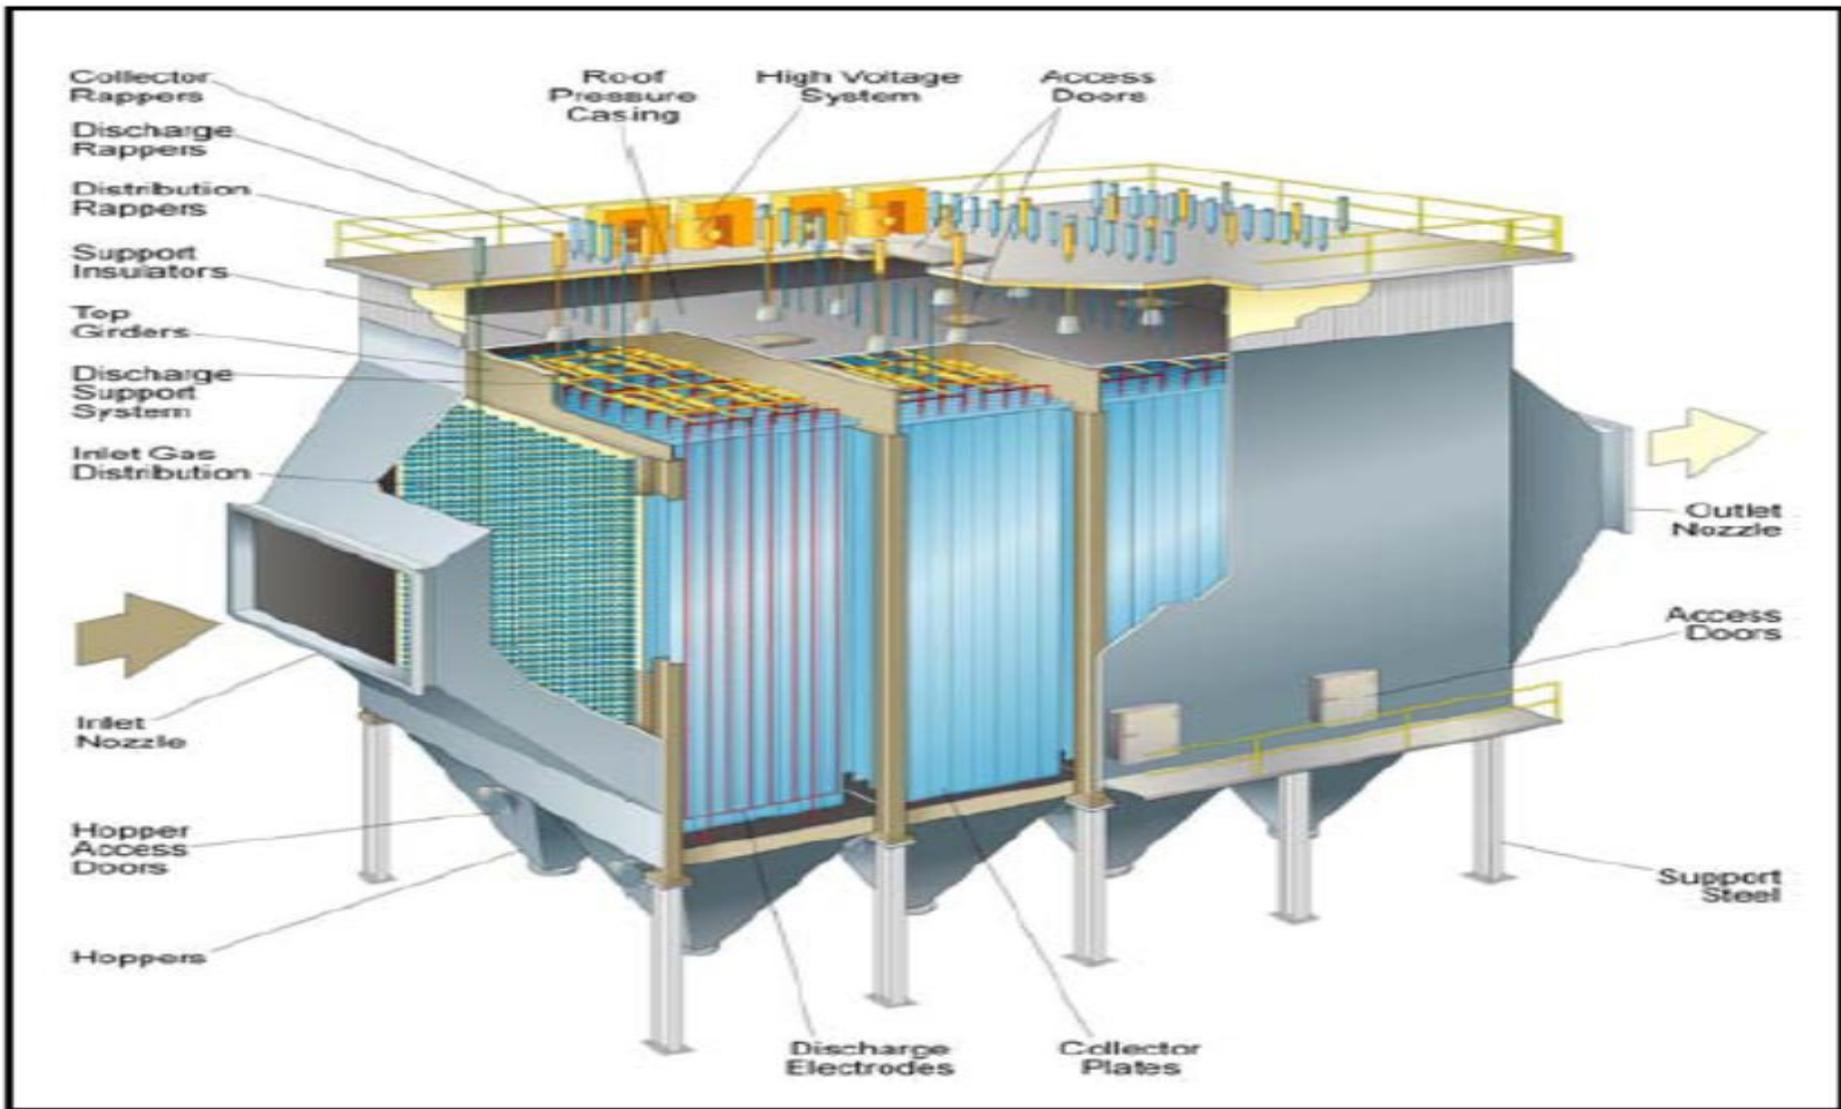


Figure 7: ESP Illustration