

Weekly System Status Report – 2023 Week 36 (04/09/2023 – 10/09/2023)

Introduction

This document is intended to provide a general picture of the Adequacy of the National Electricity Supply System in the medium term. The Report will be updated weekly, on Tuesdays and circulated Wednesdays, thereafter, published on the Eskom website, updated on Wednesdays. The values contained in this report are unverified and not official yet and can change at any time.

Disclaimer

The Data published here is for information purposes only. The content is subject to verification and validation. Eskom shall not be held responsible for any errors or it being misleading or incomplete and accepts no liability whatsoever for any loss, damages, or expenses, howsoever, incurred or suffered, resulting, or arising, from the use of this Data or any reliance placed on it.

Historic Daily Peak System Capacity/Demand

Date	Available Dispatchable Generation (MW)	Non-commercial Generation (MW)	Residual Load Forecast (MW)	Actual Residual Demand (MW) Incl IOS	Operating Reserve Margin (Excl Non-Commercial Units)	Operating Reserve Margin (Incl Non-Commercial Units)	Forecast vs. Actual (Residual Demand)
Mon 04/Sep/2023	26,824	0	28,603	29,000	-7.5%	-7.5%	-1.4%
Tue 05/Sep/2023	25,524	0	28,303	29,153	-12.4%	-12.4%	-2.9%
Wed 06/Sep/2023	26,284	0	29,785	30,271	-13.2%	-13.2%	-1.6%
Thu 07/Sep/2023	28,086	0	29,930	30,319	-7.4%	-7.4%	-1.3%
Fri 08/Sep/2023	27,072	0	28,536	28,930	-6.4%	-6.4%	-1.4%
Sat 09/Sep/2023	27,104	0	25,649	25,585	5.9%	5.9%	0.3%
Sun 10/Sep/2023	25,370	0	25,885	26,215	-3.2%	-3.2%	-1.3%


Date	Total Available Generation Incl Renewables (MW)	Non-commercial Generation (MW)	RSA Contracted Load Forecast (MW)	Actual RSA Contracted Demand (MW) Incl IOS	Operating Reserve Margin (Excl Non-Commercial Units)	Operating Reserve Margin (Incl Non-Commercial Units)	Forecast vs. Actual (RSA Contracted Demand)
Mon 04/Sep/2023	28,533	0	30,425	30,708	-7.1%	-7.1%	-0.9%
Tue 05/Sep/2023	27,240	0	30,615	30,869	-11.8%	-11.8%	-0.8%
Wed 06/Sep/2023	27,759	0	31,438	31,746	-12.6%	-12.6%	-1.0%
Thu 07/Sep/2023	29,313	0	31,134	31,546	-7.1%	-7.1%	-1.3%
Fri 08/Sep/2023	27,980	0	29,831	29,839	-6.2%	-6.2%	0.0%
Sat 09/Sep/2023	29,918	0	28,354	28,399	5.3%	5.3%	-0.2%
Sun 10/Sep/2023	27,822	0	28,710	28,666	-2.9%	-2.9%	0.2%

Notes:

- Available Dispatchable Generation means **all generation resources** that can be dispatched by Eskom and includes capacity available from all emergency generation resources.
- RSA Contracted Load Forecast is the total official day-ahead hourly forecast. Residual Load Forecast excludes the expected generation from renewables.
- Actual Residual Demand is the aggregated metered hourly sent-out generation and imports from dispatchable resources and includes demand reductions. The Actual RSA Contracted Demand includes renewable generation.
- Net Maximum Dispatchable Capacity (including imports and emergency generation resources) = 49 191 MW.
- These figures do not include any demand side products.
- The peak hours for the residual demand can differ from that of the RSA contracted demand, depending on renewable generation.

Week-on-Week Dispatchable Generation Energy Sent Out

[2023 weeks compared to similar 2022 weeks]

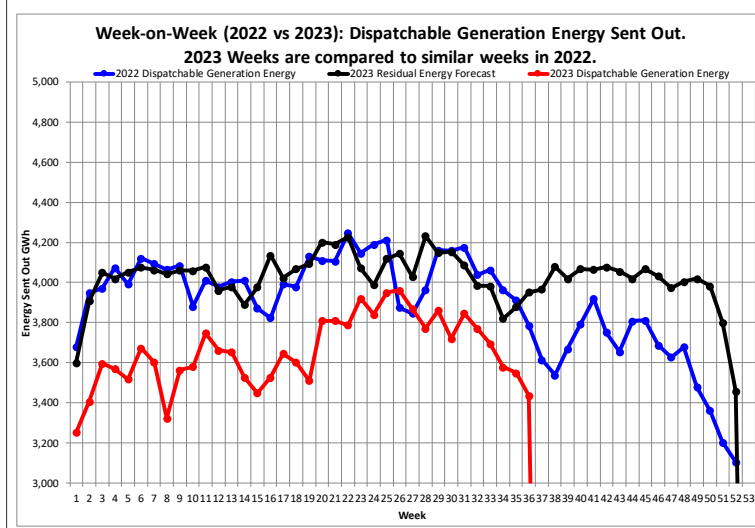


Week 36 : Dispatchable Generation Energy Sent Out Statistics		
Energy Sent Out	3,435	GWh
Week-on-Week Growth	-9.28	%
Year-on-Year Growth (Year-to-Date) Annual	-9.05	%

Note:
2023 Weeks are compared to similar weeks in 2022.
(2023 week 1 ~ 2022 week 1)

Annual Dispatchable Generation Energy Sent Out Statistics			
Year	01 Jan to 10 Sep Energy	Annual Energy (01 Jan to 31 Dec)	Unit
2018	156,697	224,202	GWh
2019	153,616	219,575	GWh
2020	143,408	206,725	GWh
2021	148,184	210,022	GWh
2022	145,121	202,847	GWh
2023 (YTD)	131,996		GWh

Week-on-Week Residual Energy Demand

[2023 weeks compared to similar 2022 weeks]

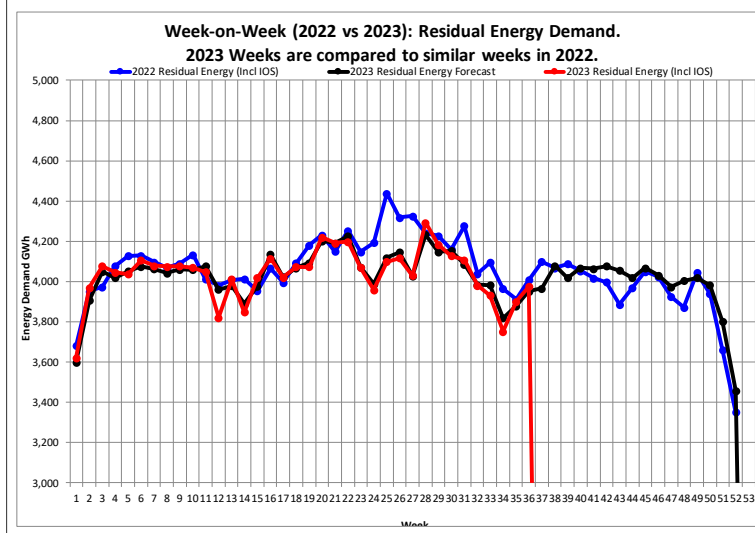


Week 36 : Residual Energy Demand Statistics		
Energy Demand	3,975	GWh
Week-on-Week Growth	-0.80	%
Year-on-Year Growth (Year-to-Date) Annual	-1.55	%

Note:
2023 Weeks are compared to similar weeks in 2022.
(2023 week 1 ~ 2022 week 1)

Annual Residual Energy Demand Statistics			
Year	01 Jan to 10 Sep Energy	Annual Energy (01 Jan to 31 Dec)	Unit
2018	156,825	224,594	GWh
2019	154,340	220,937	GWh
2020	144,753	208,151	GWh
2021	149,281	211,958	GWh
2022	148,026	211,134	GWh
2023 (YTD)	145,802		GWh

Week-on-Week RSA Contracted Energy Demand

[2023 weeks compared to similar 2022 weeks]

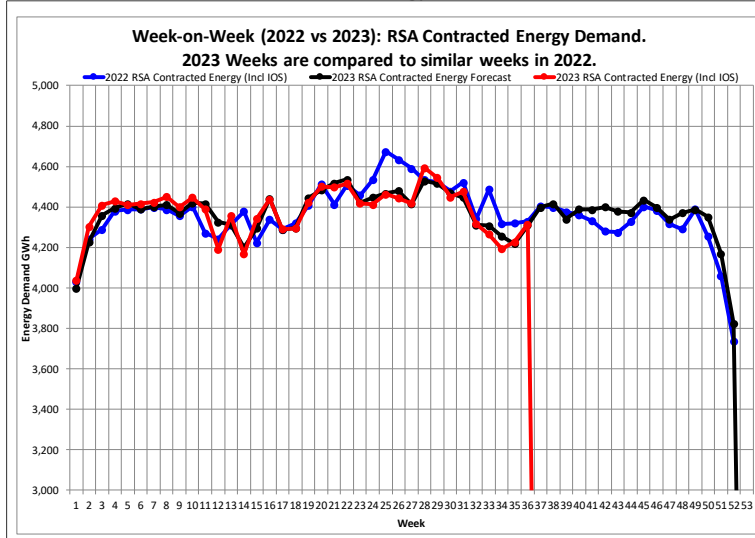


Week 36 : RSA Contracted Energy Demand Statistics		
Energy Demand	4,315	GWh
Week-on-Week Growth	-0.31	%
Year-on-Year Growth (Year-to-Date) Annual	-0.34	%

Note:
2023 Weeks are compared to similar weeks in 2022.
(2023 week 1 ~ 2022 week 1)

Annual RSA Contracted Energy Demand Statistics			
Year	01 Jan to 10 Sep Energy	Annual Energy (01 Jan to 31 Dec)	Unit
2018	163,969	235,482	GWh
2019	162,026	232,524	GWh
2020	152,651	220,630	GWh
2021	159,049	227,166	GWh
2022	158,677	227,337	GWh
2023 (YTD)	158,196		GWh

Week-on-Week Dispatchable Generation Peak Demand

[2023 weeks compared to similar 2022 weeks]

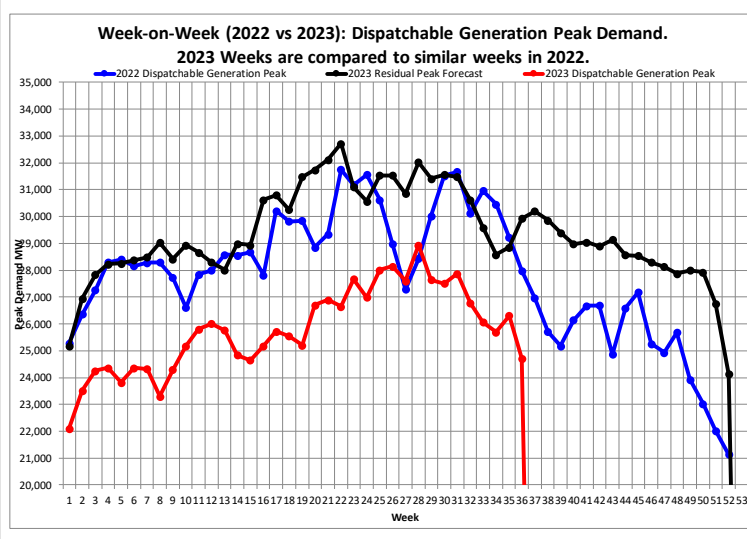

Week 36 : Dispatchable Generation Peak Demand Statistics		
Peak Demand	24,722	MW
Week-on-Week Growth	-11.65	%
Year-on-Year Growth (Year-to-Date) Annual	-8.88	%

Note:


2023 Weeks are compared to similar weeks in 2022.

(2023 week 1 ~ 2022 week 1)

Annual Dispatchable Generation Peak Demand Statistics			
Year	Peak Date	Annual Peak	Unit
2018	Mon 16-Jul-2018	34,256	MW
2019	Thu 30-May-2019	33,066	MW
2020	Wed 17-Jun-2020	32,384	MW
2021	Thu 15-Jul-2021	32,292	MW
2022	Thu 02-Jun-2022	31,756	MW
2023 (YTD)	Mon 10-Jul-2023	28,937	MW

Week-on-Week Residual Peak Demand

[2023 weeks compared to similar 2022 weeks]

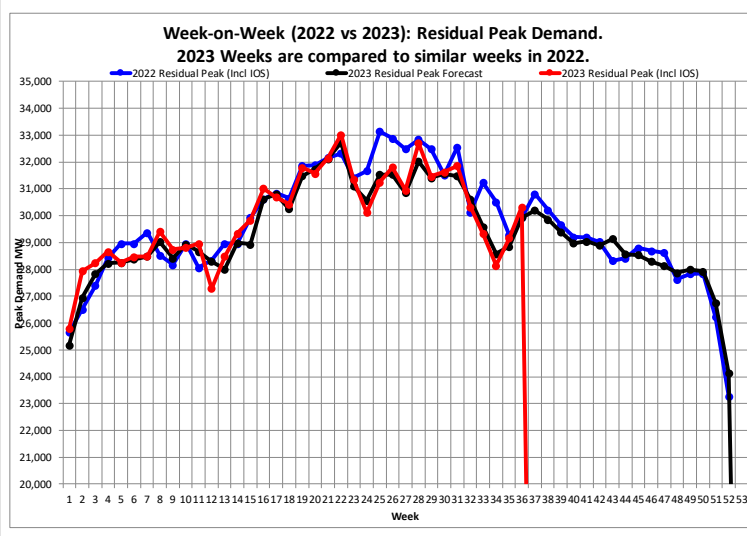

Week 36 : Residual Peak Demand Statistics		
Peak Demand	30,319	MW
Week-on-Week Growth	1.32	%
Year-on-Year Growth (Year-to-Date) Annual	-0.36	%

Note:


2023 Weeks are compared to similar weeks in 2022.

(2023 week 1 ~ 2022 week 1)

Annual Residual Peak Demand Statistics			
Year	Peak Date	Annual Peak	Unit
2018	Tue 29-May-2018	34,907	MW
2019	Thu 30-May-2019	33,746	MW
2020	Wed 15-Jul-2020	32,756	MW
2021	Tue 08-Jun-2021	34,029	MW
2022	Thu 23-Jun-2022	33,136	MW
2023 (YTD)	Tue 30-May-2023	33,016	MW

Week-on-Week RSA Contracted Peak Demand

[2023 weeks compared to similar 2022 weeks]

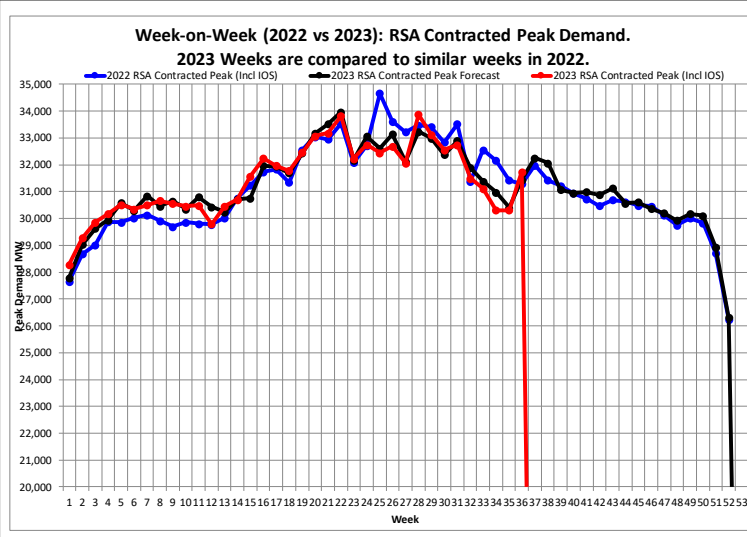

Week 36 : RSA Contracted Peak Demand Statistics		
Peak Demand	31,746	MW
Week-on-Week Growth	1.47	%
Year-on-Year Growth (Year-to-Date) Annual	-2.29	%

Note:

2023 Weeks are compared to similar weeks in 2022.

(2023 week 1 ~ 2022 week 1)

Annual RSA Contracted Peak Demand Statistics			
Year	Peak Date	Annual Peak	Unit
2018	Tue 29-May-2018	35,345	MW
2019	Thu 30-May-2019	34,510	MW
2020	Tue 01-Sep-2020	34,155	MW
2021	Thu 22-Jul-2021	35,005	MW
2022	Thu 23-Jun-2022	34,666	MW
2023 (YTD)	Mon 10-Jul-2023	33,873	MW

Weekly Generation Availability

	Week														Annual (Jan - Dec)	
	23	24	25	26	27	28	29	30	31	32	33	34	35	36	2023	2022
Energy Availability Factor (Eskom EAF)	59.14	57.29	57.91	58.19	57.54	56.02	57.16	57.18	58.73	56.75	56.37	55.13	53.47	52.62	54.40	58.00
Planned Outage Factor	5.95	9.58	8.01	8.14	9.47	6.82	6.07	7.52	7.29	8.86	9.69	10.49	12.84	11.92	10.13	10.62
Unplanned Outage Factor	33.85	32.03	32.84	32.82	32.41	36.71	35.87	34.19	33.06	33.48	32.74	33.44	32.99	34.67	34.19	29.86
Other Outage Factor	1.06	1.10	1.24	0.85	0.58	0.45	0.90	1.11	0.92	0.91	1.20	0.94	0.70	0.79	1.28	1.52

EAF: Ratio of the available energy generation over a given time period to the maximum amount of energy which could be produced over the same time period.

Outage Factors: Ratio of energy losses over a given time period to the maximum amount of energy which could be produced over the same time period.

YTD: Year-to-Date (01 January of current year to current week)

52 Week Outlook

This is the forecast demand vs. available generating capacity for each week for 52 weeks ahead. Colour codes ranging from Green (no shortage) to Red (worst case) are used to indicate the absence or presence of a capacity constraint.

Week Start	Week	MW RSA Contracted Forecast	MW Residual Forecast	MW Available Dispatchable Capacity	MW Available Capacity (Less OR and UA)	MW Planned Maintenance	MW Unplanned Outage Assumption (UA)	MW Planned Risk Level (-18200 MW)	MW Likely Risk Scenario (-20200 MW)
11-Sep-23	37	32257	30200	45597	27397	3594	16000		
18-Sep-23	38	32063	29856	44691	26491	4500	16000		
25-Sep-23	39	31078	29391	44041	25841	5150	16000		
02-Oct-23	40	30953	28976	43958	25758	5233	16000		
09-Oct-23	41	30997	29039	44066	25866	5125	16000		
16-Oct-23	42	30875	28899	44337	26137	4854	16000		
23-Oct-23	43	31121	29144	44724	26524	4467	16000		
30-Oct-23	44	30573	28564	43949	25749	5242	16000		
06-Nov-23	45	30606	28538	44083	25883	5108	16000		
13-Nov-23	46	30370	28302	44140	25940	5051	16000		
20-Nov-23	47	30204	28136	43500	25300	5691	16000		
27-Nov-23	48	29935	27867	42837	24637	6354	16000		
04-Dec-23	49	30174	27992	42837	24637	6354	16000		
11-Dec-23	50	30109	27927	43017	24817	6174	16000		
18-Dec-23	51	28935	26752	42668	24468	6523	16000		
25-Dec-23	52	26312	24130	39608	21408	9583	16000		
01-Jan-24	1	27780	25636	40533	22333	8658	16000		
08-Jan-24	2	29422	27278	41715	23515	7476	16000		
15-Jan-24	3	29883	27739	42580	24380	6611	16000		
22-Jan-24	4	30203	28059	42580	24380	6611	16000		
29-Jan-24	5	30358	28214	42580	24380	6611	16000		
05-Feb-24	6	30700	28610	43425	25225	5766	16000		
12-Feb-24	7	30793	28704	43425	25225	5766	16000		
19-Feb-24	8	30724	28635	43030	24830	6161	16000		
26-Feb-24	9	30567	28477	43030	24830	6161	16000		
04-Mar-24	10	30918	28958	43693	25493	5498	16000		
11-Mar-24	11	30966	29006	43516	25316	5675	16000		
18-Mar-24	12	30790	28807	43758	25558	5433	16000		
25-Mar-24	13	30764	28719	43342	25142	5849	16000		
01-Apr-24	14	31169	29620	44797	26597	4394	16000		
08-Apr-24	15	31684	30135	44327	26127	4864	16000		
15-Apr-24	16	32032	30483	45283	27083	3908	16000		
22-Apr-24	17	32418	30869	45108	26908	4083	16000		
29-Apr-24	18	32233	30877	45723	27523	3468	16000		
06-May-24	19	33030	31695	46316	28116	2875	16000		
13-May-24	20	33673	32338	46491	28291	2700	16000		
20-May-24	21	33942	32607	47211	29011	1980	16000		
27-May-24	22	34467	33131	47179	28979	2012	16000		
03-Jun-24	23	34299	32501	47179	28979	2012	16000		
10-Jun-24	24	34408	32610	47179	28979	2012	16000		
17-Jun-24	25	34302	32504	47754	29554	1437	16000		
24-Jun-24	26	34515	32717	47754	29554	1437	16000		
01-Jul-24	27	33834	32299	47414	29214	1777	16000		
08-Jul-24	28	34176	32642	46694	28494	2497	16000		
15-Jul-24	29	33948	32413	47134	28934	2057	16000		
22-Jul-24	30	34257	32722	47140	28940	2051	16000		
29-Jul-24	31	33502	31968	46555	28355	2636	16000		
05-Aug-24	32	33064	31447	45330	27130	3861	16000		
12-Aug-24	33	32520	30903	45330	27130	3861	16000		
19-Aug-24	34	32414	30798	44552	26352	4639	16000		
26-Aug-24	35	31943	30327	44857	26657	4334	16000		
02-Sep-24	36	32476	30789	45047	26847	4144	16000		
09-Sep-24	37	32413	30726	44599	26399	4592	16000		
16-Sep-24	38	31807	30120	43679	25479	5512	16000		

Notes - Assumptions critical:

The maintenance plan included in these assumptions includes a base scenario of outages (planned risk level). As there is opportunity for further outages, these will be included. This "likely risk scenario" includes an additional 1500 MW of outages on the base plan.

The expected imports at Apollo is included.

Avon and Dedisa is also included.

The forecast used is the latest operational weekly residual peak forecast, which excludes the expected renewable generation.

Operating Reserve (OR) from Generation: 2 200 MW

Unplanned Outage Assumption (UA): 16 000 MW

Reserves: OR + UA = 18 200 MW

Eskom Installed Capacity: 48 186 MW.

Installed Dispatchable Capacity: 49 191 MW (Incl. Avon and Dedisa).

Key:

Risk Level	Description
Green	Adequate Generation to meet Demand and Reserves.
Yellow	< 1 000MW Possibly short to meet Reserves
Orange	1 001MW - 2 000MW Definitely short to meet Reserves and possibly Demand
Red	> 2 001MW Short to meet Demand and Reserves

Medium Term Peak Demand/Capacity Forecast

Please go to the link below for the Medium-term System Adequacy Outlook - 2023 to 2027. (Published 30 October 2022).

<https://www.eskom.co.za/wp-content/uploads/2022/10/Medium-Term-System-Adequacy-Outlook-2023-2027.pdf>

or Download the medium-term system adequacy outlook 2023 – 2027 from

<https://www.eskom.co.za/eskom-divisions/tx/system-adequacy-reports/>

Renewable Energy Statistics

Note: Times are expressed as hour beginning

Current Installed Capacity (MW)	
CSP	500.0
PV	2,287.1
Wind (Eskom+IPP)	3,442.6
Total (Incl other REs)	6,280.2
Estimated Rooftop PV	4,841.0

Maximum Contribution (MW) - based on System Operator data (subject to metering verification)					
Cal Year	Indicator	CSP	PV	Wind (Eskom+IPP)	Total (Incl other REs)
All Time	Maximum	506.2	2,099.5	3,102.2	5,126.1
	Max Date	15-Mar-2022 15:00	24-Oct-2021 12:00	25-Aug-2023 20:00	05-Sep-2022 12:00
2016	Maximum	200.9	1,350.5	1,229.8	2,576.3
	Max Date	11-Aug-2016 14:00	16-Dec-2016 12:00	23-Dec-2016 13:00	23-Dec-2016 13:00
2017	Maximum	302.0	1,432.5	1,708.2	3,142.7
	Max Date	07-Nov-2017 10:00	27-Oct-2017 12:00	25-Dec-2017 18:00	13-Dec-2017 13:00
2018	Maximum	399.7	1,392.1	1,902.3	3,298.9
	Max Date	04-Dec-2018 16:00	03-Oct-2018 12:00	02-Oct-2018 16:00	28-Sep-2018 11:00
2019	Maximum	502.1	1,375.6	1,872.0	3,530.6
	Max Date	24-Sep-2019 11:00	19-Jan-2019 12:00	14-Dec-2019 15:00	27-Oct-2019 13:00
2020	Maximum	504.5	1,929.2	2,113.9	4,050.0
	Max Date	25-Nov-2020 12:00	25-Nov-2020 12:00	01-Dec-2020 19:00	24-Nov-2020 13:00
2021	Maximum	504.9	2,099.5	2,639.3	4,784.7
	Max Date	30-Nov-2021 16:00	24-Oct-2021 12:00	15-Dec-2021 17:00	01-Nov-2021 13:00
2022	Maximum	506.2	2,048.8	3,028.1	5,126.1
	Max Date	15-Mar-2022 15:00	20-Nov-2022 11:00	02-Dec-2022 16:00	05-Sep-2022 12:00
2023	Maximum	505.8	2,044.1	3,102.2	4,877.8
	Max Date	21-Feb-2023 13:00	21-Feb-2023 12:00	25-Aug-2023 20:00	20-Feb-2023 15:00

Annual Energy Contribution (MWh) - based on System Operator data (subject to metering verification)					
Cal Year	Indicator	CSP	PV	Wind (Eskom+IPP)	Total (Incl other REs)
All Time	Annual Energy	1,656,017	5,069,146	9,692,373	16,202,974
2016	Total Energy	529,522	2,630,141	3,730,771	6,951,261
	Total Energy	687,703	3,324,857	5,081,023	9,198,632
2017	Total Energy	1,031,288	3,282,124	6,467,095	10,887,902
	Total Energy	1,557,151	3,324,989	6,624,642	11,586,945
2018	Total Energy	1,626,049	4,140,212	6,625,830	12,478,704
	Total Energy	1,656,017	5,069,146	8,359,224	15,208,327
2019	Total Energy	1,448,276	4,844,736	9,692,373	16,202,974
	Total Energy	914,525	3,400,878	8,195,480	12,715,658

Maximum Difference between Consecutive Evening Peaks (MW) - based on System Operator data (subject to metering verification)		
Cal Year	Indicator	Total (Incl other REs)
All Time	Maximum	2,148
	Max Date	20-Apr-2023 to 21-Apr-2023
2016	Maximum	828
	Max Date	30-Aug-2016 to 31-Aug-2016
2017	Maximum	1,038
	Max Date	19-Jun-2017 to 20-Jun-2017
2018	Maximum	1,336
	Max Date	01-Sep-2018 to 02-Sep-2018
2019	Maximum	1,464
	Max Date	05-Jul-2019 to 06-Jul-2019
2020	Maximum	1,488
	Max Date	31-Aug-2020 to 01-Sep-2020
2021	Maximum	1,744
	Max Date	07-Aug-2021 to 08-Aug-2021
2022	Maximum	1,523
	Max Date	07-Aug-2022 to 08-Aug-2022
2023	Maximum	2,148
	Max Date	20-Apr-2023 to 21-Apr-2023

Maximum proportion that Renewables contributed towards actual hourly energy supplied (%) - based on System Operator data (subject to metering verification)		
Cal Year	Indicator	Total (Incl other REs)
All Time	Maximum	21.8%
	Max Date	20-Feb-2023 15:00
2016	Maximum	9.8%
	Max Date	23-Dec-2016 13:00
2017	Maximum	12.7%
	Max Date	25-Dec-2017 15:00
2018	Maximum	13.1%
	Max Date	01-Jan-2018 14:00
2019	Maximum	13.9%
	Max Date	14-Dec-2019 14:00
2020	Maximum	16.1%
	Max Date	27-Dec-2020 15:00
2021	Maximum	19.1%
	Max Date	01-Nov-2021 13:00
2022	Maximum	19.3%
	Max Date	05-Sep-2022 12:00
2023	Maximum	21.8%
	Max Date	20-Feb-2023 15:00