

Weekly System Status Report – 2024 Week 11 (11/03/2024 – 17/03/2024)

Introduction

This document is intended to provide a general picture of the Adequacy of the National Electricity Supply System in the medium term. The Report will be updated weekly, on Tuesdays and circulated Wednesdays, thereafter, published on the Eskom website, updated on Wednesdays. The values contained in this report are unverified and not official yet and can change at any time.

Disclaimer

The Data published here is for information purposes only. The content is subject to verification and validation. Eskom shall not be held responsible for any errors or it being misleading or incomplete and accepts no liability whatsoever for any loss, damages, or expenses, howsoever, incurred or suffered, resulting, or arising, from the use of this Data or any reliance placed on it.

Historic Daily Peak System Capacity/Demand

Date	Available Dispatchable Generation (MW)	Non-commercial Generation (MW)	Residual Load Forecast (MW)	Actual Residual Demand (MW) Incl IOS	Operating Reserve Margin (Excl Non-Commercial Units)	Operating Reserve Margin (Incl Non-Commercial Units)	Forecast vs. Actual (Residual Demand)
Mon 11/Mar/2024	27,036	663	26,986	26,908	0.5%	2.9%	0.3%
Tue 12/Mar/2024	27,084	609	26,700	26,114	3.7%	6.0%	2.2%
Wed 13/Mar/2024	27,163	545	27,029	26,151	3.9%	6.0%	3.4%
Thu 14/Mar/2024	28,055	706	27,295	27,626	1.6%	4.1%	-1.2%
Fri 15/Mar/2024	27,368	635	25,848	25,924	5.6%	8.0%	-0.3%
Sat 16/Mar/2024	27,125	724	24,803	24,833	9.2%	12.1%	-0.1%
Sun 17/Mar/2024	26,550	723	24,701	24,583	8.0%	10.9%	0.5%


Date	Total Available Generation Incl Renewables (MW)	Non-commercial Generation (MW)	RSA Contracted Load Forecast (MW)	Actual RSA Contracted Demand (MW) Incl IOS	Operating Reserve Margin (Excl Non-Commercial Units)	Operating Reserve Margin (Incl Non-Commercial Units)	Forecast vs. Actual (RSA Contracted Demand)
Mon 11/Mar/2024	29,258	663	28,740	29,131	0.4%	2.7%	-1.3%
Tue 12/Mar/2024	29,568	609	28,743	28,598	3.4%	5.5%	0.5%
Wed 13/Mar/2024	30,173	546	29,133	29,095	3.7%	5.6%	0.1%
Thu 14/Mar/2024	29,587	706	28,710	29,158	1.5%	3.9%	-1.5%
Fri 15/Mar/2024	29,158	635	27,483	27,714	5.2%	7.5%	-0.8%
Sat 16/Mar/2024	29,377	724	26,544	27,086	8.5%	11.1%	-2.0%
Sun 17/Mar/2024	28,351	720	26,725	26,985	5.1%	7.7%	-1.0%

Notes:

1. Available Dispatchable Generation means **all generation resources** that can be dispatched by Eskom and includes capacity available from all emergency generation resources.
2. RSA Contracted Load Forecast is the total official day-ahead hourly forecast. Residual Load Forecast excludes the expected generation from renewables.
3. Actual Residual Demand is the aggregated metered hourly sent-out generation and imports from dispatchable resources and includes demand reductions. The Actual RSA Contracted Demand includes renewable generation.
4. Net Maximum Dispatchable Capacity (including imports and emergency generation resources) = 49 191 MW.
5. These figures do not include any demand side products.
6. The peak hours for the residual demand can differ from that of the RSA contracted demand, depending on renewable generation.

Week-on-Week Dispatchable Generation Energy Sent Out

[2023 weeks compared to similar 2022 weeks]

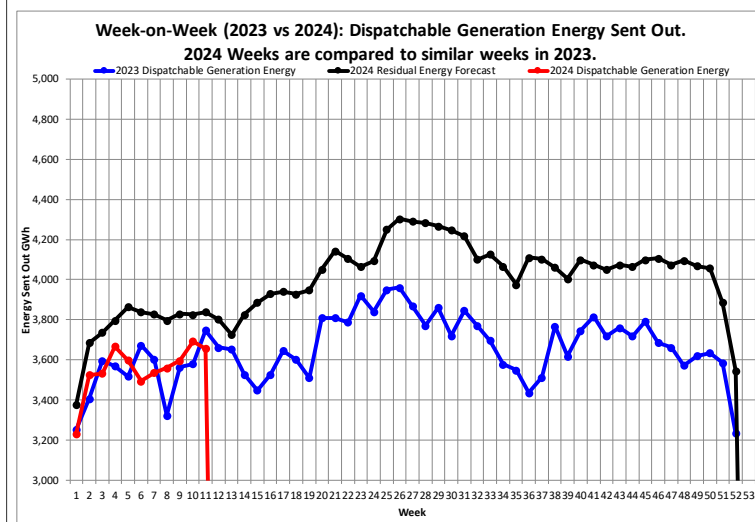


Week 11 : Dispatchable Generation Energy Sent Out Statistics		
Energy Sent Out	3,655	GWh
Week-on-Week Growth	-2.48	%
Year-on-Year Growth (Year-to-Date) Annual	0.66	%

Note:
 2024 Weeks are compared to similar weeks in 2023.
 (2024 week 1 ~ 2023 week 1)

Annual Dispatchable Generation Energy Sent Out Statistics			
Year	01 Jan to 17 Mar Energy	Annual Energy (01 Jan to 31 Dec)	Unit
2019	45,117	219,575	GWh
2020	45,094	206,725	GWh
2021	42,686	210,022	GWh
2022	43,164	202,845	GWh
2023	38,211	190,433	GWh
2024 (YTD)	39,082		GWh

Week-on-Week Residual Energy Demand

[2023 weeks compared to similar 2022 weeks]

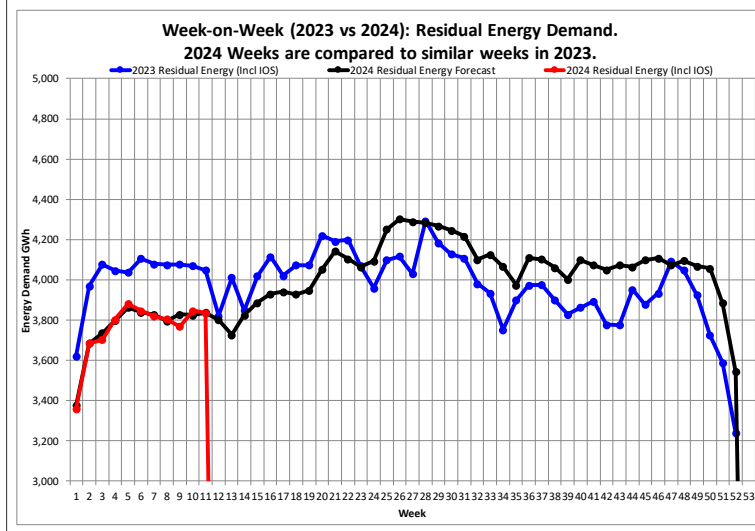


Week 11 : Residual Energy Demand Statistics		
Energy Demand	3,836	GWh
Week-on-Week Growth	-5.22	%
Year-on-Year Growth (Year-to-Date) Annual	-6.46	%

Note:
 2024 Weeks are compared to similar weeks in 2023.
 (2024 week 1 ~ 2023 week 1)

Annual Residual Energy Demand Statistics			
Year	01 Jan to 17 Mar Energy	Annual Energy (01 Jan to 31 Dec)	Unit
2019	45,506	220,937	GWh
2020	45,938	208,151	GWh
2021	43,243	211,958	GWh
2022	43,592	211,132	GWh
2023	43,598	207,189	GWh
2024 (YTD)	41,355		GWh

Week-on-Week RSA Contracted Energy Demand

[2023 weeks compared to similar 2022 weeks]

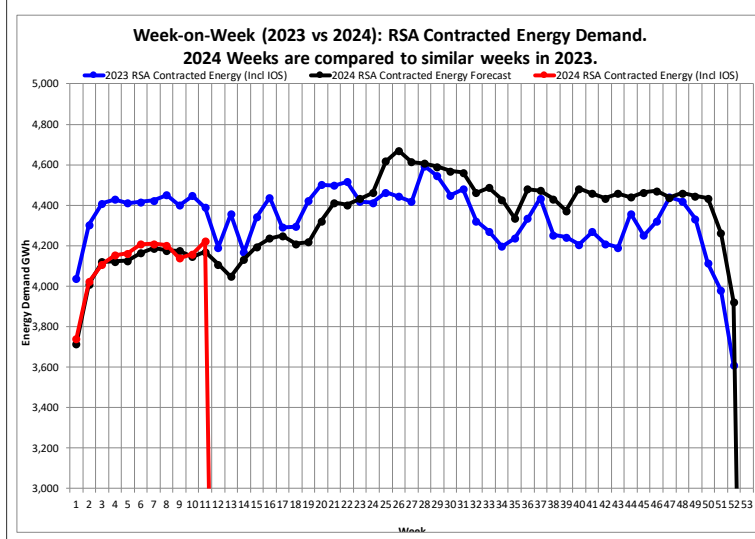


Week 11 : RSA Contracted Energy Demand Statistics		
Energy Demand	4,222	GWh
Week-on-Week Growth	-3.80	%
Year-on-Year Growth (Year-to-Date) Annual	-5.80	%

Note:
 2024 Weeks are compared to similar weeks in 2023.
 (2024 week 1 ~ 2023 week 1)

Annual RSA Contracted Energy Demand Statistics			
Year	01 Jan to 17 Mar Energy	Annual Energy (01 Jan to 31 Dec)	Unit
2019	48,108	232,524	GWh
2020	48,444	220,630	GWh
2021	46,331	227,166	GWh
2022	46,804	227,335	GWh
2023	47,467	225,874	GWh
2024 (YTD)	45,327		GWh

Week-on-Week Dispatchable Generation Peak Demand

[2023 weeks compared to similar 2022 weeks]

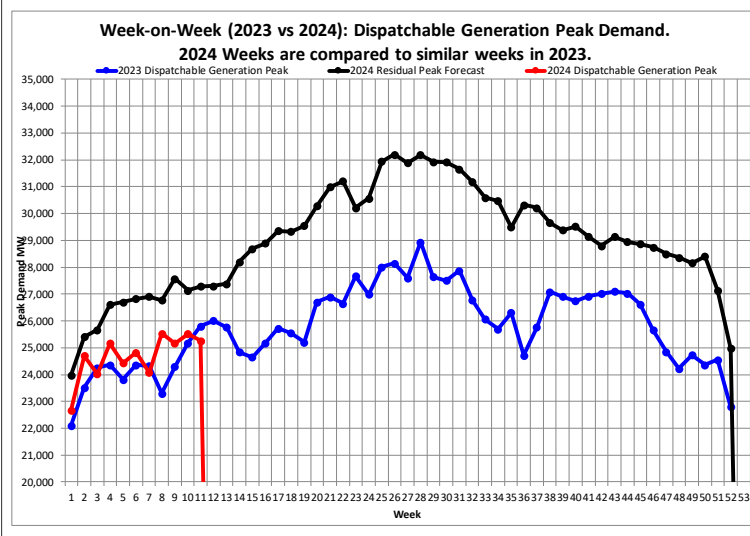

Week 11 : Dispatchable Generation Peak Demand Statistics		
Peak Demand	25,262	MW
Week-on-Week Growth	-2.10	%
Year-on-Year Growth (Year-to-Date) Annual	-1.04	%

Note:


2024 Weeks are compared to similar weeks in 2023.

(2024 week 1 ~ 2023 week 1)

Annual Dispatchable Generation Peak Demand Statistics			
Year	Peak Date	Annual Peak	Unit
2019	Thu 30-May-2019	33,066	MW
2020	Wed 17-Jun-2020	32,384	MW
2021	Thu 15-Jul-2021	32,292	MW
2022	Thu 02-Jun-2022	31,756	MW
2023	Mon 10-Jul-2023	28,937	MW
2024 (YTD)	Wed 21-Feb-2024	25,535	MW

Week-on-Week Residual Peak Demand

[2023 weeks compared to similar 2022 weeks]

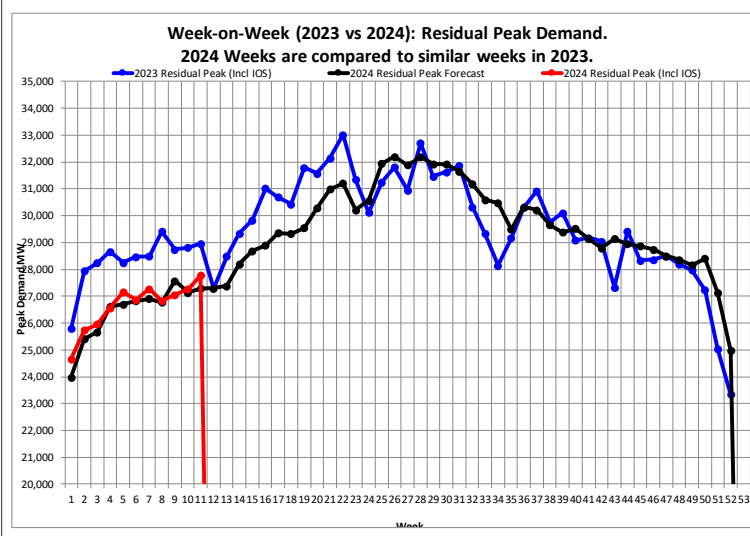

Week 11 : Residual Peak Demand Statistics		
Peak Demand	27,776	MW
Week-on-Week Growth	-4.07	%
Year-on-Year Growth (Year-to-Date) Annual	-5.54	%

Note:


2024 Weeks are compared to similar weeks in 2023.

(2024 week 1 ~ 2023 week 1)

Annual Residual Peak Demand Statistics			
Year	Peak Date	Annual Peak	Unit
2019	Thu 30-May-2019	33,746	MW
2020	Wed 15-Jul-2020	32,756	MW
2021	Tue 08-Jun-2021	34,029	MW
2022	Thu 23-Jun-2022	33,136	MW
2023	Tue 30-May-2023	33,016	MW
2024 (YTD)	Thu 14-Mar-2024	27,776	MW

Week-on-Week RSA Contracted Peak Demand

[2023 weeks compared to similar 2022 weeks]

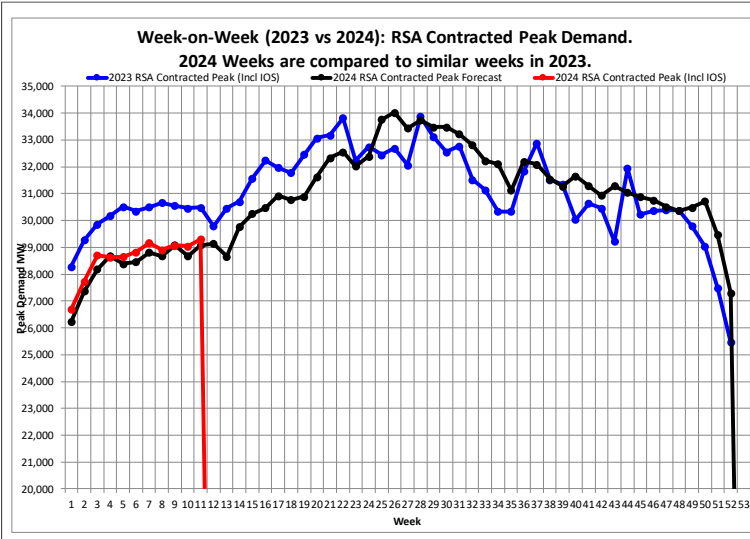

Week 11 : RSA Contracted Peak Demand Statistics		
Peak Demand	29,308	MW
Week-on-Week Growth	-3.88	%
Year-on-Year Growth (Year-to-Date) Annual	-4.42	%

Note:

2024 Weeks are compared to similar weeks in 2023.

(2024 week 1 ~ 2023 week 1)

Annual RSA Contracted Peak Demand Statistics			
Year	Peak Date	Annual Peak	Unit
2019	Thu 30-May-2019	34,510	MW
2020	Tue 01-Sep-2020	34,155	MW
2021	Thu 22-Jul-2021	35,005	MW
2022	Thu 23-Jun-2022	34,666	MW
2023	Mon 10-Jul-2023	33,873	MW
2024 (YTD)	Thu 14-Mar-2024	29,308	MW

Weekly Generation Availability

	Week											Annual (Jan - Dec)				
	50	51	52	1	2	3	4	5	6	7	8	9	10	11	2024	2023
Energy Availability Factor (Eskom EAF)	54.72	54.66	49.51	48.65	51.50	51.89	52.97	51.50	50.58	52.51	51.61	54.04	53.85	53.80	52.12	54.71
Planned Outage Factor	17.89	17.29	19.07	18.93	17.22	17.63	16.76	16.37	15.92	17.13	16.75	16.07	13.15	14.42	16.36	10.88
Unplanned Outage Factor	26.16	26.91	30.38	31.16	30.03	29.08	29.18	31.19	32.40	29.35	30.48	28.89	32.51	31.32	30.52	33.08
Other Outage Factor	1.23	1.14	1.04	1.26	1.25	1.40	1.09	0.94	1.10	1.01	1.16	1.00	0.49	0.46	1.00	1.33

EAF: Ratio of the available energy generation over a given time period to the maximum amount of energy which could be produced over the same time period.

Outage Factors: Ratio of energy losses over a given time period to the maximum amount of energy which could be produced over the same time period.

YTD: Year-to-Date (01 January of current year to current week)

52 Week Outlook

This is the forecast demand vs. available generating capacity for each week for 52 weeks ahead. Colour codes ranging from Green (no shortage) to Red (worst case) are used to indicate the absence or presence of a capacity constraint.

Week Start	Week	MW RSA Contracted Forecast	MW Residual Forecast	MW Available Dispatchable Capacity	MW Available Capacity (Less OR and UA)	MW Planned Maintenance	MW Unplanned Outage Assumption (UA)	MW Planned Risk Level (-18200 MW)	MW Likely Risk Scenario (-20200 MW)
18-Mar-24	12	29139	27305	42862	24662	6329	16000		
25-Mar-24	13	28664	27386	41838	23638	7353	16000		
01-Apr-24	14	29771	28201	43364	27164	5827	14000		
08-Apr-24	15	30254	28684	43695	27495	5496	14000		
15-Apr-24	16	30470	28900	44358	28158	4833	14000		
22-Apr-24	17	30924	29354	43638	27438	5553	14000		
29-Apr-24	18	30769	29324	45053	28853	4138	14000		
06-May-24	19	30902	29551	44905	28705	4286	14000		
13-May-24	20	31632	30281	45587	29387	3604	14000		
20-May-24	21	32341	30990	46753	30553	2438	14000		
27-May-24	22	32556	31205	46900	30700	2291	14000		
03-Jun-24	23	32031	30211	46180	29980	3011	14000		
10-Jun-24	24	32388	30568	46366	30166	2825	14000		
17-Jun-24	25	33765	31945	46276	30076	2915	14000		
24-Jun-24	26	34023	32204	46366	30166	2825	14000		
01-Jul-24	27	33440	31884	46466	30266	2725	14000		
08-Jul-24	28	33738	32182	46466	30266	2725	14000		
15-Jul-24	29	33487	31932	46611	30411	2580	14000		
22-Jul-24	30	33477	31921	46521	30321	2670	14000		
29-Jul-24	31	33217	31661	46445	30245	2746	14000		
05-Aug-24	32	32815	31183	45403	29203	3788	14000		
12-Aug-24	33	32235	30602	45276	29076	3915	14000		
19-Aug-24	34	32102	30469	45230	29030	3961	14000		
26-Aug-24	35	31122	29489	45276	29076	3915	14000		
02-Sep-24	36	32206	30318	45091	28891	4100	14000		
09-Sep-24	37	32100	30213	44498	28298	4693	14000		
16-Sep-24	38	31551	29663	44568	28368	4623	14000		
23-Sep-24	39	31272	29384	43550	27350	5641	14000		
30-Sep-24	40	31663	29516	44331	28231	4760	14000		
07-Oct-24	41	31291	29143	42903	26703	6288	14000		
14-Oct-24	42	30935	28796	42903	26703	6288	14000		
21-Oct-24	43	31288	29140	43478	27278	5713	14000		
28-Oct-24	44	31043	28945	42643	26443	6548	14000		
04-Nov-24	45	30877	28868	42737	26537	6454	14000		
11-Nov-24	46	30756	28747	43623	27423	5568	14000		
18-Nov-24	47	30513	28504	43830	27630	5361	14000		
25-Nov-24	48	30369	28360	43830	27630	5361	14000		
02-Dec-24	49	30491	28165	43585	27385	5606	14000		
09-Dec-24	50	30725	28398	43585	27385	5606	14000		
16-Dec-24	51	29472	27145	42318	26118	6873	14000		
23-Dec-24	52	27305	24979	41103	24903	8088	14000		
30-Dec-24	1	27003	24770	41428	25228	7763	14000		
06-Jan-25	2	29323	27090	42275	26075	6916	14000		
13-Jan-25	3	30006	27773	42007	25807	7184	14000		
20-Jan-25	4	30111	27878	41543	25343	7648	14000		
27-Jan-25	5	30338	28105	43153	26953	6038	14000		
03-Feb-25	6	30275	28153	43509	27309	5682	14000		
10-Feb-25	7	30453	28331	43509	27309	5682	14000		
17-Feb-25	8	30607	28486	42428	26228	6763	14000		
24-Feb-25	9	30504	28382	43723	27523	5468	14000		
03-Mar-25	10	30527	28547	42922	26722	6269	14000		
10-Mar-25	11	30947	28967	42591	26391	6600	14000		
17-Mar-25	12	30855	28808	43158	26958	6033	14000		
24-Mar-25	13	30724	28744	42733	26533	6458	14000		

Notes - Assumptions critical:

The maintenance plan included in these assumptions includes a base scenario of outages (planned risk level). As there is opportunity for further outages, these will be included. This "likely risk scenario" includes an additional 1500 MW of outages on the base plan.

The expected imports at Apollo is included.

Avon and Dedisa is also included.

The forecast used is the latest operational weekly residual peak forecast, which excludes the expected renewable generation.

Operating Reserve (OR) from Generation: 2 200 MW

Unplanned Outage Assumption (UA): 16 000 MW (14 000 MW from April 2024)

Reserves: OR + UA = 18 200 MW

Eskom Installed Capacity: 48 186 MW.

Installed Dispatchable Capacity: 49 191 MW (Incl. Avon and Dedisa).

Key:

Risk Level	Description
Green	Adequate Generation to meet Demand and Reserves.
Yellow	< 1 000MW Possibly short to meet Reserves
Orange	1 001MW - 2 000MW Definitely short to meet Reserves and possibly Demand
Red	> 2 001MW Short to meet Demand and Reserves

Medium Term Peak Demand/Capacity Forecast

Please go to the link below for the Medium-term System Adequacy Outlook - 2024 to 2028. (Published 30 October 2023).

https://www.eskom.co.za/wp-content/uploads/2023/11/Medium_Term_System_Adequacy_Outlook_2024-2028.pdf

or Download the medium-term system adequacy outlook 2024 – 2028 from

<https://www.eskom.co.za/eskom-divisions/tx/system-adequacy-reports/>

Renewable Energy Statistics

Note: Times are expressed as hour beginning

Current Installed Capacity (MW)	
CSP	500.0
PV	2,287.1
Wind (Eskom+IPP)	3,442.6
Hybrid	150.0
Total (Incl other REs)	6,430.2
Estimated Rooftop PV	5,439.9

Maximum Contribution (MW) - based on System Operator data (subject to metering verification)					
Cal Year	Indicator	CSP	PV	Wind (Eskom+IPP)	Total (Incl other REs)
All Time	Maximum	506.2	2,111.7	3,102.2	5,129.8
	Max Date	15-Mar-2022 15:00	10-Feb-2024 12:00	25-Aug-2023 20:00	15-Sep-2023 13:00
2016	Maximum	200.9	1,350.5	1,229.8	2,576.3
Dec 2016	Max Date	09-Dec-2016 12:00	16-Dec-2016 12:00	23-Dec-2016 13:00	23-Dec-2016 13:00
2017	Maximum	302.0	1,432.5	1,708.2	3,142.7
Dec 2017	Max Date	23-Dec-2017 16:00	25-Dec-2017 12:00	25-Dec-2017 18:00	13-Dec-2017 13:00
2018	Maximum	399.7	1,392.1	1,902.3	3,298.9
Dec 2018	Max Date	04-Dec-2018 16:00	13-Dec-2018 12:00	27-Dec-2018 16:00	01-Dec-2018 12:00
2019	Maximum	502.1	1,375.6	1,872.0	3,530.6
Dec 2019	Max Date	19-Dec-2019 11:00	15-Dec-2019 11:00	14-Dec-2019 15:00	14-Dec-2019 14:00
2020	Maximum	504.5	1,929.2	2,113.9	4,050.0
Dec 2020	Max Date	11-Dec-2020 12:00	02-Dec-2020 11:00	01-Dec-2020 19:00	01-Dec-2020 13:00
2021	Maximum	504.9	2,099.5	2,639.3	4,784.7
Dec 2021	Max Date	29-Dec-2021 11:00	01-Dec-2021 12:00	15-Dec-2021 17:00	15-Dec-2021 15:00
2022	Maximum	506.2	2,048.8	3,028.1	5,126.1
Dec 2022	Max Date	04-Dec-2022 09:00	03-Dec-2022 12:00	02-Dec-2022 16:00	02-Dec-2022 15:00
2023	Maximum	505.8	2,047.8	3,102.2	5,129.8
Dec 2023	Max Date	14-Dec-2023 15:00	08-Dec-2023 11:00	14-Dec-2023 18:00	14-Dec-2023 15:00
2024	Maximum	501.3	2,111.7	3,049.9	4,995.7
Dec 2024	Max Date				

Annual Energy Contribution (MWh) - based on System Operator data (subject to metering verification)					
Cal Year	Indicator	CSP	PV	Wind (Eskom+IPP)	Total (Incl other REs)
All Time	Annual Energy	1,656,017	5,069,146	11,613,364	18,241,202
2016	Total	529,522	2,630,141	3,730,771	6,951,261
Dec 2016	Total	45,871	329,889	389,040	773,152
2017	Total	687,703	3,324,857	5,081,023	9,198,632
Dec 2017	Total	120,490	335,874	579,133	1,043,570
2018	Total	1,031,288	3,282,124	6,467,095	10,887,902
Dec 2018	Total	138,945	333,543	560,078	1,040,835
2019	Total	1,557,151	3,324,989	6,624,642	11,586,945
Dec 2019	Total	168,251	299,366	640,412	1,115,544
2020	Total	1,626,049	4,140,212	6,625,830	12,478,704
Dec 2020	Total	195,725	476,522	674,198	1,356,380
2021	Total	1,656,017	5,069,146	8,359,224	15,208,327
Dec 2021	Total	179,667	491,187	791,019	1,473,718
2022	Total	1,448,276	4,844,736	9,692,373	16,202,974
Dec 2022	Total	186,297	497,137	938,268	1,642,267
2023	Total	1,375,349	5,014,845	11,613,364	18,241,202
Dec 2023	Total	137,835	484,361	1,041,728	1,673,035
2024	Total	388,316	1,391,990	2,496,099	4,306,189
Dec 2024	Total				

Maximum Difference between Consecutive Evening Peaks (MW) - Total (Incl other REs)			Maximum proportion that Renewables contributed towards actual hourly energy - Total (Incl other REs)		
Cal Year	Indicator	Total (Incl other REs)	Cal Year	Indicator	Total (Incl other REs)
All Time	Maximum	2,148	All Time	Maximum	21.8%
	Max Date	20-Apr-2023 to 21-Apr-2023		Max Date	20-Feb-2023 15:00
2016	Maximum	828	2016	Maximum	9.8%
Dec 2016	Max Date	25-Dec-2016 to 26-Dec-2016	Dec 2016	Max Date	23-Dec-2016 13:00
2017	Maximum	1,038	2017	Maximum	12.7%
Dec 2017	Max Date	08-Dec-2017 to 09-Dec-2017	Dec 2017	Max Date	25-Dec-2017 15:00
2018	Maximum	1,336	2018	Maximum	13.1%
Dec 2018	Max Date	05-Dec-2018 to 06-Dec-2018	Dec 2018	Max Date	01-Dec-2018 12:00
2019	Maximum	1,464	2019	Maximum	13.9%
Dec 2019	Max Date	07-Dec-2019 to 08-Dec-2019	Dec 2019	Max Date	14-Dec-2019 14:00
2020	Maximum	1,488	2020	Maximum	16.1%
Dec 2020	Max Date	01-Dec-2020 to 02-Dec-2020	Dec 2020	Max Date	27-Dec-2020 15:00
2021	Maximum	1,744	2021	Maximum	19.1%
Dec 2021	Max Date	02-Dec-2021 to 03-Dec-2021	Dec 2021	Max Date	15-Dec-2021 13:00
2022	Maximum	1,523	2022	Maximum	19.3%
Dec 2022	Max Date	22-Dec-2022 to 23-Dec-2022	Dec 2022	Max Date	29-Dec-2022 14:00
2023	Maximum	2,148	2023	Maximum	21.8%
Dec 2023	Max Date	30-Dec-2023 to 31-Dec-2023	Dec 2023	Max Date	22-Dec-2023 12:00
2024	Maximum	1,591	2024	Maximum	19.8%
Dec 2024	Max Date		Dec 2024	Max Date	

Estimated Rooftop PV

Maximum/Installed Rooftop PV (MW):	Eastern Cape	Free State	Gauteng	KwaZulu-Natal	Limpopo	Mpumalanga	Northern Cape	North-West	Western Cape	Total
Feb-24	368.2	307.7	1,503.70	810.9	413.3	516.1	208.4	669.3	642.4	5,439.90
Jan-24	368.2	280.2	1,503.70	810.9	413.3	516.1	208.4	669.3	642.4	5,412.30
Dec-23	368.2	280.2	1,295.00	810.9	413.3	516.1	208.4	669.3	642.4	5,203.70
Nov-23	368.2	280.2	1,216.60	810.9	413.3	509.3	129.5	669.3	642.4	5,039.60
Oct-23	368.2	280.2	1,207.80	810.9	413.3	509.3	129.5	669.3	616.8	5,005.00
Sep-23	368.2	280.2	1,207.80	810.9	413.3	476.6	129.5	669.3	527.4	4,883.00
Aug-23	368.2	280.2	1,207.80	810.9	345.6	474.1	129.5	669.3	527.4	4,812.80
Jul-23	368.2	280.2	1,207.80	810.9	296.6	450.7	129.5	669.3	527.4	4,740.40
Jun-23	284.3	280.2	1207.8	565.8	296.6	450.7	129.5	669.3	527.4	4,411.50
May-23	190	204.9	1072.1	565.8	296.6	450.7	129.5	669.3	457.9	4,036.80
Apr-23	163.2	160.5	917.5	417.5	226.8	326.7	117.5	669.3	369	3,368.00
Mar-23	163.2	160.5	917.5	417.5	189.8	317.9	117.5	669.3	289.7	3,242.80
Feb-23	163.2	160.5	917.5	417.5	189.8	305.6	117.5	669.3	198	3,138.80
Jan-23	143.1	160.5	917.5	417.5	189.8	298.8	82.6	669.3	198	3,077.10
Dec-22	130.2	160.3	848.3	356.6	189.8	298.8	82	310.4	198	2,574.30
Nov-22	130.2	160.3	848.3	356.6	189.8	298.8	79.1	184.8	156.6	2,404.50
Oct-22	130.2	160.3	848.3	296.9	189.8	298.8	79.1	184.8	145.5	2,333.60
Sep-22	130.2	160.3	848.3	296.9	189.8	298.8	79.1	184.8	145.5	2,333.60
Aug-22	130.2	160.3	848.3	296.9	189.8	298.8	79.1	184.8	145.5	2,333.60
Jul-22	130.2	148.8	790.6	296.9	189.8	298.8	79.1	184.8	145.5	2,264.50

If there is a big jump from month to month it is mainly due to the high number of cloudy days during the latter month, not necessarily due to the number of installations in that month. It would very likely have been distributed in the preceding few months.