


Kendal Power Station - 30 Year ADF Model - Connectivity & Flow Diagram

STATUS QUO SYSTEM



NEW ADF SYSTEM

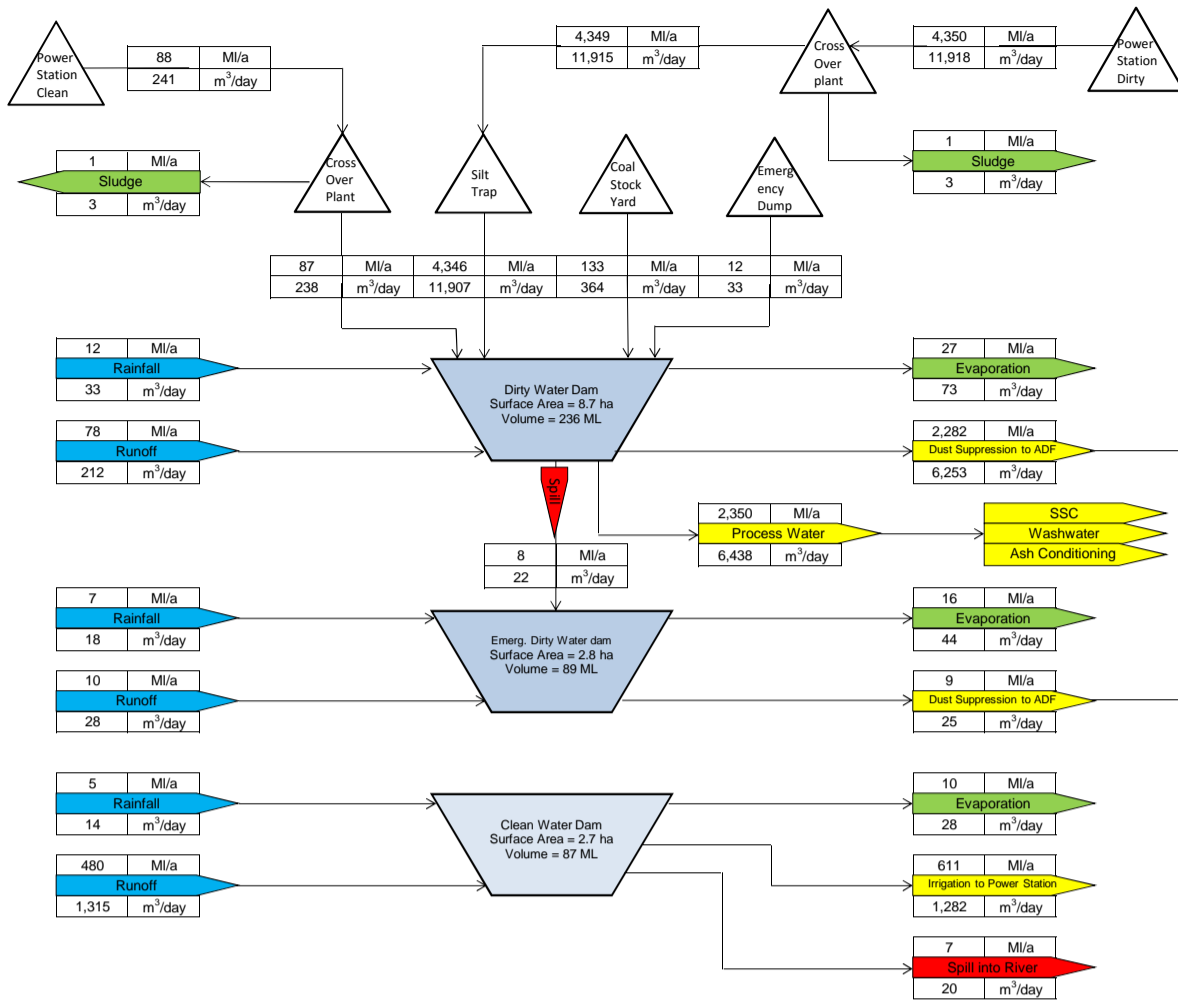

WATER BALANCE RESULTS

	Dam Vol. m³	% Full at start	Spills
Dirty Water Dam	236,553	80%	68
Emergency Dirty Water Dam	89,335	30%	0
Clean Water Dam	86,790	80%	24
Dam 1 (PCD)	130,000	0%	0
Dam 2 (PCD)	9,750	0%	1
Dam 3 (CWD)	158,000	0%	0
Dam 4 (PCD)	130,000	0%	0
Dam 5 (CWD)	197,000	0%	0
Dam 6 (PCD)	90,000	0%	0
Dam 7 (PCD)	130,000	0%	0