



NEW KOMSBERG 400/132KV SUBSTATION FOR IPPs

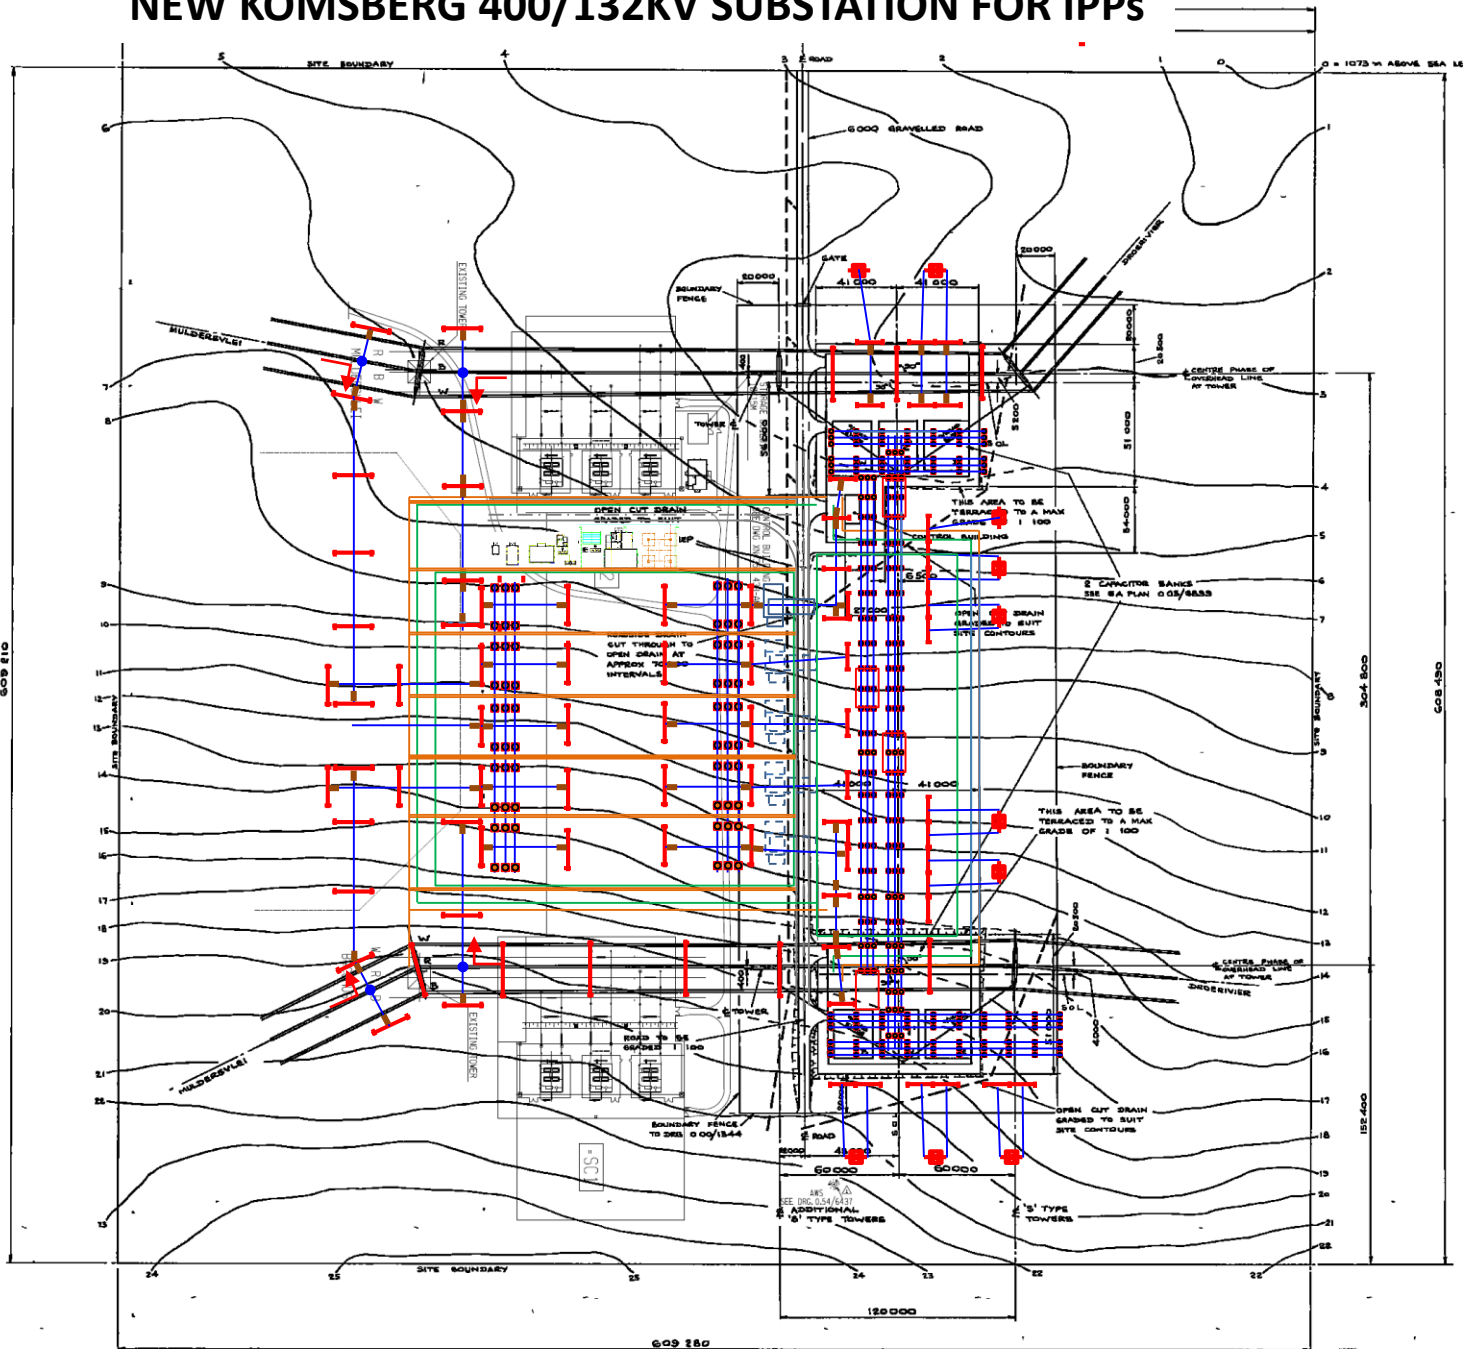

NEW KOMSBERG 400/132KV SUBSTATION FOR IPPs

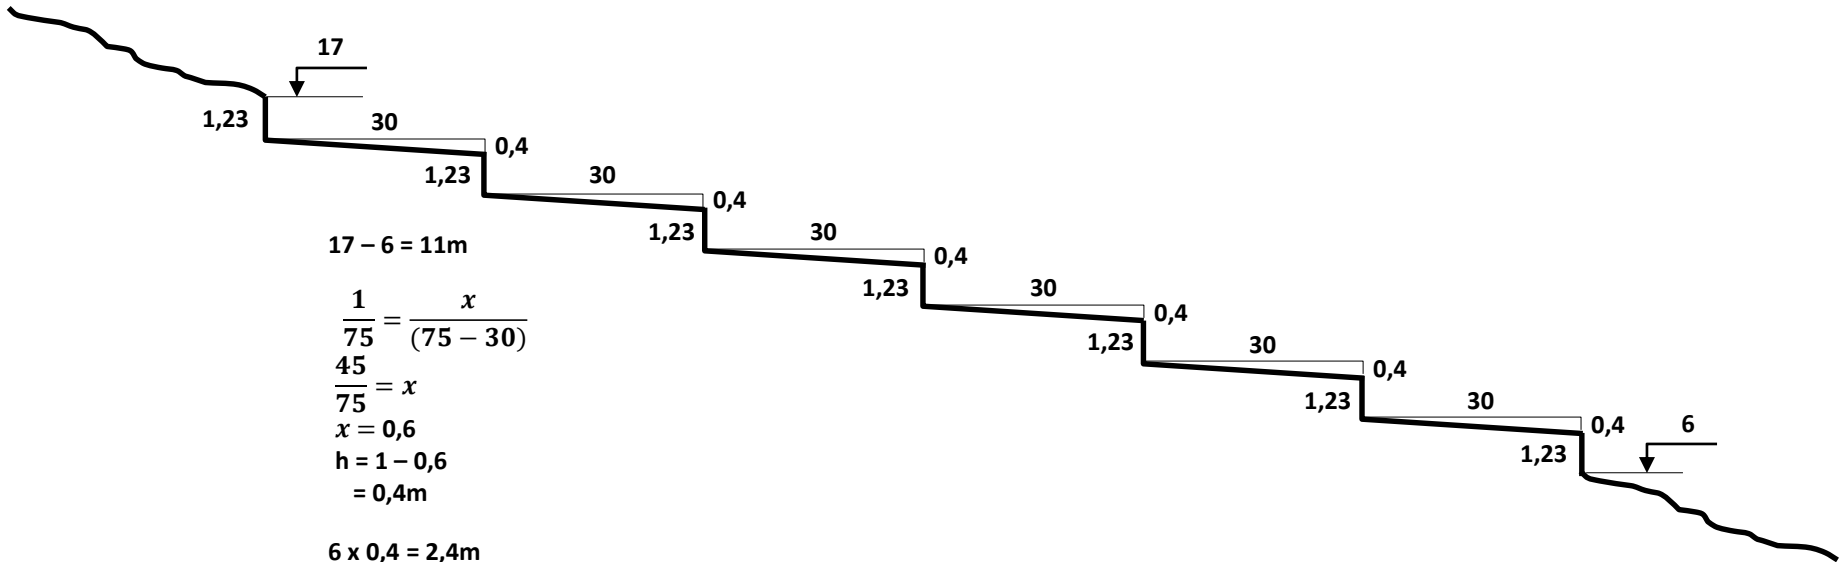

$$17 - 6 = 11\text{m}$$

$$\frac{1}{75} = \frac{x}{(75 - 30)}$$

$$\frac{45}{75} = x$$

$$x = 0,6$$

$$h = 1 - 0,6$$
$$= 0,4\text{m}$$

$$6 \times 0,4 = 2,4\text{m}$$

$$11 - 2,4 = 8,6\text{m}$$

$$8,6 \div 7 = 1,23\text{m}$$

NEW KOMSBERG 400/132KV SUBSTATION FOR IPPs

$$17 - 6 = 11\text{m}$$

$$\frac{1}{75} = \frac{x}{180}$$

$$\frac{180}{75} = x$$

$$x = 2,4$$

$$h = 1 - 0,6 \\ = 0,4\text{m}$$

$$11 - 2,4 = 8,6\text{m}$$

$$8,6 \div 2 = 4,3\text{m}$$

